




# OIL ANALYSIS REPORT

Sample Rating Trend

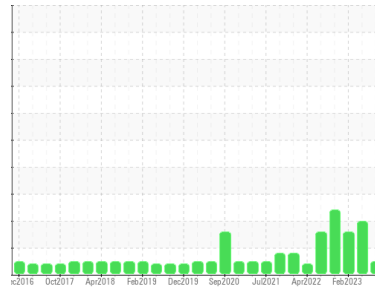

**NORMAL**



Machine Id  
**BEA 2 COOKER SE**

Component  
**Bearing**

Fluid  
**USPI GEAR 460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USPM29322</b>	USPM28220	USPM26378
Sample Date	Client Info		<b>19 Aug 2023</b>	13 May 2023	05 Feb 2023
Machine Age	yrs	Client Info	<b>0</b>	0	0
Oil Age	yrs	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>10</b>	2	18
Chromium	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Nickel	ppm	ASTM D5185m >20	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >20	<b>2</b>	<1	1
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	2
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	1	3
Phosphorus	ppm	ASTM D5185m	<b>187</b>	220	140
Zinc	ppm	ASTM D5185m	<b>0</b>	0	28
Sulfur	ppm	ASTM D5185m	<b>7080</b>	7692	5897

## CONTAMINANTS






	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>&lt;1</b>	0	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	<1
Water	%	ASTM D6304 >2	<b>0.003</b>	0.002	0.027
ppm Water	ppm	ASTM D6304	<b>36.8</b>	20.8	270

## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>2284</b>	▲ 10744	4368
Particles >6µm	ASTM D7647	>2500	<b>476</b>	▲ 2775	1319
Particles >14µm	ASTM D7647	>160	<b>52</b>	▲ 221	143
Particles >21µm	ASTM D7647	>40	<b>18</b>	▲ 68	31
Particles >38µm	ASTM D7647	>10	<b>1</b>	7	2
Particles >71µm	ASTM D7647	>3	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>20/18/14	<b>18/16/13</b>	▲ 21/19/15	19/18/14

## FLUID DEGRADATION


	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.45</b>	0.46	0.34

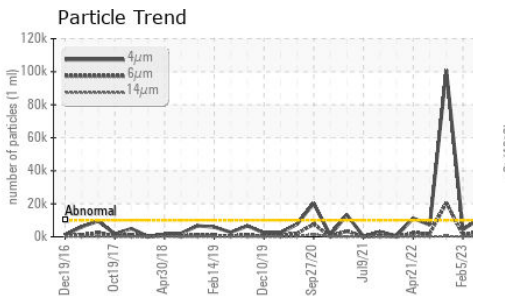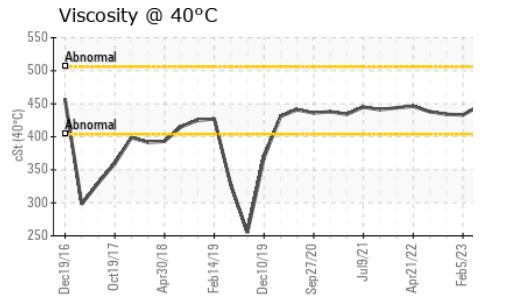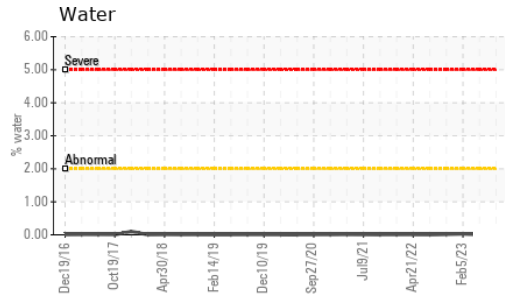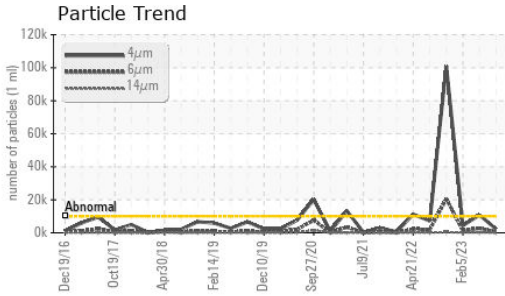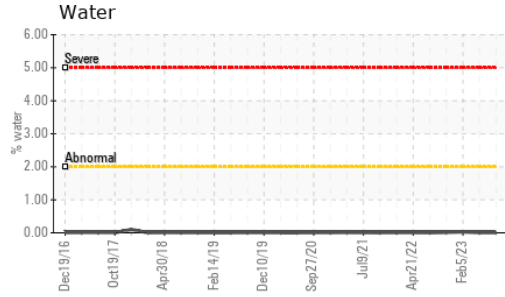






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	0.2%
Free Water	scalar	*Visual		NEG	▲ 1.0

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	445	447	433

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

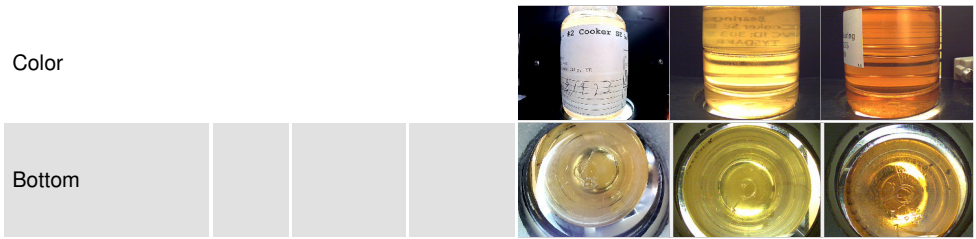

## GRAPHS

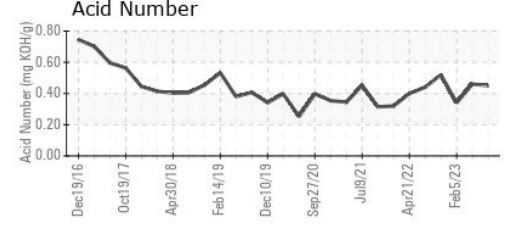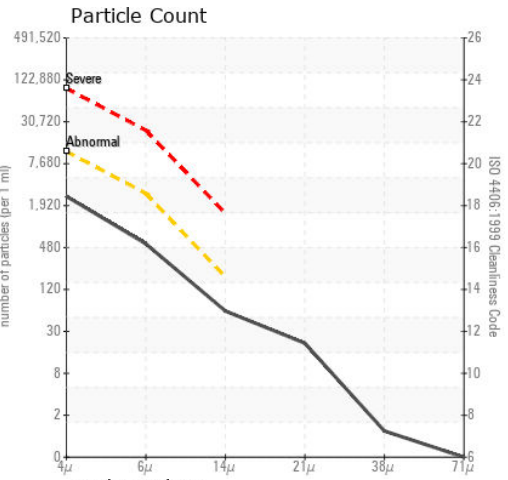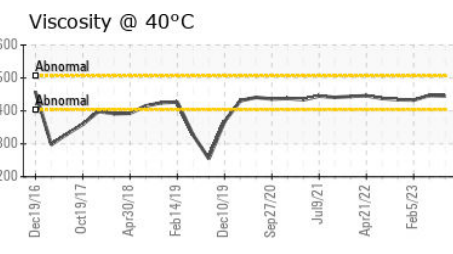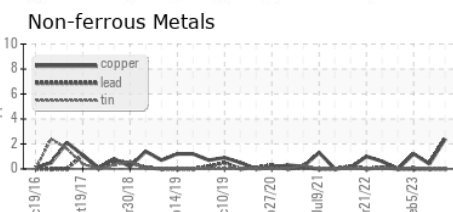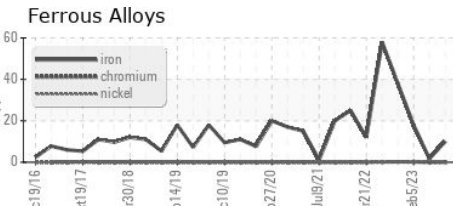

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USPM29322 **Received** : 23 Aug 2023  
**Lab Number** : 05932820 **Diagnosed** : 24 Aug 2023  
**Unique Number** : 10618091 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**TYSON**  
 US  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
 F: