




# OIL ANALYSIS REPORT

Sample Rating Trend

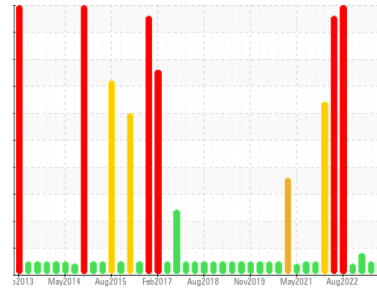

**NORMAL**



Area  
**TM 6**  
Machine Id  
**SOUTH EXHAUSTER**  
Component  
**Compressor**  
Fluid  
**REFRIG COMP OIL ISO 32 (60 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>RP0034419</b>	RP0023568	RP0023421
Sample Date	Client Info		<b>09 Aug 2023</b>	24 May 2023	21 Feb 2023
Machine Age	wks	Client Info	<b>0</b>	0	0
Oil Age	wks	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>12</b>	16	16
Iron	ppm	ASTM D5185m >50	<b>&lt;1</b>	1	3
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >25	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >25	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>&lt;1</b>	0	0
Tin	ppm	ASTM D5185m >15	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	<1

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 5	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 5	<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m 5	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m 5	<b>0</b>	0	8
Calcium	ppm	ASTM D5185m 12	<b>0</b>	<1	0
Phosphorus	ppm	ASTM D5185m 12	<b>80</b>	74	67
Zinc	ppm	ASTM D5185m 12	<b>0</b>	0	22

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>&lt;1</b>	2	<1
Sodium	ppm	ASTM D5185m	<b>0</b>	1	<1
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Water	%	ASTM D6304 >0.1	<b>0.00</b>	0.007	0.008
ppm Water	ppm	ASTM D6304 >1000	<b>0.00</b>	71.4	80.0






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	<b>3015</b>	4375	7731
Particles >6µm	ASTM D7647	>2500	<b>1021</b>	1123	▲ 2625
Particles >14µm	ASTM D7647	>320	<b>120</b>	106	298
Particles >21µm	ASTM D7647	>80	<b>35</b>	29	99
Particles >38µm	ASTM D7647	>20	<b>2</b>	2	4
Particles >71µm	ASTM D7647	>4	<b>0</b>	1	0
Oil Cleanliness	ISO 4406 (c)	>20/18/15	<b>19/17/14</b>	19/17/14	▲ 20/19/15

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.10	<b>0.16</b>	0.17	0.12

# OIL ANALYSIS REPORT

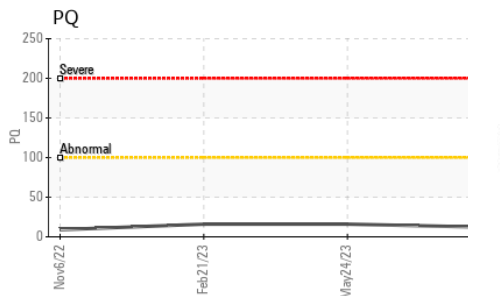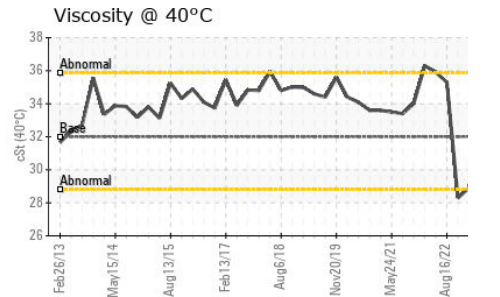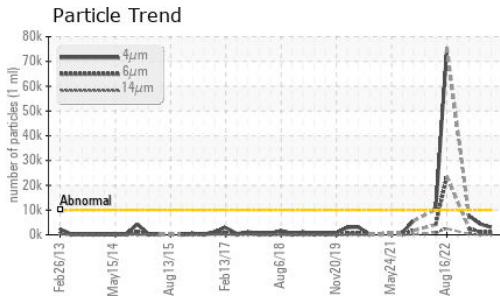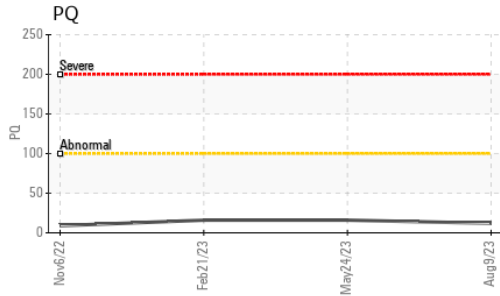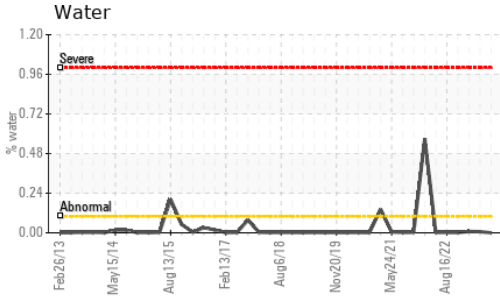






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	32.3	28.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------



## GRAPHS

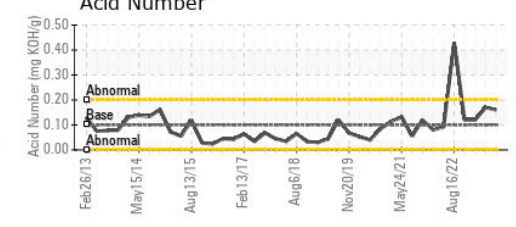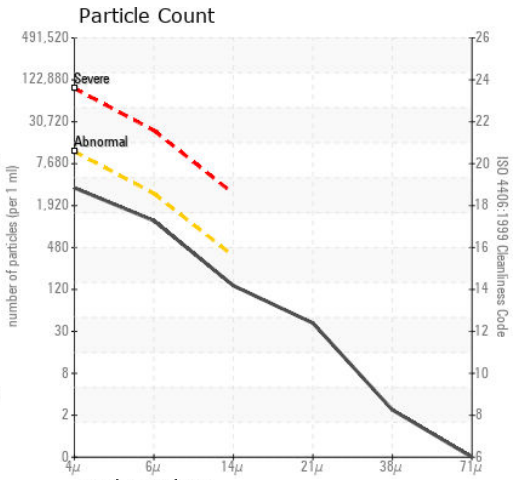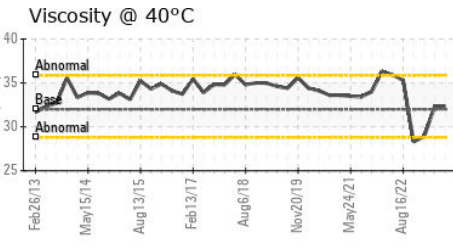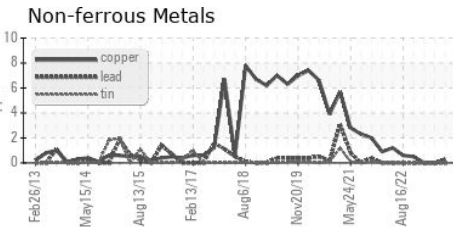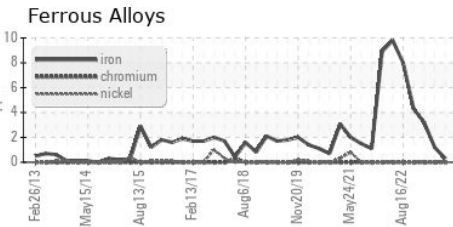

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0034419 **Received** : 23 Aug 2023  
**Lab Number** : 05932864 **Diagnosed** : 27 Aug 2023  
**Unique Number** : 10618135 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: PQ, PrtCount )

**Kimberly-Clark - Mobile - TM 6**  
 200 BAYBRIDGE RD  
 MOBILE, AL  
 US 36610  
 Contact: MORGAN RUSSELL  
 Morgan.Russell@kcc.com  
 T:  
 F: (251)452-6335

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)