




# OIL ANALYSIS REPORT

Sample Rating Trend

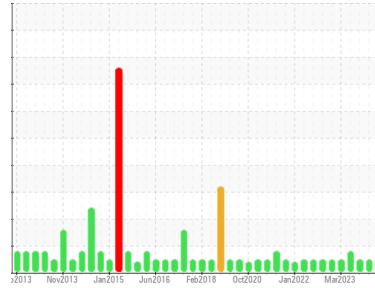

**NORMAL**



Area  
**BLEACH O2**  
 Machine Id  
**METSO BX060 POST02 PRESS NE (S/N 0661-03-02-040-040)**  
 Component  
**Bearing**  
 Fluid  
**NOT GIVEN (4 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0760567</b>	WC0760582	WC0760580
Sample Date	Client Info		<b>17 Aug 2023</b>	24 Jul 2023	30 May 2023
Machine Age	mls	Client Info	<b>0</b>	0	0
Oil Age	mls	Client Info	<b>0</b>	0	0
Oil Changed	Client Info		<b>N/A</b>	N/A	N/A
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >20	<b>40</b>	34	12
Chromium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	<1
Nickel	ppm	ASTM D5185m >20	<b>0</b>	1	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >20	<b>&lt;1</b>	<1	0
Lead	ppm	ASTM D5185m >20	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m >20	<b>1</b>	3	1
Tin	ppm	ASTM D5185m >20	<b>0</b>	0	0
Vanadium	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	<b>0</b>	0	2
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	<1	<1
Calcium	ppm	ASTM D5185m	<b>1</b>	8	5
Phosphorus	ppm	ASTM D5185m	<b>488</b>	289	408
Zinc	ppm	ASTM D5185m	<b>6</b>	15	11
Sulfur	ppm	ASTM D5185m	<b>17510</b>	25048	18696

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>10</b>	10	9
Sodium	ppm	ASTM D5185m	<b>&lt;1</b>	1	0
Potassium	ppm	ASTM D5185m >20	<b>1</b>	1	<1

## FLUID DEGRADATION




	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>1.02</b>	0.70	0.93

## VISUAL

	method	limit/base	current	history1	history2
White Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual >2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual	<b>NEG</b>	NEG	NEG



# OIL ANALYSIS REPORT


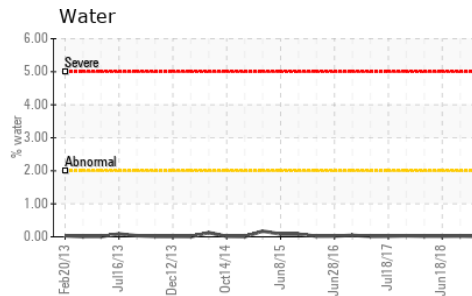
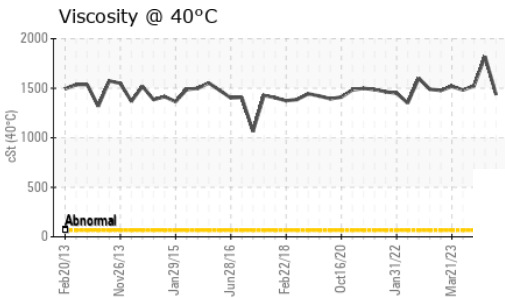
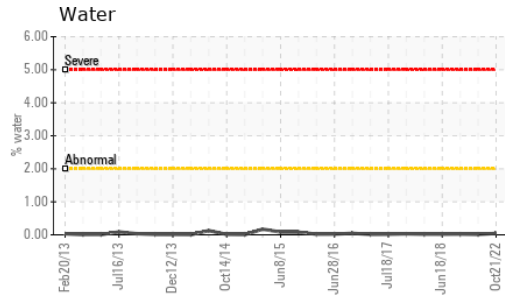


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445		1436	1820	1524

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------



## GRAPHS

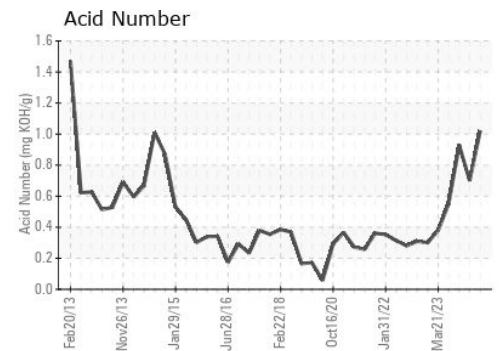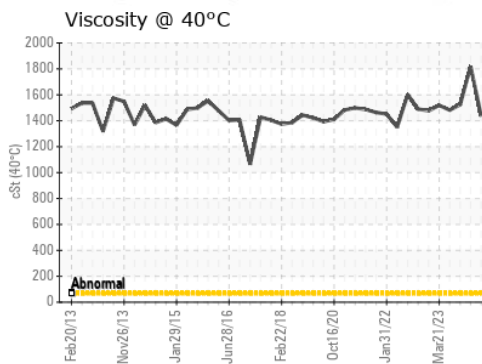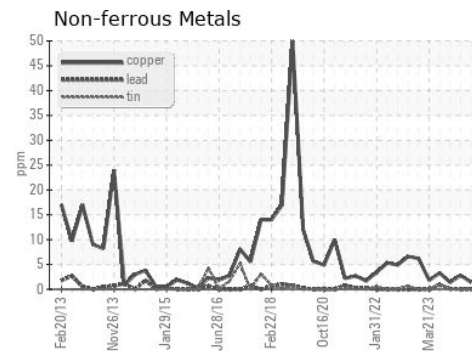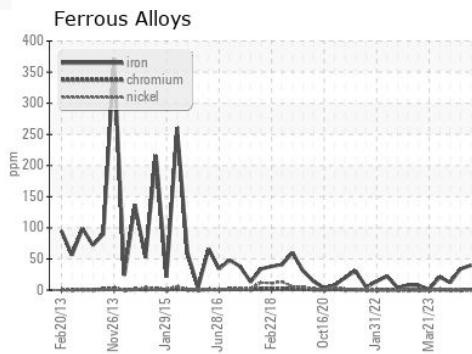

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0760567 **Received** : 23 Aug 2023  
**Lab Number** : 05932878 **Diagnosed** : 25 Aug 2023  
**Unique Number** : 10618149 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**INTERNATIONAL PAPER**  
 865 JOHN L REGEL RD  
 RIEGELWOOD, NC  
 US 28456

Contact: Zach Lizana  
 zachary.lizana@ipaper.com

T: (910)362-4775

F: