




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

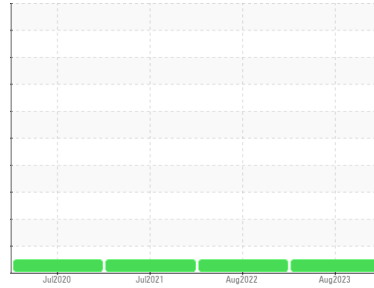

Area  
**CHEMLUBE 630 [1667201]**  
 Machine Id  
**L4-ML-BMB-SPRL4 - PFNONWOVENS**  
 Component  
**Gearbox**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05932908</b>	UCH05631788	UCH05330353
Sample Date	Client Info			<b>04 Aug 2023</b>	03 Aug 2022	19 Jul 2021
Machine Age	hrs	Client Info		<b>0</b>	0	0
Oil Age	hrs	Client Info		<b>0</b>	0	0
Oil Changed	Client Info			<b>N/A</b>	N/A	N/A
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>200	<b>60</b>	49	43
Chromium	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	<1
Nickel	ppm	ASTM D5185m	>15	<b>0</b>	<1	0
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	<1	<1
Silver	ppm	ASTM D5185m		<b>0</b>	<1	<1
Aluminum	ppm	ASTM D5185m	>25	<b>0</b>	1	0
Lead	ppm	ASTM D5185m	>100	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>200	<b>0</b>	0	<1
Tin	ppm	ASTM D5185m	>25	<b>0</b>	1	0
Antimony	ppm	ASTM D5185m	>5	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	<1

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	4.1	<b>17</b>	20	19
Barium	ppm	ASTM D5185m	0.1	<b>&lt;1</b>	0	<1
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Manganese	ppm	ASTM D5185m	0.7	<b>&lt;1</b>	<1	<1
Magnesium	ppm	ASTM D5185m	0	<b>2</b>	0	1
Calcium	ppm	ASTM D5185m	0	<b>15</b>	8	11
Phosphorus	ppm	ASTM D5185m	1600	<b>529</b>	407	338
Zinc	ppm	ASTM D5185m	0	<b>14</b>	14	10
Sulfur	ppm	ASTM D5185m	354	<b>18196</b>	13920	14469



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	<b>2</b>	3	2
Sodium	ppm	ASTM D5185m		<b>1</b>	0	0
Potassium	ppm	ASTM D5185m	>20	<b>&lt;1</b>	0	<1

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.102	<b>0.64</b>	0.66	0.692

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.2	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NONE	NONE



# OIL ANALYSIS REPORT

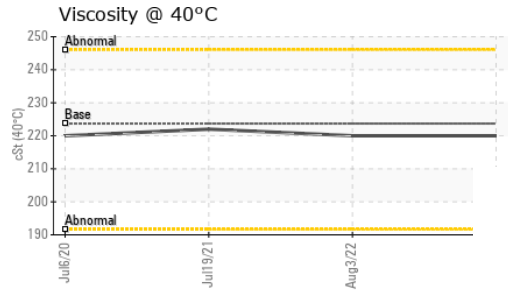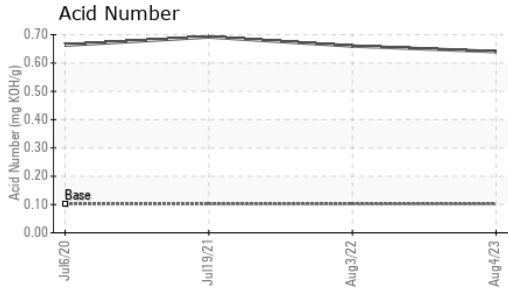

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	223.7	220	222

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------





Color



Bottom



## GRAPHS

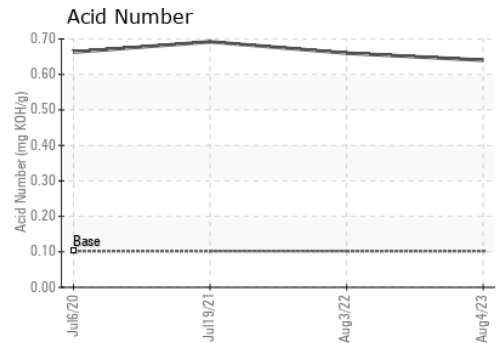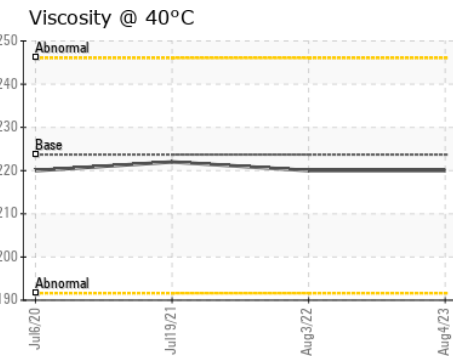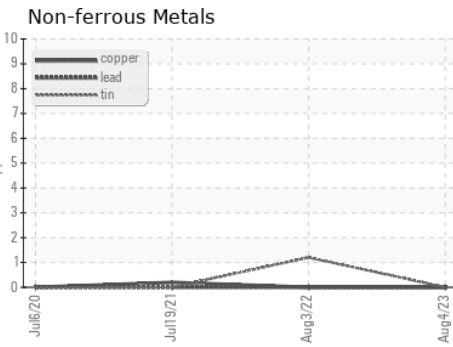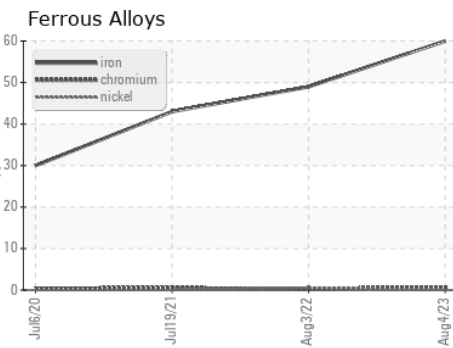

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
 Sample No. : UCH05932908 Received : 23 Aug 2023  
 Lab Number : 05932908 Diagnosed : 25 Aug 2023  
 Unique Number : 10618179 Diagnostician : Don Baldrige  
 Test Package : IND 2

**CORROSION PRODUCTS & EQUIPMENT**  
 940 POINTVIEW AVE  
 EPHRATA, PA  
 US 17522  
 Contact: RYAN HUNGARTER  
 rhungarter@corrosion-products.com  
 T: (717)961-1998  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)