


PROBLEM SUMMARY


Sample Rating Trend

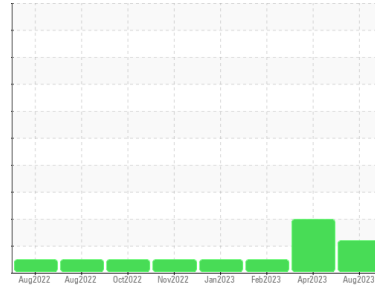

Area
Thermoforming
Machine Id
Line 3 A Extruder (S/N X8245)
Component
Bevel Helical Gearbox
Fluid
SUMMIT UNIPAR FG-150 (3 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

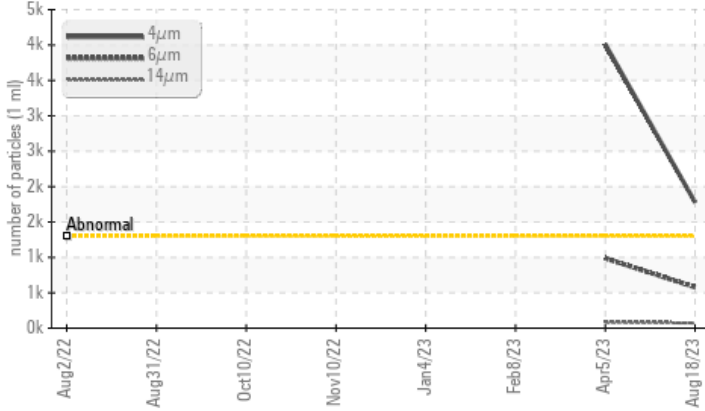

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor. (Customer Sample Comment: Banjemen Castillo)

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	ABNORMAL	NORMAL
Particles >4µm	ASTM D7647	>1300	▲ 1781	▲ 4011	---
Particles >6µm	ASTM D7647	>320	▲ 579	▲ 987	---
Oil Cleanliness	ISO 4406 (c)	>17/15/13	▲ 18/16/13	▲ 19/17/14	---

Customer Id: DARDALTX
Sample No.: TO50001740
Lab Number: 05933496
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Jonathan Hester +1 919-379-4092 x4092
jhester@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

05 Apr 2023 Diag: Doug Bogart

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 6 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



08 Feb 2023 Diag: Sean Felton

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The condition of the oil is acceptable for the time in service.

view report



04 Jan 2023 Diag: Jonathan Hester

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The condition of the oil is acceptable for the time in service.

view report



Area
Thermoforming
 Machine Id
Line 3 A Extruder (S/N X8245)
 Component
Bevel Helical Gearbox
 Fluid
SUMMIT UNIPAR FG-150 (3 GAL)

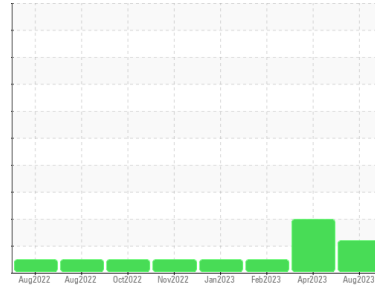

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor. (Customer Sample Comment: Banjemen Castillo)

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2	
Sample Number	Client Info	TO50001740	TO50001552	TO50001442	
Sample Date	Client Info	18 Aug 2023	05 Apr 2023	08 Feb 2023	
Machine Age	hrs	Client Info	1000	1000	1000
Oil Age	hrs	Client Info	1000	1000	1000
Oil Changed	Client Info	N/A	N/A	N/A	
Sample Status		ATTENTION	ABNORMAL	NORMAL	

WEAR METALS

method	limit/base	current	history1	history2	
PQ	ASTM D8184	12	7	9	
Iron	ppm	ASTM D5185m >150	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >10	0	<1	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	0	0	0
Lead	ppm	ASTM D5185m >100	0	<1	0
Copper	ppm	ASTM D5185m >50	2	1	1
Tin	ppm	ASTM D5185m >10	0	0	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m	2	1	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m	<1	0	0
Calcium	ppm	ASTM D5185m	<1	0	0
Phosphorus	ppm	ASTM D5185m	382	493	520
Zinc	ppm	ASTM D5185m	6	1	0
Sulfur	ppm	ASTM D5185m	86	595	573

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >50	35	17	10
Sodium	ppm	ASTM D5185m	0	0	0
Potassium	ppm	ASTM D5185m >20	<1	0	0
Water	%	ASTM D6304 >0.1	0.004	0.006	---
ppm Water	ppm	ASTM D6304 >1000	43.6	60.1	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >1300	▲ 1781	▲ 4011	---
Particles >6µm	ASTM D7647 >320	▲ 579	▲ 987	---
Particles >14µm	ASTM D7647 >80	73	▲ 81	---
Particles >21µm	ASTM D7647 >20	25	▲ 23	---
Particles >38µm	ASTM D7647 >4	1	2	---
Particles >71µm	ASTM D7647 >3	0	0	---
Oil Cleanliness	ISO 4406 (c) >17/15/13	▲ 18/16/13	▲ 19/17/14	---

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.57	0.55	---

OIL ANALYSIS REPORT

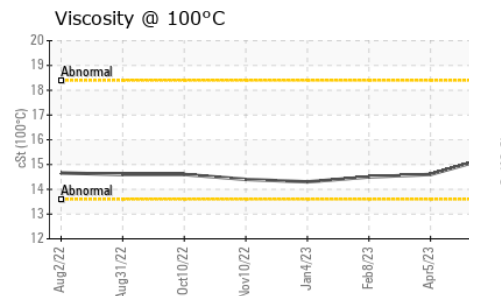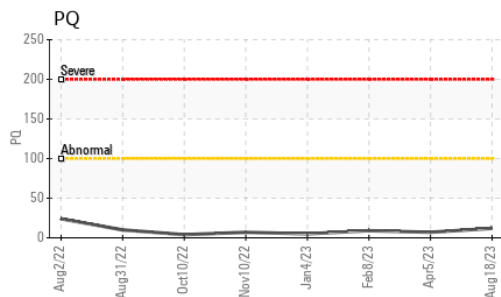
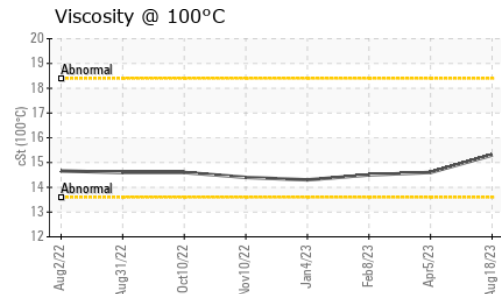
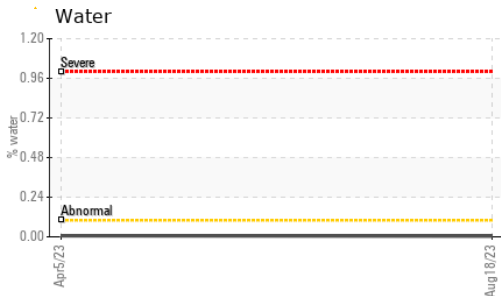
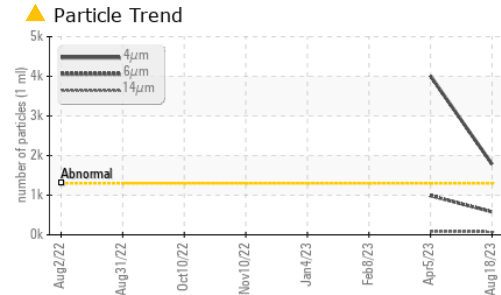


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	147	141	137
Visc @ 100°C	cSt	ASTM D445	15.3	14.6	14.5
Viscosity Index (VI)	Scale	ASTM D2270	105	102	104

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

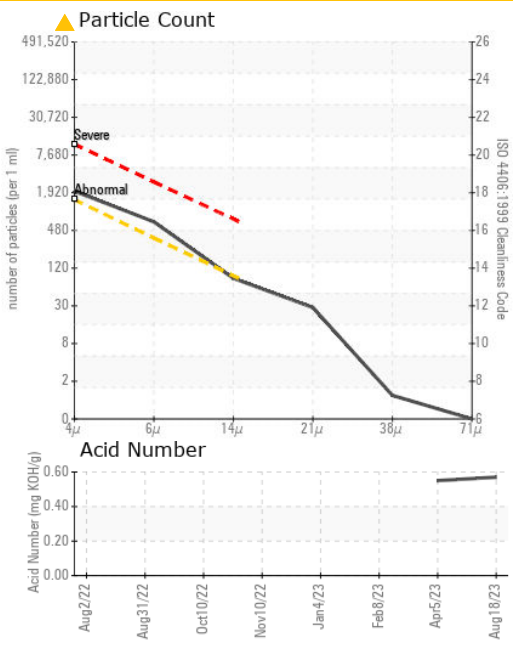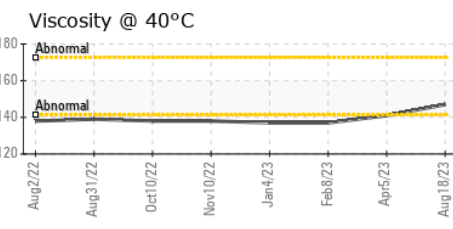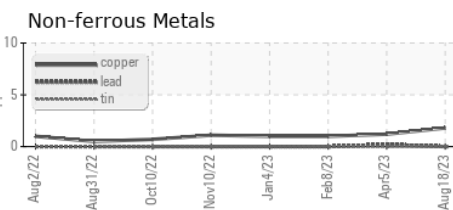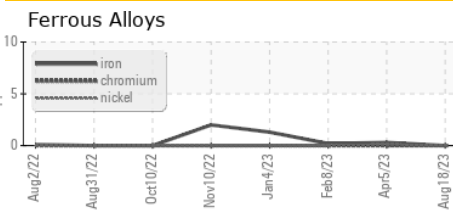

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO50001740 **Received** : 24 Aug 2023
Lab Number : 05933496 **Diagnosed** : 28 Aug 2023
Unique Number : 10618767 **Diagnostician** : Jonathan Hester
Test Package : IND 2 (Additional Tests: KF, KV100, PQ, PrtCount, VI)
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

DART CONTAINER CORPORATION
 4444 W LEADBETTER DR
 DALLAS, TX
 US 75236
 Contact: YON PALOMINO
 yon.palomino@dart.biz
 T: (214)775-5673
 F: