

## **OIL ANALYSIS REPORT**



**NORMAL** 



# Machine Id KAESER 8090671 (S/N 1209)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the

### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Mar2023	Jul2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC05933571	KC05813945	
Sample Date		Client Info		18 Jul 2023	25 Mar 2023	
Machine Age	hrs	Client Info		799	798	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		N/A	N/A	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	2	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	11	<1	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	90	71	36	
Calcium	ppm	ASTM D5185m	2	1	2	
Phosphorus	ppm	ASTM D5185m		0	5	
Zinc	ppm	ASTM D5185m		6	24	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	4	3	
Sodium	ppm	ASTM D5185m		8	3	
Potassium	ppm	ASTM D5185m	>20	11	<1	
Water	%	ASTM D6304	>0.05	0.029	<b>△</b> 0.142	
ppm Water	ppm	ASTM D6304	>500	297.0	<u>▲</u> 1420	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		3471		
Particles >6µm		ASTM D7647	>1300	904		
Particles >14μm		ASTM D7647	>80	39		
Particles >21µm		ASTM D7647	>20	10		
Particles >38μm		ASTM D7647	>4	0		
Particles >71μm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/12		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.25

0.33



### **OIL ANALYSIS REPORT**

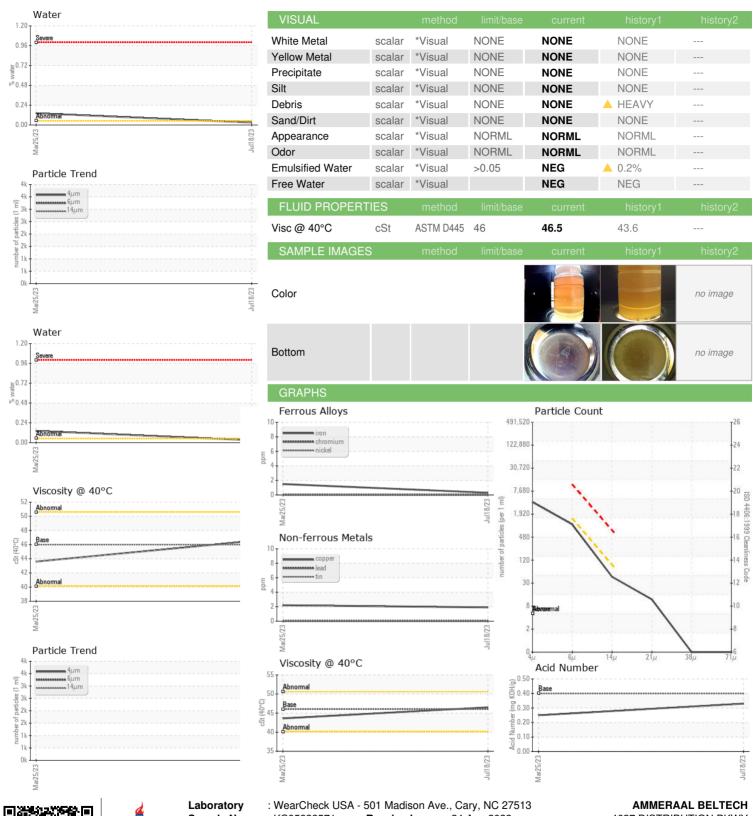



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

+05933571: 10618842

: KC05933571 : IND 2

Received : 24 Aug 2023 Diagnosed : 28 Aug 2023

: Angela Borella Diagnostician

4627 DISTRIBUTION PKWY

BUFORD, GA US 30519

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: