


PROBLEM SUMMARY

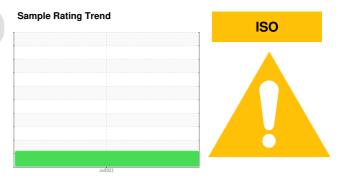


KAESER 8382392 (S/N 1773)

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

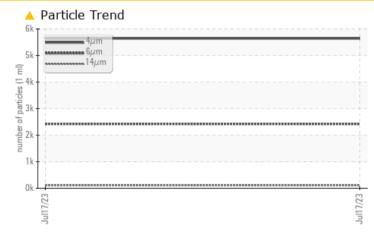

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | | |
|--------------------------|--------------|---------|------------|--|--|--|--|--|--|
| Sample Status | | | ATTENTION | | | | | | |
| Particles >6µm | ASTM D7647 | >1300 | 🔺 2424 | | | | | | |
| Particles >14µm | ASTM D7647 | >80 | 112 | | | | | | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | <u> </u> | | | | | | |

Customer Id: AMMBUF Sample No.: KC05933586 Lab Number: 05933586 Test Package: IND 2



To manage this report scan the QR code


To discuss the diagnosis or test data: Don Baldridge +1 <u>don.b505@comcast.net</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u> There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT



ISO

KAESER 8382392 (S/N 1773)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

| SAMPLE INFORM | IATION | method | limit/base | current | history1 | history2 |
|------------------|----------|-----------------|------------|-----------------|----------|----------|
| Sample Number | | Client Info | | KC05933586 | | |
| Sample Date | | Client Info | | 17 Jul 2023 | | |
| Machine Age | hrs | Client Info | | 2624 | | |
| Oil Age | hrs | Client Info | | 0 | | |
| Oil Changed | | Client Info | | N/A | | |
| Sample Status | | | | ATTENTION | | |
| WEAR METALS | | method | limit/base | current | history1 | history2 |
| Iron | ppm | ASTM D5185m | >50 | <1 | | |
| Chromium | ppm | ASTM D5185m | >10 | 0 | | |
| Nickel | ppm | ASTM D5185m | >3 | 0 | | |
| Titanium | ppm | ASTM D5185m | >3 | 0 | | |
| Silver | ppm | ASTM D5185m | >2 | 0 | | |
| Aluminum | ppm | ASTM D5185m | >10 | 0 | | |
| Lead | ppm | ASTM D5185m | >10 | 0 | | |
| Copper | ppm | ASTM D5185m | >50 | 7 | | |
| Tin | ppm | ASTM D5185m | >10 | 0 | | |
| Vanadium | ppm | ASTM D5185m | | 0 | | |
| Cadmium | ppm | ASTM D5185m | | 0 | | |
| ADDITIVES | | method | limit/base | current | history1 | history2 |
| Boron | ppm | ASTM D5185m | | 0 | | |
| Barium | ppm | ASTM D5185m | 90 | 3 | | |
| Molybdenum | ppm | ASTM D5185m | 50 | 0 | | |
| Manganese | ppm | ASTM D5185m | | 0 | | |
| Magnesium | ppm | ASTM D5185m | 90 | 8 | | |
| Calcium | ppm | ASTM D5185m | | <1 | | |
| Phosphorus | ppm | ASTM D5185m | 2 | 0 | | |
| Zinc | ppm | ASTM D5185m | | 4 | | |
| | | AOTIVI DOTODITI | | - | | |
| CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| Silicon | ppm | ASTM D5185m | >25 | 6 | | |
| Sodium | ppm | ASTM D5185m | | 0 | | |
| Potassium | ppm | ASTM D5185m | >20 | 2 | | |
| Water | % | ASTM D6304 | | 0.025 | | |
| ppm Water | ppm | ASTM D6304 | >500 | 255.6 | | |
| FLUID CLEANLIN | ESS | method | limit/base | current | history1 | history2 |
| Particles >4µm | | ASTM D7647 | | 5641 | | |
| Particles >6µm | | ASTM D7647 | >1300 | <u> </u> | | |
| Particles >14µm | | ASTM D7647 | >80 | <u> </u> | | |
| Particles >21µm | | ASTM D7647 | >20 | 19 | | |
| Particles >38µm | | ASTM D7647 | >4 | 2 | | |
| Particles >71µm | | ASTM D7647 | >3 | 0 | | |
| Oil Cleanliness | | ISO 4406 (c) | >/17/13 | 20/18/14 | | |
| FLUID DEGRADA | TION | method | limit/base | current | history1 | history2 |
| Acid Number (AN) | mg KOH/g | ASTM D8045 | 0.4 | 0.31 | | |

-COMPRESSOR Built for a lifetime

OIL ANALYSIS REPORT

method

limit/base

current


history1

history2


VISUAL

🔺 Particle Trend 6 . 5 14µm 41 in 31 0 Water 1.20 0.96



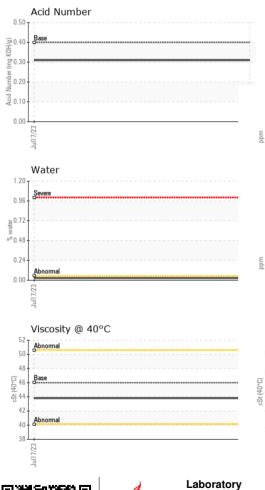

NONE White Metal *Visual NONE scalar Yellow Metal *Visual NONE NONE scalar Precipitate scalar *Visua NONE NONE Silt scalar *Visual NONE NONE Debris *Visual NONE NONE scalar NONE Sand/Dirt scalar *Visual NONE NORML Appearance *Visual NORML scalar Odor *Visual NORML scalar NORML **Emulsified Water** scalar *Visual >0.05 NEG Free Water scalar *Visual NEG FLUID PROPERTIES method limit/base current history history2 Visc @ 40°C cSt ASTM D445 46 43.8 SAMPLE IMAGES method limit/base history1 current history2 Color no image no image Bottom no image no image GRAPHS Ferrous Alloys Particle Count 491,52 122,880 30.720 7.68 4406 per 1 1,920 :1999 Cle Non-ferrous Metals 480 120 14 30 n T 214 28 Viscosity @ 40°C Acid Number 55 (^{0.50} (⁰/HOX) 0.40 Ba 50 Ē 0.30 45 · 문 0.20 Abnorma 40 0.10 Acid 35 0.00 Jul17/23 -Jul17/23 : WearCheck USA - 501 Madison Ave., Cary, NC 27513 AMMERAAL BELTECH : 24 Aug 2023 4627 DISTRIBUTION PKWY : KC05933586 Received : 05933586



BUFORD, GA US 30519 Contact: Service Manager

: 10618857 Test Package : IND 2 Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Sample No.

Lab Number

Unique Number

Contact/Location: Service Manager - AMMBUF

T:

F: