




PROBLEM SUMMARY

Sample Rating Trend

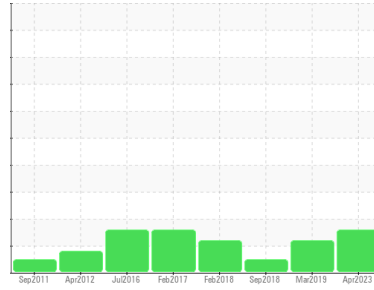


Machine Id
KAESER BSD 50 2803022 (S/N 1490)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

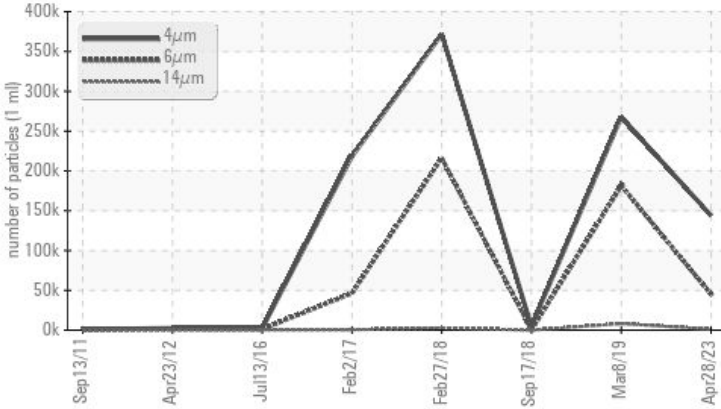

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 45084	▲ 181551	343
Particles >14µm	ASTM D7647	>80	▲ 1011	▲ 8236	11
Particles >21µm	ASTM D7647	>20	▲ 216	▲ 229	5
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 24/23/17	▲ 25/20	16/11

Customer Id: QUIHOL
Sample No.: KCP53853
Lab Number: 05933623
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

08 Mar 2019 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



17 Sep 2018 Diag: Angela Borella

NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



27 Feb 2018 Diag: Angela Borella

ISO




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid.

view report



Machine Id
KAESER BSD 50 2803022 (S/N 1490)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

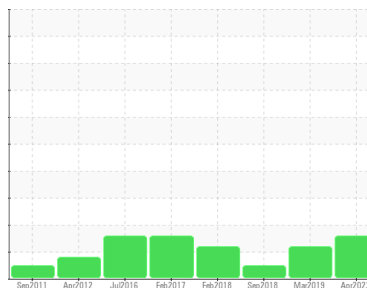

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCP53853	KCP00996	KCP14543
Sample Date	Client Info			28 Apr 2023	08 Mar 2019	17 Sep 2018
Machine Age	hrs	Client Info		57198	39483	37576
Oil Age	hrs	Client Info		0	1907	4512
Oil Changed	Client Info			Not Chngd	Not Chngd	Changed
Sample Status				ABNORMAL	ABNORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	2	7	3
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	<1
Titanium	ppm	ASTM D5185m	>3	0	<1	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	4	<1
Lead	ppm	ASTM D5185m	>10	0	<1	<1
Copper	ppm	ASTM D5185m	>50	2	2	5
Tin	ppm	ASTM D5185m	>10	0	<1	<1
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	<1
Barium	ppm	ASTM D5185m	90	40	40	15
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	<1
Magnesium	ppm	ASTM D5185m	90	76	85	59
Calcium	ppm	ASTM D5185m	2	13	57	20
Phosphorus	ppm	ASTM D5185m		2	1	6
Zinc	ppm	ASTM D5185m		0	7	9
Sulfur	ppm	ASTM D5185m		22191	24730	21499

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	1	12	0
Sodium	ppm	ASTM D5185m		19	29	29
Potassium	ppm	ASTM D5185m	>20	5	11	12
Water	%	ASTM D6304	>0.05	0.027	0.018	0.020
ppm Water	ppm	ASTM D6304	>500	275.1	180	200

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		143979	267767	4786
Particles >6µm		ASTM D7647	>1300	▲ 45084	▲ 181551	343
Particles >14µm		ASTM D7647	>80	▲ 1011	▲ 8236	11
Particles >21µm		ASTM D7647	>20	▲ 216	▲ 229	5
Particles >38µm		ASTM D7647	>4	4	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 24/23/17	▲ 25/20	16/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.40	0.374	0.313

OIL ANALYSIS REPORT

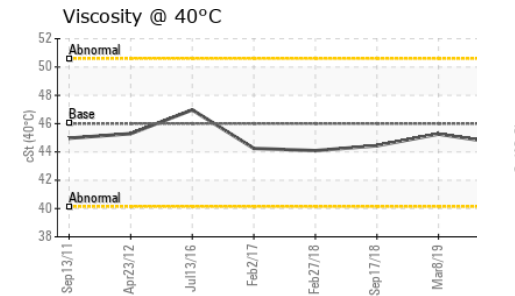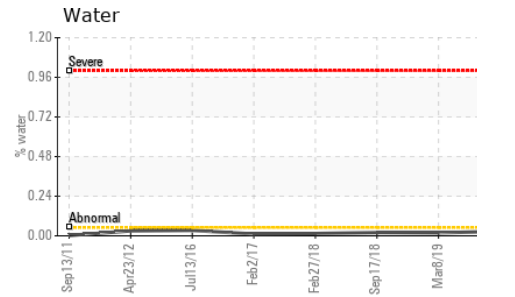
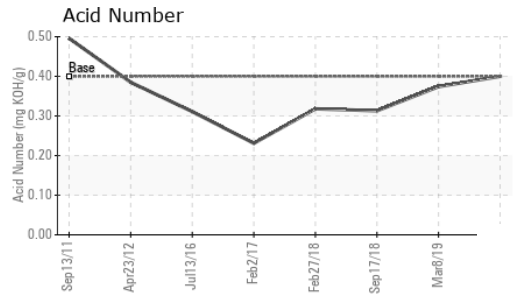
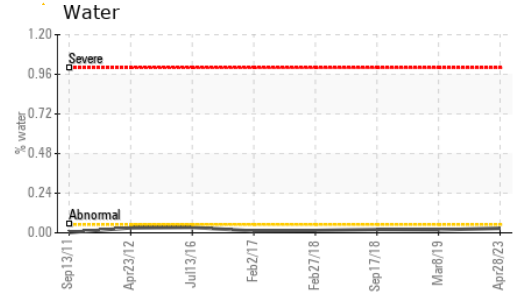
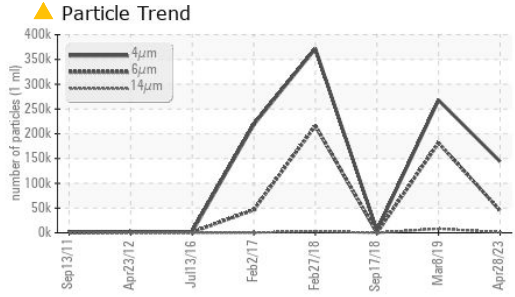


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.6	45.26	44.44

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

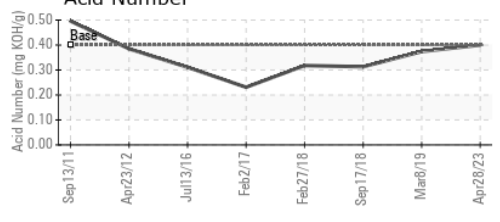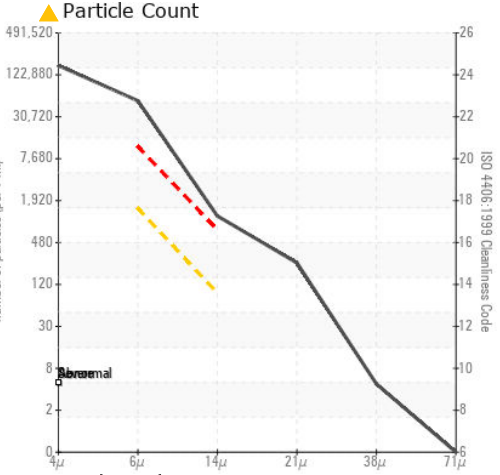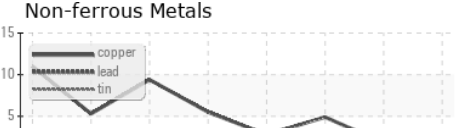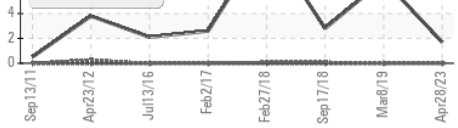

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP53853 **Received** : 24 Aug 2023
Lab Number : 05933623 **Diagnosed** : 25 Aug 2023
Unique Number : 10618894 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

QUIK-RITE
 14311 CMI DR
 HOLLY, MI
 US 48442
 Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: