

PROBLEM SUMMARY

Sample Rating Trend



KAESER 7846928

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC T	EMATIC TEST RESULTS					
Sample Status				ABNORMAL	NORMAL	
Debris	scalar	*Visual	NONE	MODER	NONE	

Customer Id: IROWAR Sample No.: KC102777 Lab Number: 05933647 Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Alert			?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

24 Feb 2023 Diag: Jonathan Hester

NORMAL




Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



VIS DEBRIS



KAESER 7846928

Component

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear

All component wear rates are normal.

Contamination

Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Feb 2023	May2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC102777	KC106252	
Sample Date		Client Info		30 May 2023	24 Feb 2023	
Machine Age	hrs	Client Info		17794	15663	
Oil Age	hrs	Client Info		2200	7802	
Oil Changed		Client Info		Not Changd	Changed	
Sample Status				ABNORMAL	NORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	0	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	1	1	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	61	0	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		2	<1	
Magnesium	ppm	ASTM D5185m	90	59	0	
Calcium	ppm	ASTM D5185m	2	4	0	
Phosphorus	ppm	ASTM D5185m		<1	3	
Zinc	ppm	ASTM D5185m		10	0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		21	0	
Potassium	ppm	ASTM D5185m	>20	5	0	
Water	%	ASTM D6304	>0.05	0.021	0.007	
ppm Water	ppm	ASTM D6304	>500	218.8	77.2	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647			4863	
Particles >6µm		ASTM D7647	>1300		794	
Particles >14µm		ASTM D7647	>80		29	
Particles >21µm		ASTM D7647	>20		6	
Particles >38μm		ASTM D7647	>4		1	
Particles >71µm		ASTM D7647	>3		0	
Oil Cleanliness		ISO 4406 (c)	>/17/13		19/17/12	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2

Acid Number (AN)


mg KOH/g ASTM D8045 0.4

0.42

0.47



OIL ANALYSIS REPORT

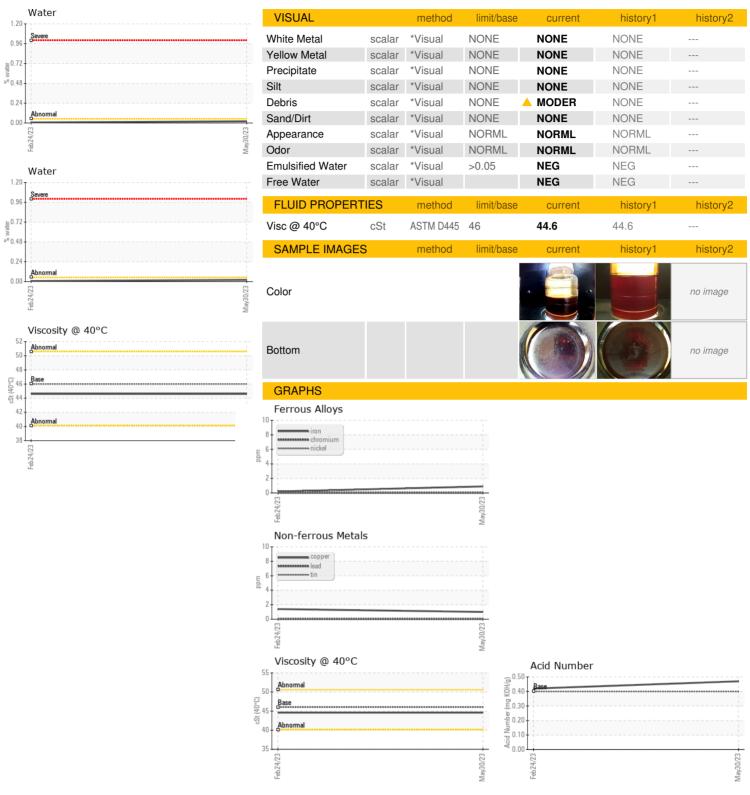





Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

: KC102777 : 05933647 : 10618918 Test Package : IND 2

: WearCheck USA - 501 Madison Ave., Cary, NC 27513 Received : 24 Aug 2023 Diagnosed : 25 Aug 2023

: Don Baldridge Diagnostician

IROQUOIS 25373 GORESBECK HWY WARREN, MI US 48089

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: