




# PROBLEM SUMMARY


Sample Rating Trend

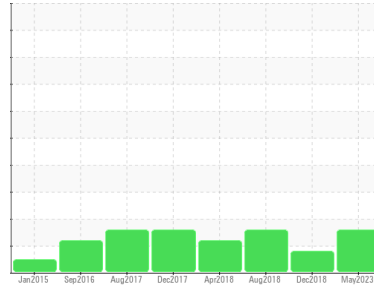

Machine Id  
**KAESER CSD 75T 3759635 (S/N 1162)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

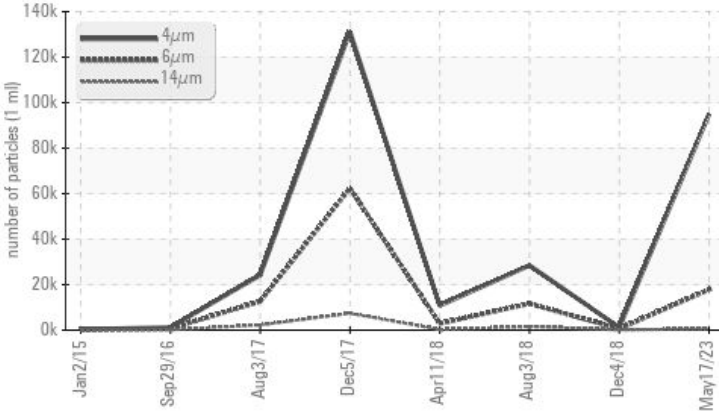

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647 >1300	▲ 17820	635	▲ 11648
Particles >14µm	ASTM D7647 >80	▲ 555	▲ 108	▲ 1546
Particles >21µm	ASTM D7647 >20	▲ 135	▲ 36	▲ 424
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 24/21/16	▲ 16/14	▲ 21/18

Customer Id: AMETROKC  
 Sample No.: KCPA002576  
 Lab Number: 05933661  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 04 Dec 2018 Diag: Angela Borella

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. Please specify the brand, type, and viscosity of the oil on your next sample. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 03 Aug 2018 Diag: Angela Borella

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 11 Apr 2018 Diag: Angela Borella

ISO




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



# OIL ANALYSIS REPORT

Sample Rating Trend

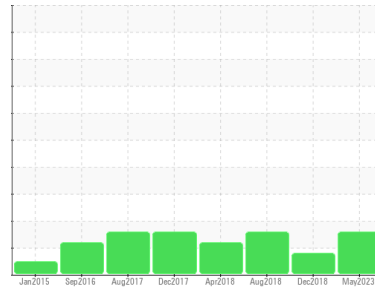

ISO



Machine Id  
**KAESER CSD 75T 3759635 (S/N 1162)**

Component

**Compressor**

Fluid

**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a high amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA002576</b>	KCP14603	KCP14523
Sample Date	Client Info		<b>17 May 2023</b>	04 Dec 2018	03 Aug 2018
Machine Age	hrs	Client Info	<b>84342</b>	57781	55410
Oil Age	hrs	Client Info	<b>0</b>	4610	2238
Oil Changed	Client Info		<b>N/A</b>	Not Changd	Not Changd
Sample Status			<b>ABNORMAL</b>	ATTENTION	ABNORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>3</b>	2	1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m >10	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >50	<b>3</b>	6	3
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	1	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	0
Barium	ppm	ASTM D5185m 90	<b>38</b>	0	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	<1
Magnesium	ppm	ASTM D5185m 90	<b>44</b>	5	11
Calcium	ppm	ASTM D5185m 2	<b>4</b>	0	0
Phosphorus	ppm	ASTM D5185m	<b>1</b>	3	0
Zinc	ppm	ASTM D5185m	<b>0</b>	6	7
Sulfur	ppm	ASTM D5185m	<b>20767</b>	15379	20563

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	<1	<1
Sodium	ppm	ASTM D5185m	<b>25</b>	2	5
Potassium	ppm	ASTM D5185m >20	<b>5</b>	0	1
Water	%	ASTM D6304 >0.05	<b>0.023</b>	0.005	0.011
ppm Water	ppm	ASTM D6304 >500	<b>230.6</b>	50	110






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>94941</b>	1166	28481
Particles >6µm	ASTM D7647 >1300		▲ <b>17820</b>	635	▲ 11648
Particles >14µm	ASTM D7647 >80		▲ <b>555</b>	▲ 108	▲ 1546
Particles >21µm	ASTM D7647 >20		▲ <b>135</b>	▲ 36	▲ 424
Particles >38µm	ASTM D7647 >4		<b>3</b>	5	▲ 10
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		▲ <b>24/21/16</b>	▲ 16/14	▲ 21/18

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.43</b>	0.381	0.434


# OIL ANALYSIS REPORT

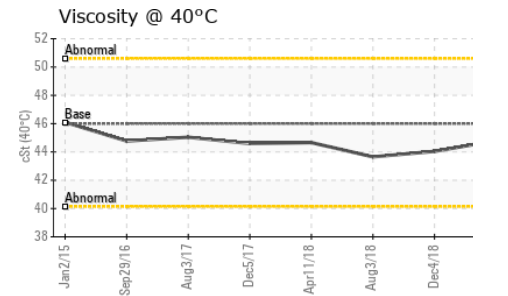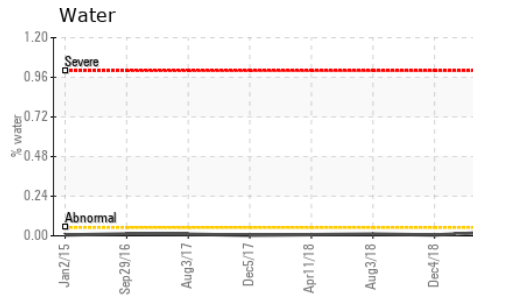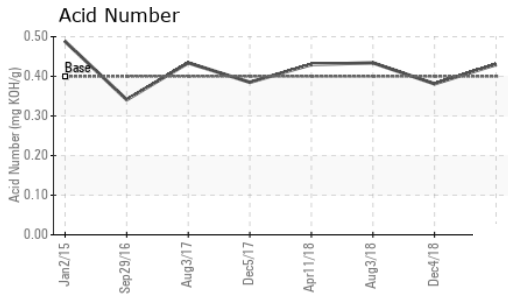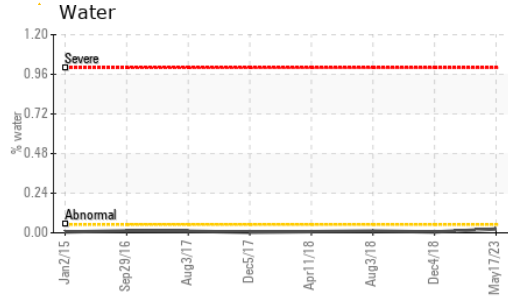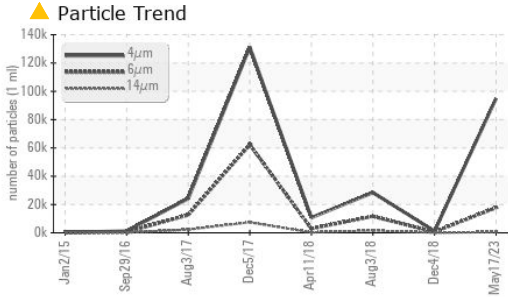






VISUAL	method	limit/base	current	history1	history2	
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	LIGHT	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	NEG	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	<b>44.8</b>	44.04	43.65

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

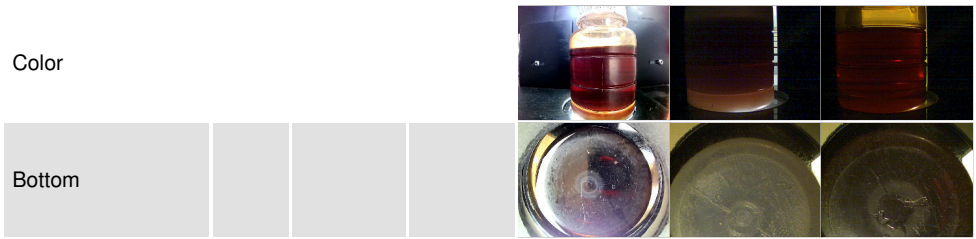

## GRAPHS

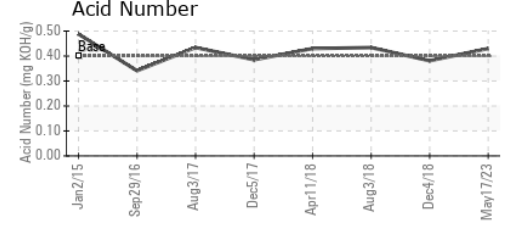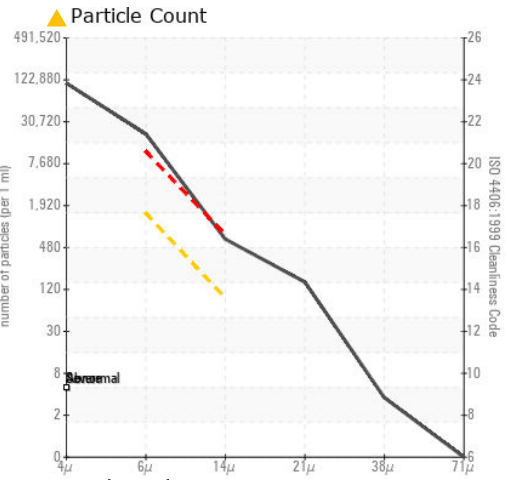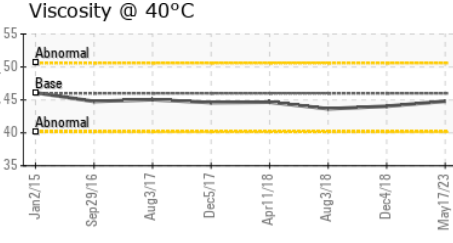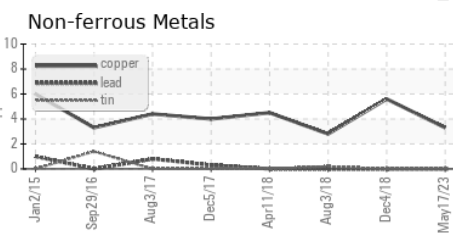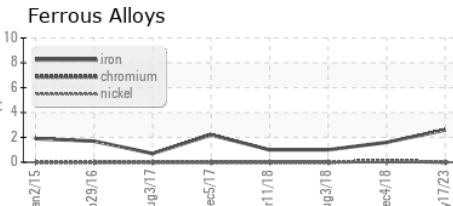

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA002576 **Received** : 24 Aug 2023  
**Lab Number** : 05933661 **Diagnosed** : 25 Aug 2023  
**Unique Number** : 10618932 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**AMERICAN MSC**  
 2451 ELLIOT DR  
 TROY, MI  
 US 48083  
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: