




OIL ANALYSIS REPORT

Sample Rating Trend

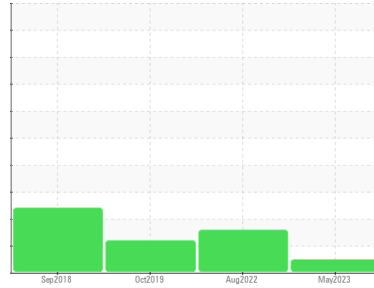

Machine Id
KAESER SM 7.5 6053728 (S/N 1363)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

DIAGNOSIS

Recommendation
Resample at the next service interval to monitor.

Wear
All component wear rates are normal.

Contamination
There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		KCPA002809	KCP49731	KC75981
Sample Date	Client Info		24 May 2023	03 Aug 2022	30 Oct 2019
Machine Age	hrs	Client Info	7238	6543	3597
Oil Age	hrs	Client Info	0	0	0
Oil Changed	Client Info		N/A	Changed	Changed
Sample Status			NORMAL	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	0	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	<1
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	0	0	<1
Copper	ppm	ASTM D5185m >50	2	2	4
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	---	0
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	27
Barium	ppm	ASTM D5185m 90	6	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 100	67	37	41
Calcium	ppm	ASTM D5185m 0	3	0	<1
Phosphorus	ppm	ASTM D5185m 0	1	<1	4
Zinc	ppm	ASTM D5185m 0	3	3	0
Sulfur	ppm	ASTM D5185m 23500	21851	17691	15404

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	<1	2
Sodium	ppm	ASTM D5185m	19	12	14
Potassium	ppm	ASTM D5185m >20	1	0	1
Water	%	ASTM D6304 >0.05	0.016	0.018	0.011
ppm Water	ppm	ASTM D6304 >500	167.5	181.4	117.0






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		1251	9960	4516
Particles >6µm	ASTM D7647	>1300	421	▲ 4084	▲ 1841
Particles >14µm	ASTM D7647	>80	46	▲ 209	▲ 137
Particles >21µm	ASTM D7647	>20	16	▲ 38	▲ 54
Particles >38µm	ASTM D7647	>4	0	3	4
Particles >71µm	ASTM D7647	>3	0	0	0
Oil Cleanliness	ISO 4406 (c)	>--/17/13	17/16/13	▲ 20/19/15	▲ 18/14

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 1.0	0.33	0.30	0.318


OIL ANALYSIS REPORT

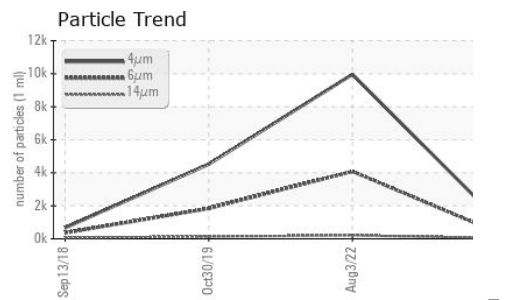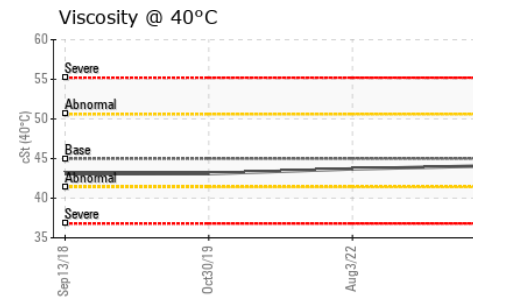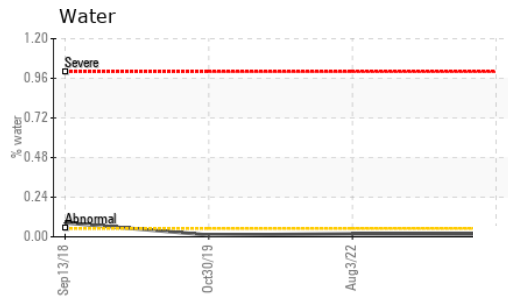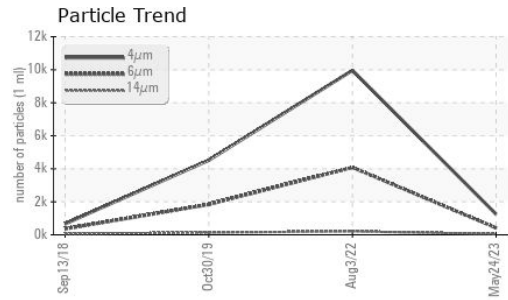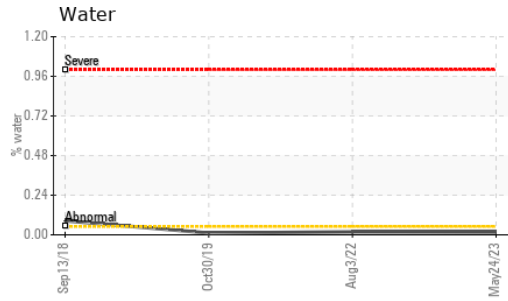






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	44.1	43.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

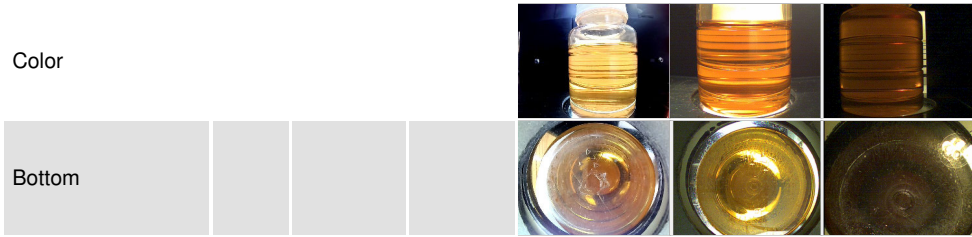

GRAPHS

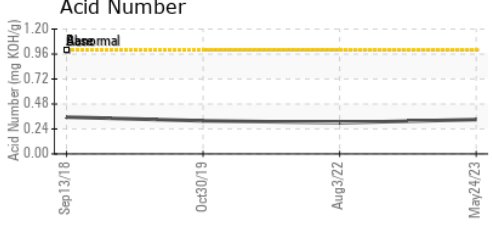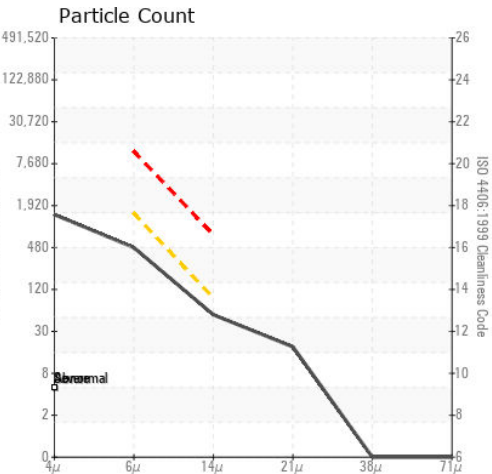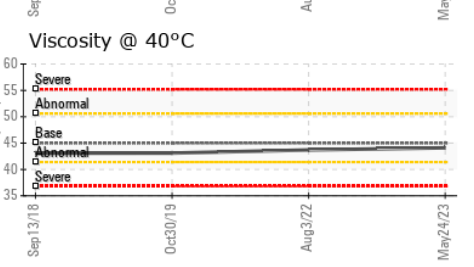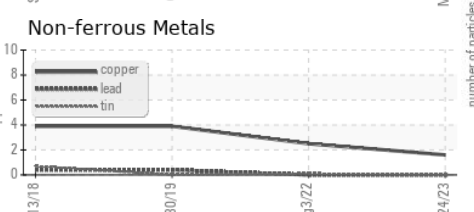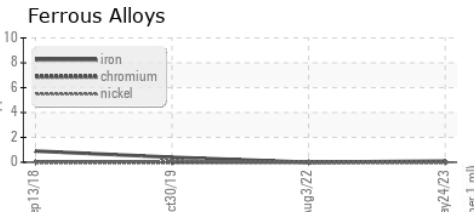

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KCPA002809 Received : 24 Aug 2023
 Lab Number : 05933663 Diagnosed : 25 Aug 2023
 Unique Number : 10618934 Diagnostician : Doug Bogart
 Test Package : IND 2 (Additional Tests: KF, PrtCount)

ELITE CLEANERS
 9864 E GRAND RIVER AVE
 BRIGHTON, MI
 US 48116
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: