


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id KAESER ASD40ST 4021267 (S/N 1008)

Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2016 Apr2	017 Jun2017 Jun2018 Jan2	019 May2019 Oct2019 Mar2020 Jan2	021 Aug2023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA000302	KCP32583	KCP26294
Sample Date		Client Info		23 Aug 2023	28 Jan 2021	07 Mar 2020
Machine Age	hrs	Client Info		93225	79906	74076
Oil Age	hrs	Client Info		0	6000	6000
Oil Changed		Client Info		N/A	Changed	N/A
Sample Status				NORMAL	ATTENTION	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	<1	0
Aluminum	ppm	ASTM D5185m	>10	0	0	0
Lead	ppm	ASTM D5185m	>10	0	0	0
Copper	ppm	ASTM D5185m	>50	9	10	9
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m			0	<1
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	<1	0
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	90	4	0	<1
Calcium	ppm	ASTM D5185m	2	2	0	0
Phosphorus	ppm	ASTM D5185m		3	<1	<1
Zinc	ppm	ASTM D5185m		70	0	<1
Sulfur	ppm	ASTM D5185m		20905	14630	14312
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	0
Sodium	ppm	ASTM D5185m		1	0	0
Potassium	ppm	ASTM D5185m	>20	0	<1	0
Water	%	ASTM D6304	>0.05	0.005	0.003	0.003
ppm Water	ppm	ASTM D6304	>500	52.0	38.8	35.5
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		454	5813	919
Particles >6µm		ASTM D7647	>1300	109	<u>▲</u> 1442	287
Particles >14µm		ASTM D7647	>80	18	<u>123</u>	29
Particles >21µm		ASTM D7647	>20	5	<u></u> 40	8
Particles >38µm		ASTM D7647	>4	0	1	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>17/13	14/11	▲ 18/14	15/12
FLUID DEGRADA	TION	method	limit/base	current	history1	history2



OIL ANALYSIS REPORT

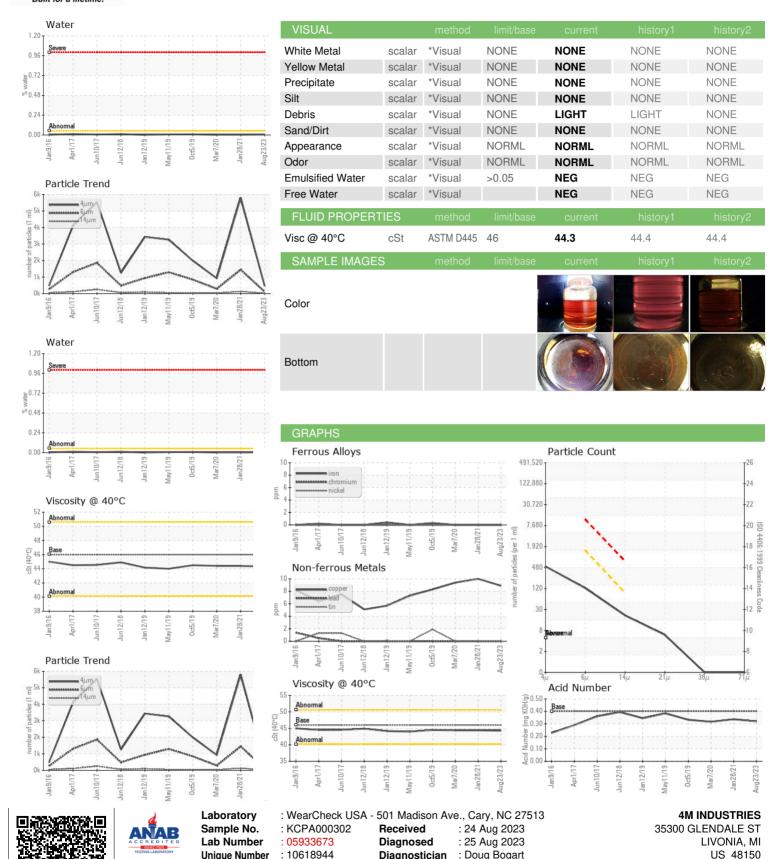

Certificate L2367

Unique Number

: 10618944

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Test Package : IND 2 (Additional Tests: KF, PrtCount)

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Diagnostician : Doug Bogart

Contact: SERVICE MANAGER

T: F: