


OIL ANALYSIS REPORT

Sample Rating Trend





Machine Id L13 Component Pump Fluid

USPI VAC 100 (--- LTR)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		Jan2021	Jun2021 Dec2021	Jun2022 Dec2022 M	ay2023	
SAMPLE INFORM	1ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM29406	USPM28428	USPM28541
Sample Date		Client Info		18 Aug 2023	22 May 2023	29 Mar 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>90	2	3	1
Chromium	ppm	ASTM D5185m	>5	0	0	0
Nickel	ppm	ASTM D5185m	>5	0	<1	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>3	0	0	0
Aluminum	ppm	ASTM D5185m	>7	0	0	1
Lead	ppm	ASTM D5185m	>12	0	2	0
Copper	ppm	ASTM D5185m	>30	0	0	0
Tin	ppm	ASTM D5185m	>9	0	<1	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	<1	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	<1
Magnesium	ppm	ASTM D5185m	0	<1	0	2
Calcium	ppm	ASTM D5185m	0	2	0	0
Phosphorus	ppm	ASTM D5185m	1800	1497	1520	1408
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m	0	68	40	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>60	8	7	6
Sodium	ppm	ASTM D5185m		0	1	0
Potassium	ppm	ASTM D5185m	>20	0	2	0
Water	%	ASTM D6304		0.046	0.051	0.036
ppm Water	ppm	ASTM D6304	>.1	466.4	518.3	361.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	196	162	286
Particles >6µm		ASTM D7647	>2500	68	77	65
Particles >14µm		ASTM D7647	>640	19	20	12
Particles >21µm		ASTM D7647	>160	9	9	5
Particles >38µm		ASTM D7647	>40	1	2	0
Particles >71µm		ASTM D7647	>10	0	1	0
Oil Cleanliness		ISO 4406 (c)	>20/18/16	15/13/11	15/13/11	15/13/11
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.05	0.08	0.06	0.05



OIL ANALYSIS REPORT

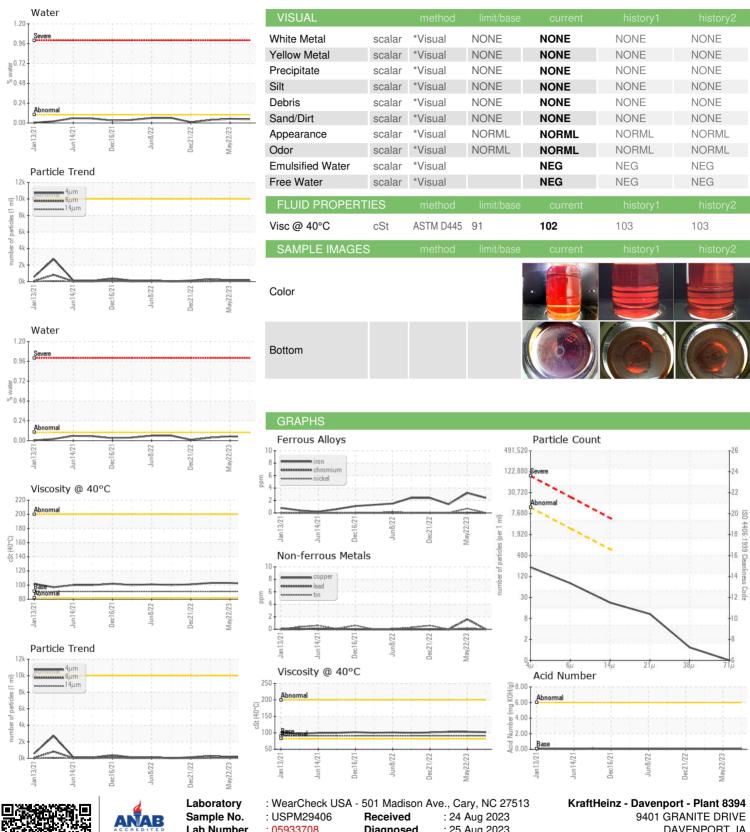



Certificate L2367

Lab Number **Unique Number**

Test Package

: 05933708

: IND 2

: 10618979

Diagnosed : 25 Aug 2023 : Doug Bogart Diagnostician

DAVENPORT, IA US 52802

Contact/Location: JOHN KONRAD - KRADAV

Contact: JOHN KONRAD john.konrad@kraftheinz.com

T:

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (563)326-8391