


Area
PALASYN 45
Machine Id
SULLIVAN PALATEK 22KE003400 - DEACONESS HOSPITAL
Component
Compressor

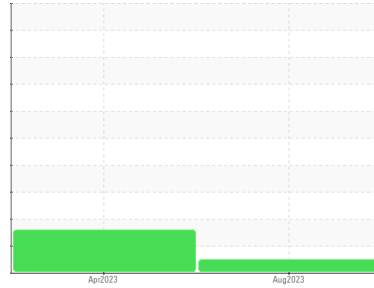

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The water content is negligible. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION method limit/base current history1 history2

Sample Number	Client Info	UCS05933776	UCS05845037	---
Sample Date	Client Info	21 Aug 2023	18 Apr 2023	---
Machine Age	hrs	Client Info	2695	1186
Oil Age	hrs	Client Info	2695	1186
Oil Changed	Client Info	Not Changed	Not Changed	---
Sample Status		NORMAL	ATTENTION	---

WEAR METALS method limit/base current history1 history2

Iron	ppm	ASTM D5185m	>50	0	14	---
Chromium	ppm	ASTM D5185m	>10	0	0	---
Nickel	ppm	ASTM D5185m		0	1	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>25	0	2	---
Lead	ppm	ASTM D5185m	>25	0	0	---
Copper	ppm	ASTM D5185m	>50	0	<1	---
Tin	ppm	ASTM D5185m	>15	0	1	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---

ADDITIVES method limit/base current history1 history2

Boron	ppm	ASTM D5185m	0.0	0	0	---
Barium	ppm	ASTM D5185m	0.0	0	0	---
Molybdenum	ppm	ASTM D5185m	0	0	0	---
Manganese	ppm	ASTM D5185m	0	0	<1	---
Magnesium	ppm	ASTM D5185m	0.0	0	2	---
Calcium	ppm	ASTM D5185m	0.0	1	0	---
Phosphorus	ppm	ASTM D5185m	966	520	669	---
Zinc	ppm	ASTM D5185m	0	0	0	---
Sulfur	ppm	ASTM D5185m	1309	870	1324	---

CONTAMINANTS method limit/base current history1 history2

Silicon	ppm	ASTM D5185m	>25	1	2	---
Sodium	ppm	ASTM D5185m		0	<1	---
Potassium	ppm	ASTM D5185m	>20	0	2	---



FLUID DEGRADATION method limit/base current history1 history2

Acid Number (AN)	mg KOH/g	ASTM D8045	0.172	0.21	0.06	---
------------------	----------	------------	-------	-------------	------	-----

VISUAL method limit/base current history1 history2

White Metal	scalar	*Visual	NONE	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	0.2%	---
Free Water	scalar	*Visual		NEG	▲ 10.0	---

OIL ANALYSIS REPORT



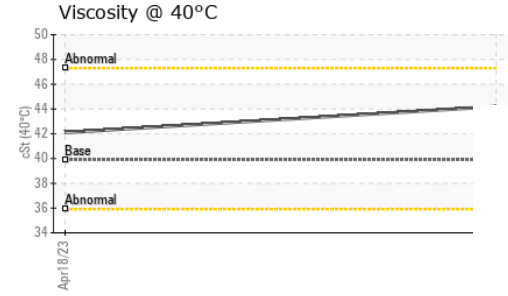
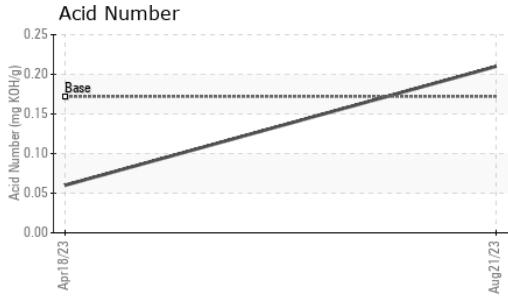


FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	39.9	44.2	42.1	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color						no image
Bottom						no image

GRAPHS

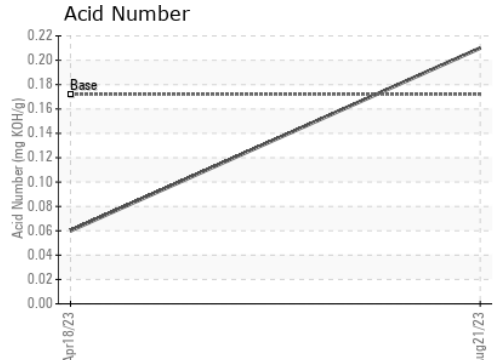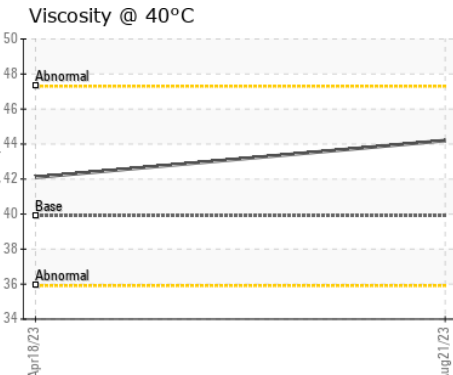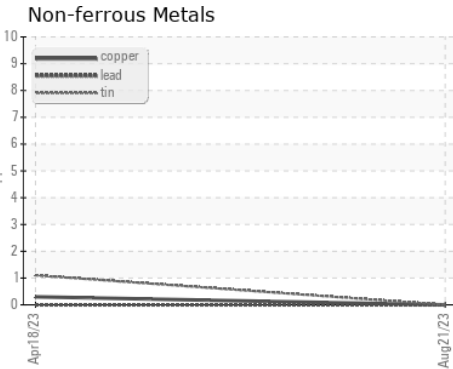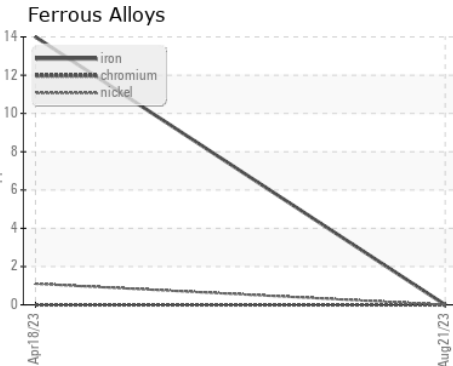

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : UCS05933776 **Received** : 24 Aug 2023
Lab Number : **05933776** **Diagnosed** : 26 Aug 2023
Unique Number : 10619047 **Diagnostician** : Don Baldrige
Test Package : IND 2

ADVANCED COMPRESSOR TECHNOLOGIES
 2315 B GLENVIEW DR
 EVANSVILLE, IN
 US 47720
 Contact: TODD RILEY
 triley@advancedcompressortechnologies.com
 T: (812)401-1420
 F: (812)401-1451

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)