

OIL ANALYSIS REPORT

Sample Rating Trend



Machine Id 4006828 (S/N 2092) Component

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


			0012021 0002021	May2022 Mar2023	AUG2U23			
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2		
Sample Number		Client Info		KCPA002970	KCP54620	KCP49360		
Sample Date		Client Info		18 Aug 2023	01 Mar 2023	23 Aug 2022		
Machine Age	hrs	Client Info		52952	51011	48779		
Oil Age	hrs	Client Info		0	5600	3304		
Oil Changed		Client Info		N/A	Changed	Not Changd		
Sample Status				NORMAL	NORMAL	ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2		
Iron	ppm	ASTM D5185m	>50	0	0	0		
Chromium	ppm	ASTM D5185m	>10	0	0	0		
Nickel	ppm	ASTM D5185m	>3	0	0	0		
Titanium	ppm	ASTM D5185m	>3	0	0	0		
Silver	ppm	ASTM D5185m	>2	0	0	0		
Aluminum	ppm	ASTM D5185m		0	<1	<1		
Lead	ppm	ASTM D5185m	>10	0	0	0		
Copper	ppm	ASTM D5185m		8	14	11		
Tin		ASTM D5185m	>50	0	0	0		
	ppm		>10	0 				
Antimony	ppm	ASTM D5185m						
Vanadium	ppm	ASTM D5185m		0	0	0		
Cadmium	ppm	ASTM D5185m		0	0	0		
ADDITIVES		method	limit/base	current	history1	history2		
Boron	ppm	ASTM D5185m		0	0	0		
Barium	ppm	ASTM D5185m	90	0	<1	1		
Molybdenum	ppm	ASTM D5185m		0	0	0		
Manganese	ppm	ASTM D5185m		0	0	0		
Magnesium	ppm	ASTM D5185m	90	7	<1	<1		
Calcium	ppm	ASTM D5185m	2	0	0	0		
Phosphorus	ppm	ASTM D5185m		2	2	4		
Zinc	ppm	ASTM D5185m		13	0	5		
Sulfur	ppm	ASTM D5185m		17808	15591	14849		
CONTAMINANTS	;	method	limit/base	current	history1	history2		
Silicon	ppm	ASTM D5185m	>25	0	<1	0		
Sodium	ppm	ASTM D5185m		0	<1	2		
Potassium	ppm	ASTM D5185m	>20	1	<1	0		
Water	%	ASTM D6304	>0.05	0.010	0.013	0.017		
ppm Water	ppm	ASTM D6304	>500	105.7	133.3	175.0		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2		
Particles >4µm		ASTM D7647		1264	831	8347		
Particles >6µm		ASTM D7647	>1300	320	181	A 2203		
Particles >14µm		ASTM D7647	>80	37	17	<u> </u>		
Particles >21µm		ASTM D7647	>20	13	7	A 84		
Particles >38µm		ASTM D7647	>4	1	1	4		
Particles >71µm		ASTM D7647		0	0	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/12	17/15/11	▲ 20/18/15		
FLUID DEGRADA		method	limit/base	current	history1	history2		
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.38	0.38	0.40		
·09·55) Bev: 1	manonig	. 10 1 11 200-10	5.1		Contact/Location: M HAYES - AMETIEGA			


Report Id: AMETIFGA [WUSCAR] 05934357 (Generated: 08/28/2023 11:09:55) Rev: 1


Contact/Location: M. HAYES - AMETIFGA



OIL ANALYSIS REPORT






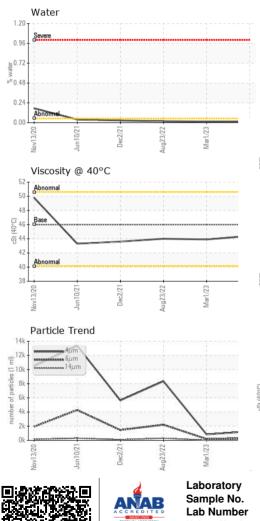

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT	VLITE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.4	43.9	44.0
SAMPLE IMAGES		method	limit/base	current	history1	history2
Color				•	J	

Bottom

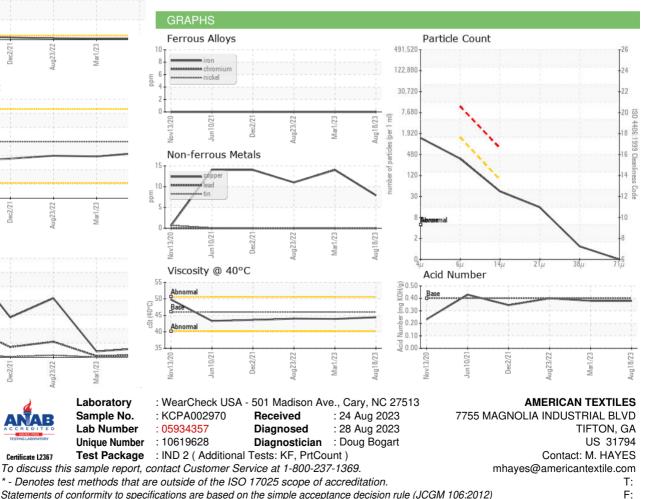

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Certificate L2367