




# PROBLEM SUMMARY


Sample Rating Trend

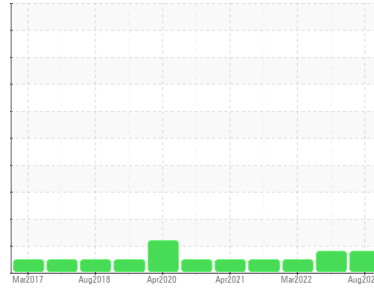

Machine Id  
**KAESER SFC 90S 5785548 (S/N 1166)**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

▲ Particle Trend

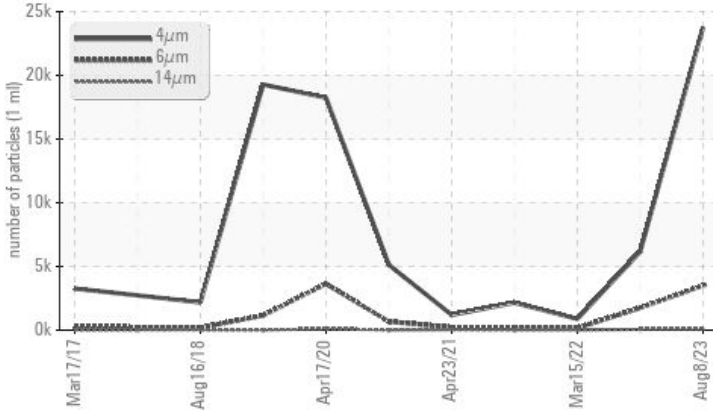

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status		<b>ABNORMAL</b>	ATTENTION	NORMAL
Particles >6µm	ASTM D7647 >1300	▲ <b>3498</b>	▲ 1747	172
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ <b>22/19/13</b>	▲ 20/18/13	15/11

Customer Id: RINVALGA  
 Sample No.: KCPA004664  
 Lab Number: 05934366  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS

### 03 Dec 2022 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 15 Mar 2022 Diag: Jonathan Hester

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



### 20 Oct 2021 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





# OIL ANALYSIS REPORT

Sample Rating Trend

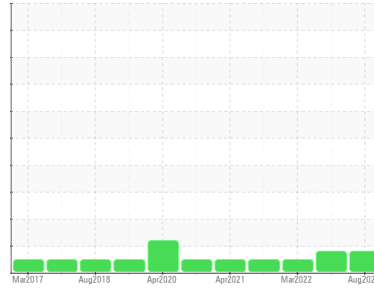

ISO



Machine Id  
**KAESER SFC 90S 5785548 (S/N 1166)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) FG-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA004664</b>	KCP52688	KCP41132
Sample Date	Client Info			<b>08 Aug 2023</b>	03 Dec 2022	15 Mar 2022
Machine Age	hrs	Client Info		<b>46992</b>	42067	36193
Oil Age	hrs	Client Info		<b>0</b>	5873	3019
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>ABNORMAL</b>	ATTENTION	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>1</b>	<1	0
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m	>10	<b>10</b>	3	6
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Copper	ppm	ASTM D5185m	>50	<b>2</b>	2	<1
Tin	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	---
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	0
Molybdenum	ppm	ASTM D5185m		<b>0</b>	0	0
Manganese	ppm	ASTM D5185m		<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m		<b>0</b>	2	0
Calcium	ppm	ASTM D5185m		<b>0</b>	0	0
Phosphorus	ppm	ASTM D5185m	500	<b>17</b>	31	123
Zinc	ppm	ASTM D5185m		<b>10</b>	0	66
Sulfur	ppm	ASTM D5185m		<b>309</b>	344	1466

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	<1	0
Sodium	ppm	ASTM D5185m		<b>2</b>	2	<1
Potassium	ppm	ASTM D5185m	>20	<b>2</b>	0	0
Water	%	ASTM D6304	>0.05	<b>0.009</b>	0.004	0.005
ppm Water	ppm	ASTM D6304	>500	<b>93.8</b>	41.8	52.4

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>23771</b>	6158	881
Particles >6µm		ASTM D7647	>1300	<b>▲ 3498</b>	▲ 1747	172
Particles >14µm		ASTM D7647	>80	<b>65</b>	60	16
Particles >21µm		ASTM D7647	>20	<b>14</b>	7	5
Particles >38µm		ASTM D7647	>4	<b>0</b>	1	0
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>▲ 22/19/13</b>	▲ 20/18/13	15/11

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.5	<b>0.59</b>	0.47	0.45


# OIL ANALYSIS REPORT

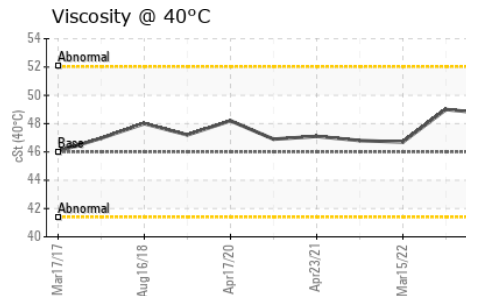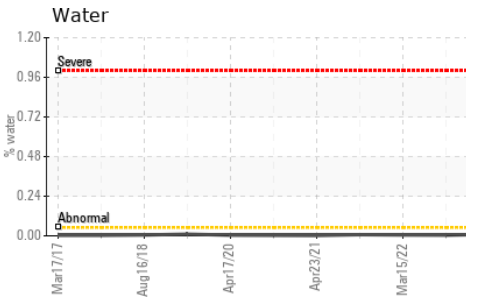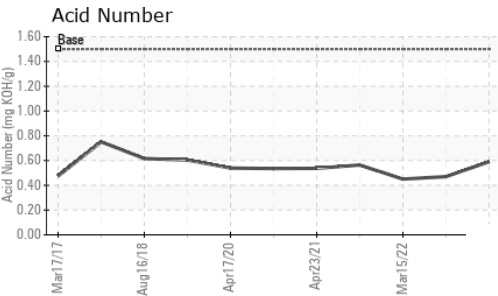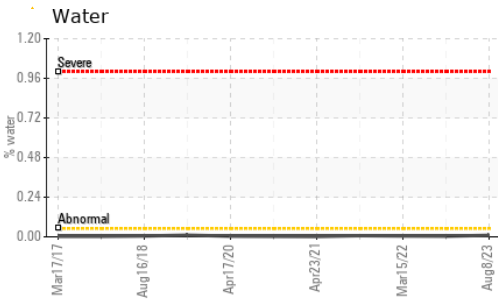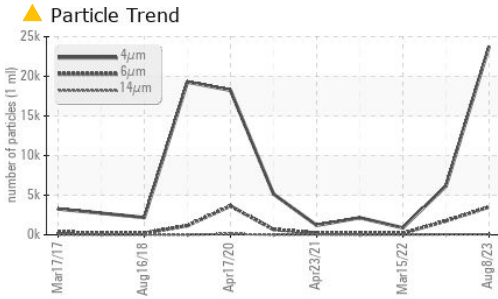






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	48.7	49.0	46.7

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

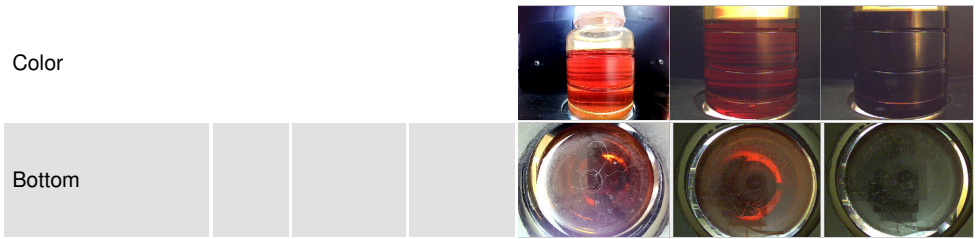

## GRAPHS

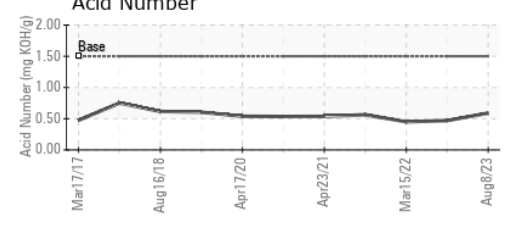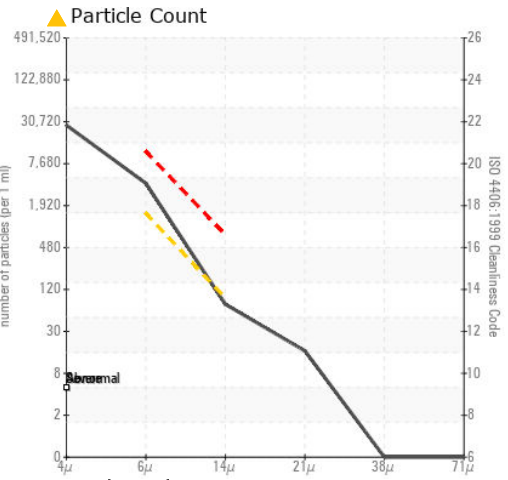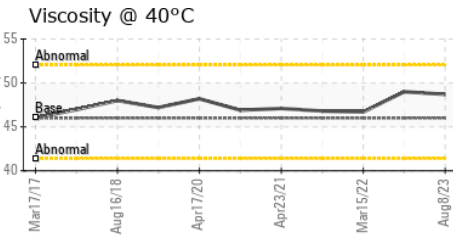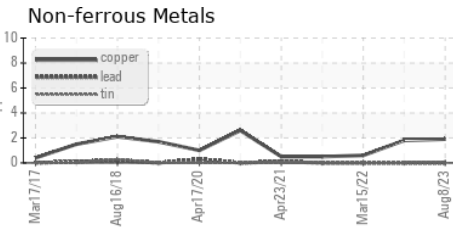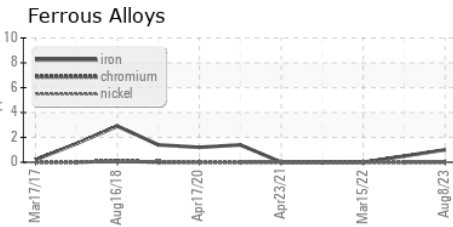

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA004664 **Received** : 24 Aug 2023  
**Lab Number** : 05934366 **Diagnosed** : 28 Aug 2023  
**Unique Number** : 10619637 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**RING CAN CORPORATION**  
 1699 CLAY RD  
 VALDOSTA, GA  
 US 31601  
 Contact: JIMMY GRIGGS  
 jimmy.griggs@ringcontainer.com

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)