




# OIL ANALYSIS REPORT

Sample Rating Trend

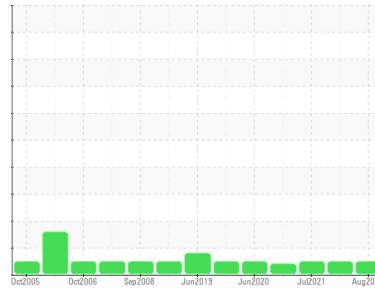

**NORMAL**



Machine Id  
**FRICK RC-8 (S/N SGC23170261)**

Component  
**Refrigeration Compressor**

Fluid  
**FRICK COMPRESSOR OIL #3 (150 GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>USP230325</b>	USP230312	USP201994
Sample Date	Client Info		<b>18 Aug 2023</b>	12 Jun 2022	22 Jul 2021
Machine Age	hrs	Client Info	<b>93178</b>	89011	84271
Oil Age	hrs	Client Info	<b>0</b>	89011	0
Oil Changed	Client Info		<b>Not Changed</b>	N/A	Changed
Sample Status			<b>NORMAL</b>	NORMAL	NORMAL

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >8	<b>1</b>	1	1
Chromium	ppm	ASTM D5185m >2	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	<1	0
Aluminum	ppm	ASTM D5185m >3	<b>0</b>	<1	<1
Lead	ppm	ASTM D5185m >2	<b>0</b>	0	0
Copper	ppm	ASTM D5185m >8	<b>0</b>	0	0
Tin	ppm	ASTM D5185m >4	<b>0</b>	0	0
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	2
Barium	ppm	ASTM D5185m	<b>2</b>	1	2
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m	<b>0</b>	0	0
Calcium	ppm	ASTM D5185m	<b>&lt;1</b>	0	<1
Phosphorus	ppm	ASTM D5185m	<b>1</b>	0	0
Zinc	ppm	ASTM D5185m	<b>0</b>	1	<1
Sulfur	ppm	ASTM D5185m	<b>576</b>	556	569

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >15	<b>2</b>	2	2
Sodium	ppm	ASTM D5185m	<b>0</b>	0	0
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	0	0
Water	%	ASTM D6304 >0.01	<b>0.00</b>	0.001	0.002
ppm Water	ppm	ASTM D6304 >100	<b>0.00</b>	3.8	19.5

## FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>700</b>	3419	1726
Particles >6µm	ASTM D7647	>2500	<b>208</b>	677	521
Particles >14µm	ASTM D7647	>320	<b>17</b>	24	44
Particles >21µm	ASTM D7647	>80	<b>6</b>	6	7
Particles >38µm	ASTM D7647	>20	<b>0</b>	0	0
Particles >71µm	ASTM D7647	>4	<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c)	>21/18/15	<b>17/15/11</b>	19/17/12	18/16/13

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	<b>0.013</b>	0.013	0.015




# OIL ANALYSIS REPORT

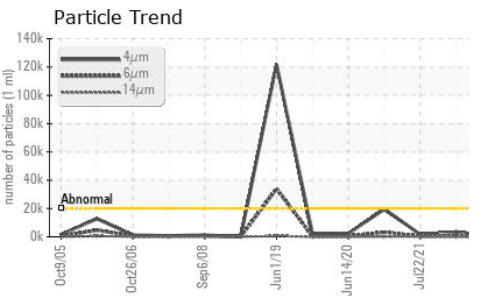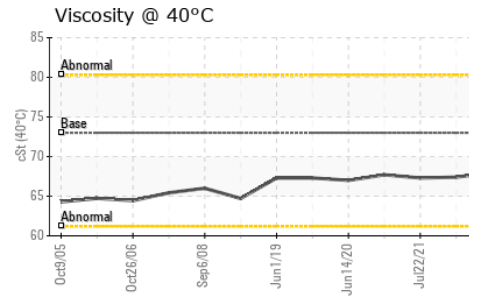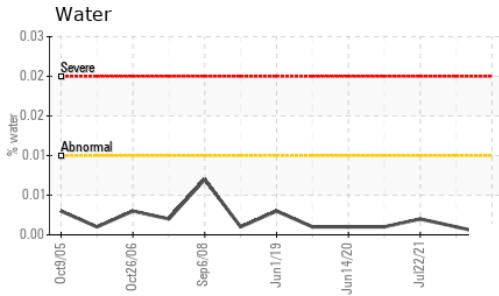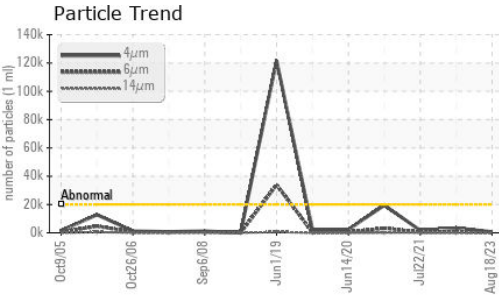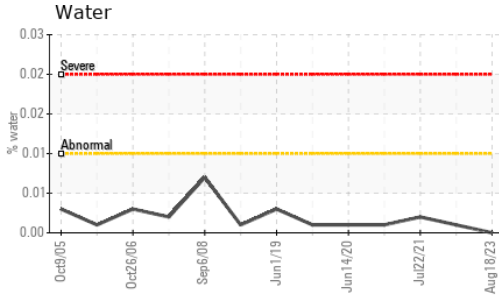






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.01	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 73	<b>68.0</b>	67.4	67.3

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

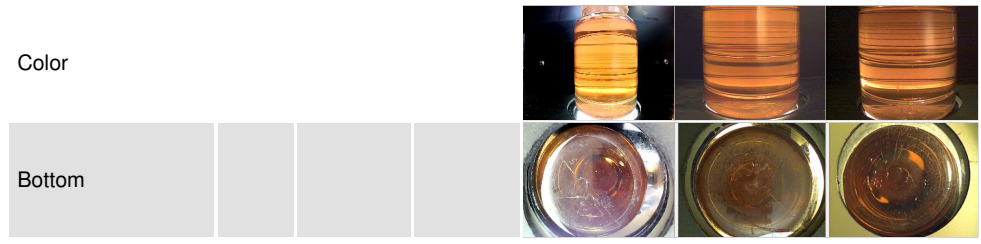

## GRAPHS

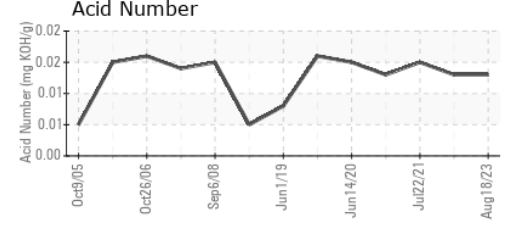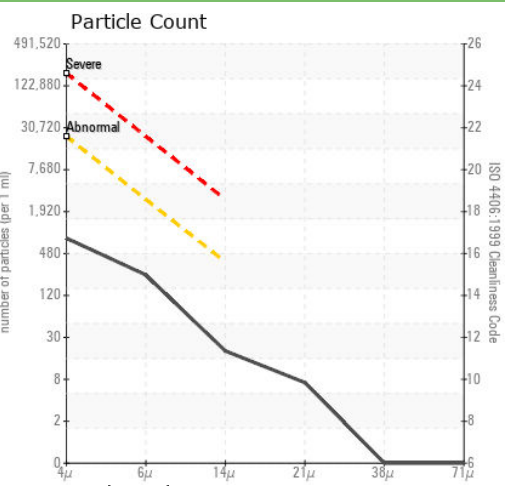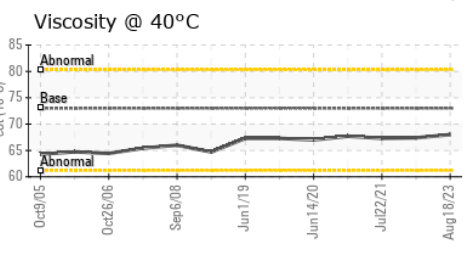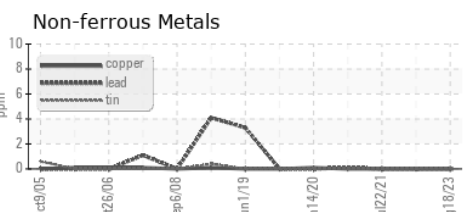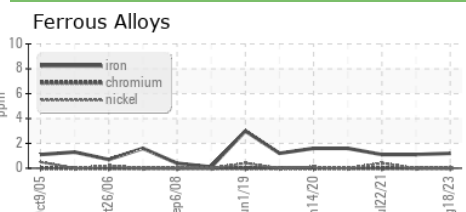

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : USP230325 **Received** : 24 Aug 2023  
**Lab Number** : 05934405 **Diagnosed** : 28 Aug 2023  
**Unique Number** : 10619676 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**SCHREIBER FOODS**  
 923 CR 176  
 STEPHENVILLE, TX  
 US 76401

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: KRIS STOVER  
 kris.stover@sficorp.com; canastasio@wearcheckusa.com  
 T: (254)968-0012  
 F: (254)968-2747