


PROBLEM SUMMARY

KAESER SK15 3675434 (S/N 1871)


KAESER SIGMA (OEM) S-460 (--- GAL)

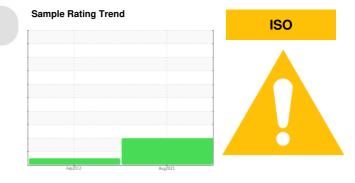

COMPONENT CONDITION SUMMARY

Component Compressor

Fluid

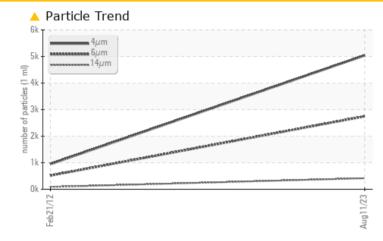

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

| PROBLEMATIC TEST RESULTS | | | | | | | | |
|--------------------------|--------------|---------|------------|---------------|--|--|--|--|
| Sample Status | | | ABNORMAL | MARGINAL | | | | |
| Particles >6µm | ASTM D7647 | >1300 | <u> </u> | 516 | | | | |
| Particles >14µm | ASTM D7647 | >80 | 415 | <u> </u> | | | | |
| Particles >21µm | ASTM D7647 | >20 | <u> </u> | <u> </u> | | | | |
| Particles >38µm | ASTM D7647 | >4 | <u> </u> | <u> </u> | | | | |
| Oil Cleanliness | ISO 4406 (c) | >/17/13 | <u> </u> | 1 6/14 | | | | |

Customer Id: WESLYO Sample No.: KCPA005126 Lab Number: 05935400 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

| RECOMMENDED ACTIONS | | | | |
|---------------------|--------|------|---------|---|
| Action | Status | Date | Done By | Description |
| Change Filter | | | ? | We recommend you service the filters on this component. |

HISTORICAL DIAGNOSIS

ISO


21 Feb 2012 Diag: Doug Bogart

No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The condition of oil is suitable for further service.





OIL ANALYSIS REPORT

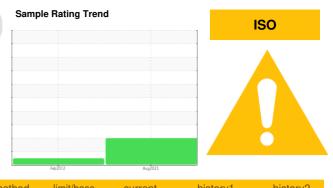



NOOLO

Machine Id KAESER SK15 3675434 (S/N 1871) Component

Compressor Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)


| DIAGNOSIS | SAMPLE INFORMA | TION | method | limit/base | current | history1 | history2 |
|---|------------------|-----------|--------------|------------|---------------|-------------|-----------|
| A Recommendation | Sample Number | | Client Info | | KCPA005126 | KC24480 | |
| We recommend you service the filters on this | Sample Date | | Client Info | | 11 Aug 2023 | 21 Feb 2012 | |
| component. Resample at the next service interval to | | irs | Client Info | | 32272 | 4367 | |
| monitor. | Oil Age h | irs | Client Info | | 0 | 2361 | |
| Wear | Oil Changed | | Client Info | | N/A | N/A | |
| All component wear rates are normal. | Sample Status | | | | ABNORMAL | MARGINAL | |
| Contamination | WEAR METALS | | method | limit/base | current | history1 | history2 |
| There is a high amount of particulates present in | | | | | | | Thistory2 |
| the oil. | | pm | ASTM D5185m | | 0 | 2 | |
| Fluid Condition | | pm | ASTM D5185m | >5 | 0 | <1 | |
| The AN level is acceptable for this fluid. The | | pm | ASTM D5185m | | 0 | 0 | |
| condition of the oil is suitable for further service. | | pm | ASTM D5185m | | 0 | 0 | |
| | | pm | ASTM D5185m | | 0 | 0 | |
| | | pm | ASTM D5185m | | 0 | <1 | |
| | | pm | ASTM D5185m | | 0 | <1 | |
| | | pm | ASTM D5185m | | 3 | 3 | |
| | | pm | ASTM D5185m | >10 | 0 | 0 | |
| | • | pm | ASTM D5185m | | | 0 | |
| | Vanadium p | pm | ASTM D5185m | | <1 | 0 | |
| | Cadmium p | pm | ASTM D5185m | | 0 | 0 | |
| | ADDITIVES | | method | limit/base | current | history1 | history2 |
| | Boron p | pm | ASTM D5185m | | 0 | 0 | |
| | | pm | ASTM D5185m | 90 | 0 | 0 | |
| | | pm | ASTM D5185m | | 0 | <1 | |
| | 2 | pm | ASTM D5185m | | 0 | <1 | |
| | - | pm | ASTM D5185m | 90 | 11 | 47 | |
| | | pm | ASTM D5185m | 2 | 0 | <1 | |
| | Phosphorus p | pm | ASTM D5185m | | <1 | 1 | |
| | | pm | ASTM D5185m | | 0 | 23 | |
| | Sulfur p | pm | ASTM D5185m | | 20605 | 17707 | |
| | CONTAMINANTS | | method | limit/base | current | history1 | history2 |
| | Silicon | pm | ASTM D5185m | >35 | 0 | <1 | |
| | | pm | ASTM D5185m | 200 | 5 | 15 | |
| | | pm | ASTM D5185m | >20 | 0 | 0 | |
| | Water % | | ASTM D510311 | | 0.008 | 0.003 | |
| | | pm | ASTM D6304 | | 86.7 | 30 | |
| | FLUID CLEANLINES | SS | method | limit/base | current | history1 | history2 |
| | Particles >4µm | | ASTM D7647 | | 5041 | 948 | |
| | Particles >6µm | | ASTM D7647 | >1300 | <u>^</u> 2748 | 516 | |
| | Particles >14µm | | ASTM D7647 | | <u> </u> | ▲ 88 | |
| | Particles >21µm | | ASTM D7647 | | <u> </u> | <u> </u> | |
| | Particles >38µm | | ASTM D7647 | | <u> </u> | 4 | |
| | Particles >71µm | | ASTM D7647 | | 0 | 0 | |
| | Oil Cleanliness | | ISO 4406 (c) | | <u> </u> | ▲ 16/14 | |
| | FLUID DEGRADATI | ION | method | limit/base | | history1 | history2 |
| | | ng KOH/g | ASTM D8045 | | 0.40 | 0.533 | |
| | | іу і∖∪⊓/у | A0 HVI D0040 | 0.4 | 0.40 | 0.000 | |


Report Id: WESLYO [WUSCAR] 05935400 (Generated: 08/28/2023 12:42:03) Rev: 1

Contact/Location: ? ? - WESLYO



OIL ANALYSIS REPORT

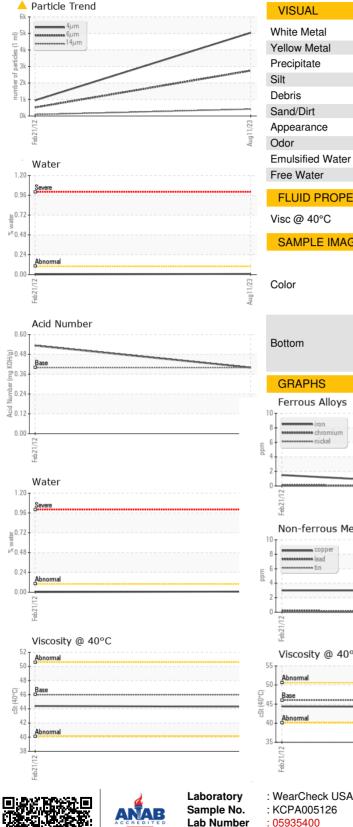

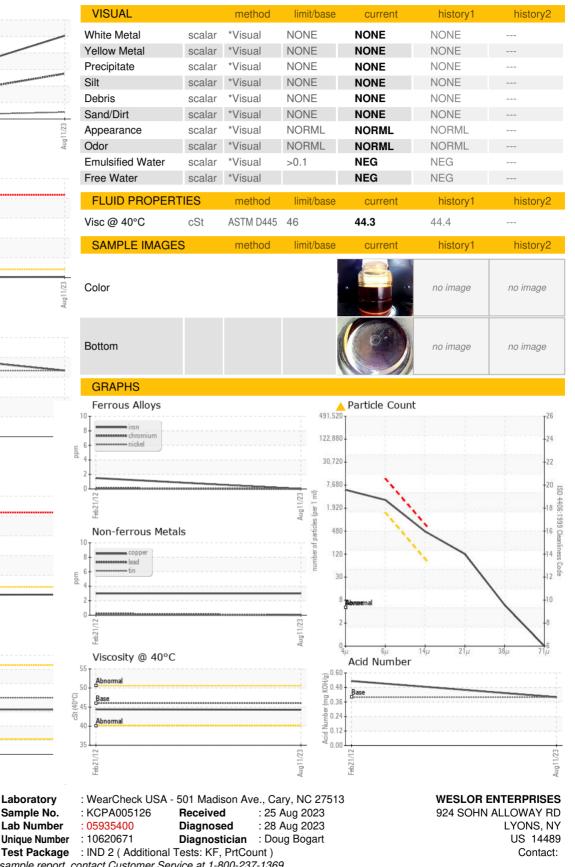

To discuss this sample report, contact Customer Service at 1-800-237-1369. * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Page 4 of 4

Certificate L2367

Unique Number