




PROBLEM SUMMARY

Sample Rating Trend

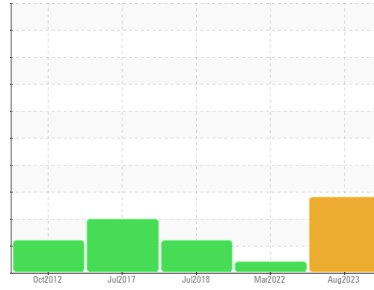

WATER




Machine Id
KAESER BSD 50 3883594 (S/N 1306)

Component
Compressor


Fluid
KAESER SIGMA (OEM) S-460 (--- PNT)

COMPONENT CONDITION SUMMARY

▲ Water

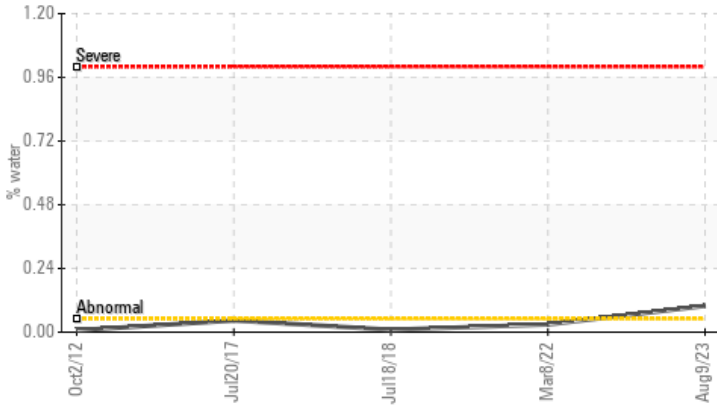

▲ Particle Trend

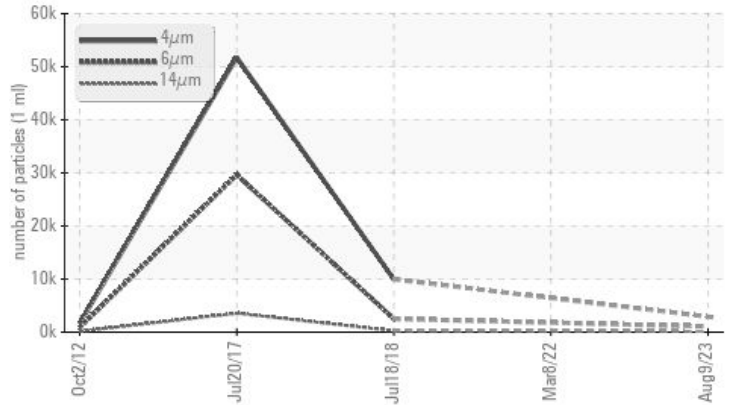

RECOMMENDATION

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

PROBLEMATIC TEST RESULTS

Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
Water	%	ASTM D6304	>0.05	▲ 0.099	0.029	0.009
ppm Water	ppm	ASTM D6304	>500	▲ 995.4	296.5	90
Particles >14µm		ASTM D7647	>80	▲ 136	---	▲ 248
Particles >21µm		ASTM D7647	>20	▲ 43	---	▲ 77
Oil Cleanliness		ISO 4406 (c)	>--/17/13	▲ 19/17/14	---	▲ 19/15

Customer Id: CAMSTR
 Sample No.: KC05935418
 Lab Number: 05935418
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

08 Mar 2022 Diag: Angela Borella

VIS DEBRIS



Oil and filter change at the time of sampling has been noted. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

[view report](#)



18 Jul 2018 Diag: Jonathan Hester

ISO



The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



20 Jul 2017 Diag: Doug Bogart

CONTAMINANT




Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



OIL ANALYSIS REPORT

Sample Rating Trend

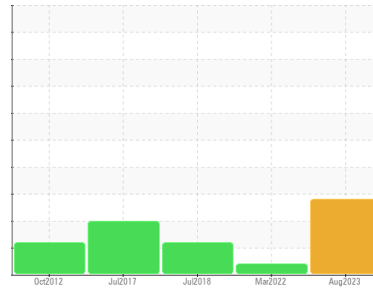

WATER



Machine Id
KAESER BSD 50 3883594 (S/N 1306)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- PNT)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. We advise that you stop the unit and follow the water drain-off procedure for this component. We recommend an early resample in 500 hours to monitor this condition.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil. There is a light concentration of water present in the oil.

Fluid Condition

The AN level is acceptable for this fluid.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC05935418	KC100112	KC75059
Sample Date	Client Info	09 Aug 2023	08 Mar 2022	18 Jul 2018
Machine Age	hrs	81533	73617	50042
Oil Age	hrs	0	8793	8378
Oil Changed	Client Info	N/A	Changed	Not Changed
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	0	<1	<1
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	0	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	<1	0
Aluminum	ppm	ASTM D5185m >10	0	2	<1
Lead	ppm	ASTM D5185m >10	0	0	0
Copper	ppm	ASTM D5185m >50	10	13	13
Tin	ppm	ASTM D5185m >10	0	<1	0
Antimony	ppm	ASTM D5185m	---	0	0
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	<1	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	<1	0
Barium	ppm	ASTM D5185m 90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	0
Magnesium	ppm	ASTM D5185m 90	0	0	2
Calcium	ppm	ASTM D5185m 2	0	0	0
Phosphorus	ppm	ASTM D5185m	27	180	<1
Zinc	ppm	ASTM D5185m	0	0	38

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	0	<1	0
Sodium	ppm	ASTM D5185m	1	0	2
Potassium	ppm	ASTM D5185m >20	0	<1	0
Water	%	ASTM D6304 >0.05	▲ 0.099	0.029	0.009
ppm Water	ppm	ASTM D6304 >500	▲ 995.4	296.5	90






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	2920	---	9958
Particles >6µm	ASTM D7647 >1300	1065	---	▲ 2504
Particles >14µm	ASTM D7647 >80	▲ 136	---	▲ 248
Particles >21µm	ASTM D7647 >20	▲ 43	---	▲ 77
Particles >38µm	ASTM D7647 >4	2	---	4
Particles >71µm	ASTM D7647 >3	0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 19/17/14	---	▲ 19/15

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.41	0.49	0.396


OIL ANALYSIS REPORT

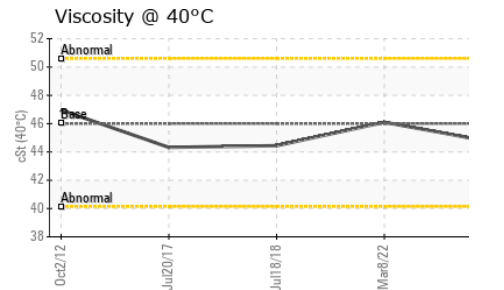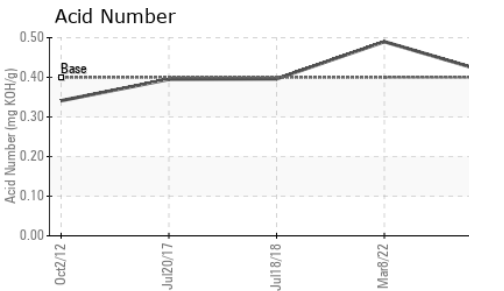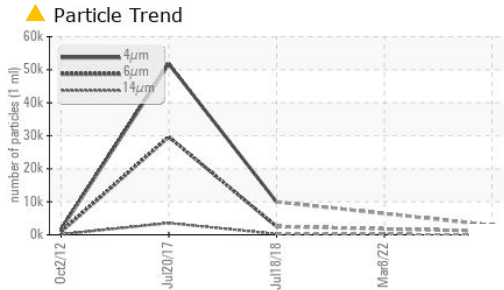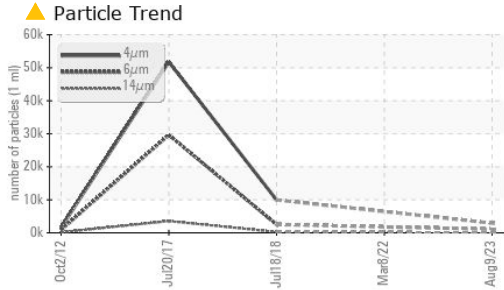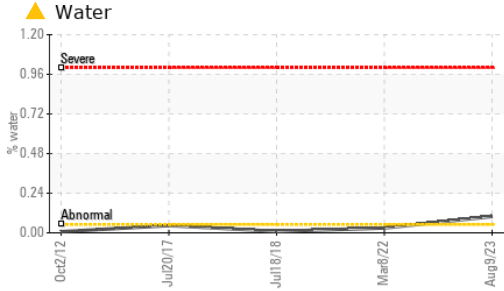






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.7	46.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

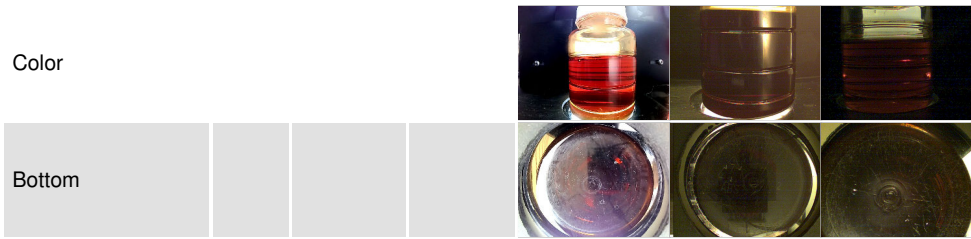

GRAPHS

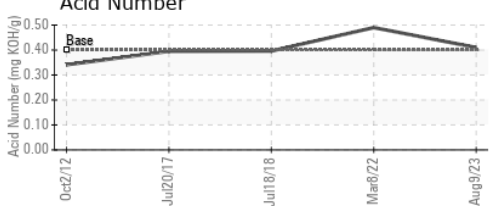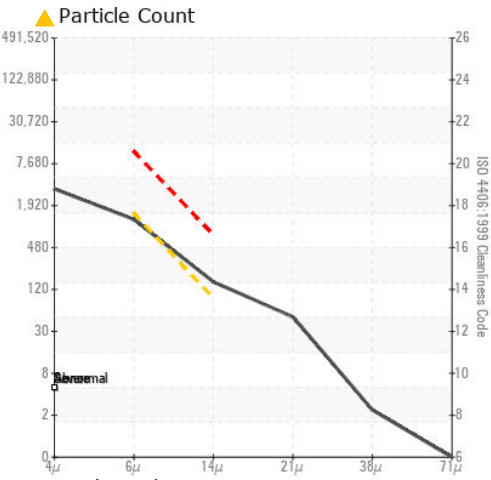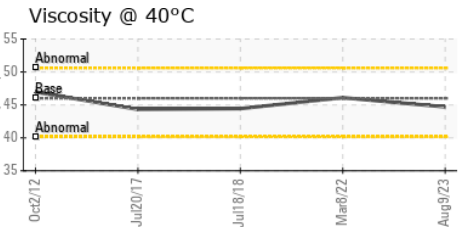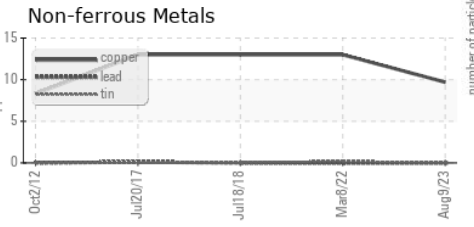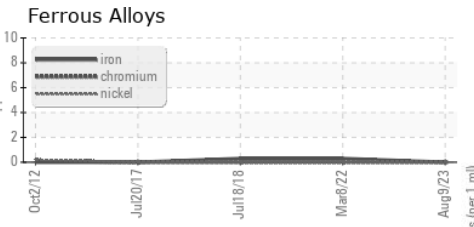

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KC05935418
 Lab Number : 05935418
 Unique Number : 10620689
 Test Package : IND 2
 Received : 25 Aug 2023
 Diagnosed : 28 Aug 2023
 Diagnostician : Don Baldrige

CAMERON COMPRESSOR
 10446 RIVER RD
 ST ROSE, LA
 US 70087
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: