




PROBLEM SUMMARY

Sample Rating Trend

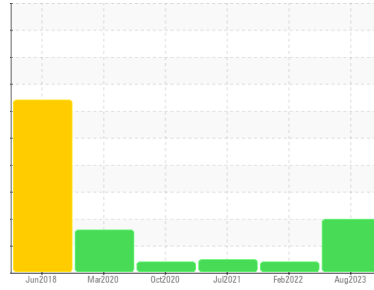

ISO




Machine Id
KAESER SK 19 2182448 (S/N 1694)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

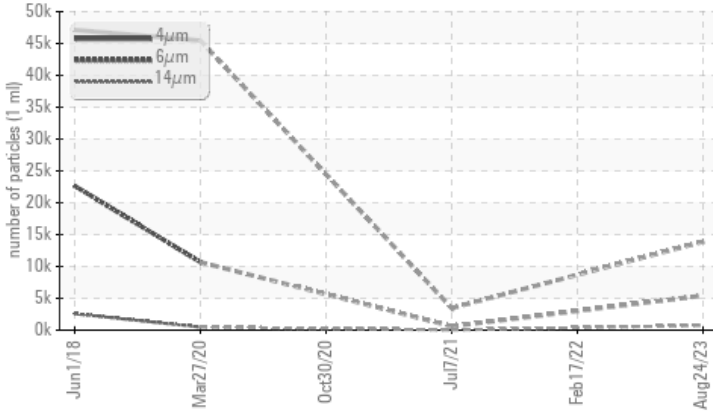

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	NORMAL
Particles >6µm	ASTM D7647	>1300	▲ 5426	---	603
Particles >14µm	ASTM D7647	>80	▲ 730	---	32
Particles >21µm	ASTM D7647	>20	▲ 203	---	9
Particles >38µm	ASTM D7647	>4	▲ 6	---	2
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 21/20/17	---	16/12

Customer Id: MCKNORMA
Sample No.: KCPA004657
Lab Number: 05935422
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

17 Feb 2022 Diag: Don Baldrige

VIS DEBRIS



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



07 Jul 2021 Diag: Angela Borella

NORMAL



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



30 Oct 2020 Diag: Angela Borella

VIS DEBRIS




The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample. All component wear rates are normal. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



Machine Id
KAESER SK 19 2182448 (S/N 1694)

Component
Compressor
Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

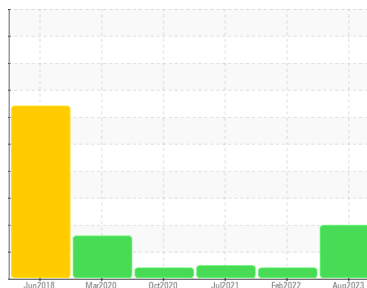

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA004657	KCP35329	KCP33132
Sample Date	Client Info	24 Aug 2023	17 Feb 2022	07 Jul 2021
Machine Age	hrs	35792	29073	27012
Oil Age	hrs	0	3620	5459
Oil Changed	Client Info	N/A	Not Changd	Changed
Sample Status		ABNORMAL	ABNORMAL	NORMAL

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm ASTM D5185m >50	<1	3	<1
Chromium	ppm ASTM D5185m >10	0	0	0
Nickel	ppm ASTM D5185m >3	0	0	<1
Titanium	ppm ASTM D5185m >3	0	0	0
Silver	ppm ASTM D5185m >2	0	0	<1
Aluminum	ppm ASTM D5185m >10	0	<1	0
Lead	ppm ASTM D5185m >10	0	<1	0
Copper	ppm ASTM D5185m >50	11	7	14
Tin	ppm ASTM D5185m >10	0	0	0
Antimony	ppm ASTM D5185m	---	0	1
Vanadium	ppm ASTM D5185m	<1	0	0
Cadmium	ppm ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm ASTM D5185m	0	0	5
Barium	ppm ASTM D5185m 90	0	0	0
Molybdenum	ppm ASTM D5185m	0	0	0
Manganese	ppm ASTM D5185m	<1	<1	<1
Magnesium	ppm ASTM D5185m 90	27	59	12
Calcium	ppm ASTM D5185m 2	0	4	0
Phosphorus	ppm ASTM D5185m	0	2	2
Zinc	ppm ASTM D5185m	16	21	4
Sulfur	ppm ASTM D5185m	20803	16805	16005

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D5185m >25	0	1	0
Sodium	ppm ASTM D5185m	17	33	6
Potassium	ppm ASTM D5185m >20	1	6	2
Water	% ASTM D6304 >0.05	0.014	0.012	0.009
ppm Water	ppm ASTM D6304 >500	148.9	123.8	91.7






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	13896	---	3467
Particles >6µm	ASTM D7647 >1300	▲ 5426	---	603
Particles >14µm	ASTM D7647 >80	▲ 730	---	32
Particles >21µm	ASTM D7647 >20	▲ 203	---	9
Particles >38µm	ASTM D7647 >4	▲ 6	---	2
Particles >71µm	ASTM D7647 >3	0	---	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 21/20/17	---	16/12

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g ASTM D8045 0.4	0.31	0.34	0.351

OIL ANALYSIS REPORT

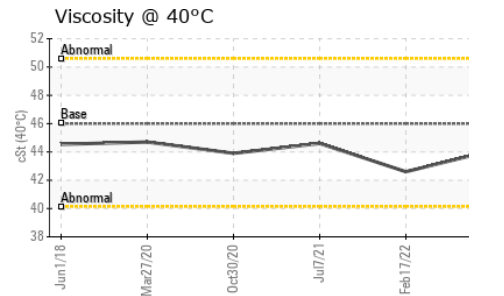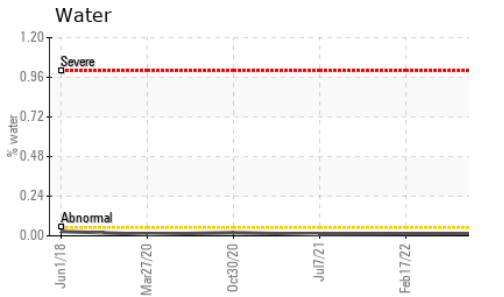
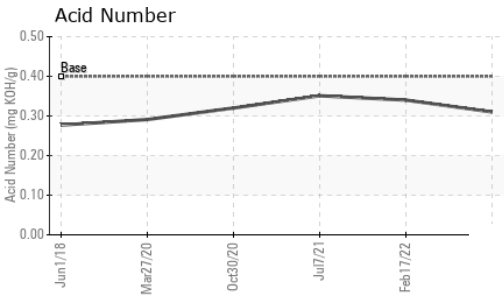
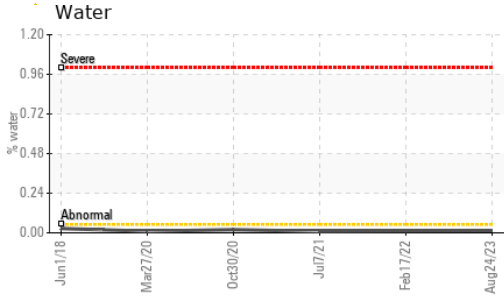
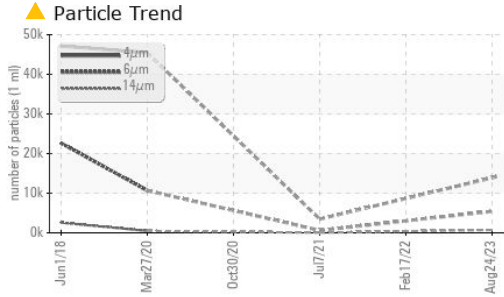


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 46	44.1	42.6	44.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

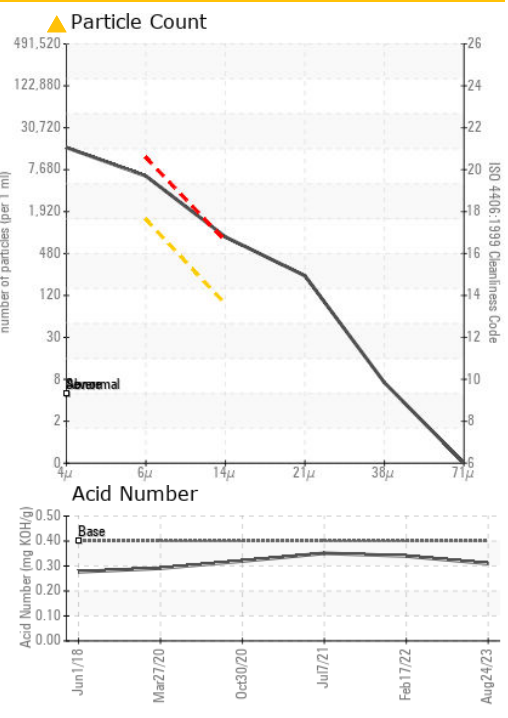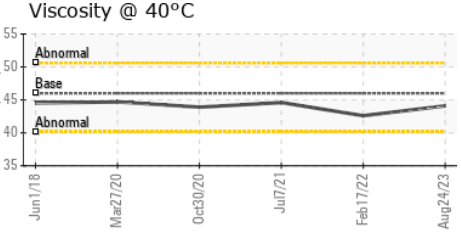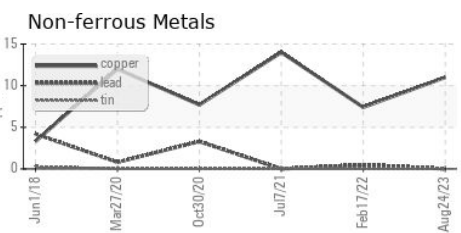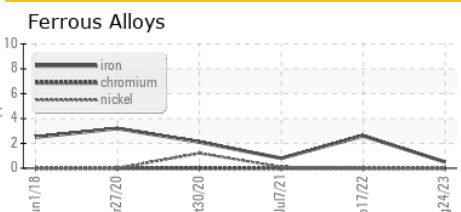

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA004657 **Received** : 25 Aug 2023
Lab Number : 05935422 **Diagnosed** : 28 Aug 2023
Unique Number : 10620693 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

MCKESSON MEDICAL
 55 LYMAN ST
 NORTHBOROUGH, MA
 US 01532
 Contact: ERIC BERLO
 eric.berlo@mckesson.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)