




OIL ANALYSIS REPORT

Sample Rating Trend

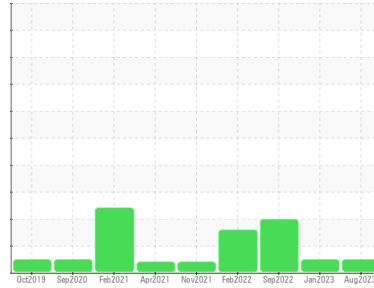

NORMAL



Machine Id
PICKLE MEZZ I/R - VK5418U18312

Component
Air Compressor

Fluid
INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	USPM17741	USPM25413	USPR000806
Sample Date	Client Info	24 Aug 2023	09 Jan 2023	15 Sep 2022
Machine Age	hrs	0	8364	0
Oil Age	hrs	0	0	0
Oil Changed	Client Info	N/A	N/A	N/A
Sample Status		NORMAL	NORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	3	2
Chromium	ppm	ASTM D5185m >4	0	0	0
Nickel	ppm	ASTM D5185m >4	0	0	0
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	<1
Aluminum	ppm	ASTM D5185m >10	0	<1	<1
Lead	ppm	ASTM D5185m >20	0	0	<1
Copper	ppm	ASTM D5185m >40	4	2	4
Tin	ppm	ASTM D5185m >5	<1	<1	<1
Antimony	ppm	ASTM D5185m	---	---	---
Vanadium	ppm	ASTM D5185m	<1	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m 0	0	0	<1
Barium	ppm	ASTM D5185m 500	0	35	57
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 0	0	0	0
Calcium	ppm	ASTM D5185m 0	0	0	0
Phosphorus	ppm	ASTM D5185m 20	3	13	2
Zinc	ppm	ASTM D5185m 0	150	103	121
Sulfur	ppm	ASTM D5185m 200	104	109	84

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	<1	1
Sodium	ppm	ASTM D5185m	18	23	25
Potassium	ppm	ASTM D5185m >20	3	1	2
Water	%	ASTM D6304 >0.6	0.161	0.084	0.180
ppm Water	ppm	ASTM D6304 >6000	1616.9	843.5	1803.4

FLUID CLEANLINESS






method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647 >10000	7906	1917	▲ 128405
Particles >6µm	ASTM D7647 >2500	1276	447	▲ 33623
Particles >14µm	ASTM D7647 >320	79	39	▲ 1384
Particles >21µm	ASTM D7647 >80	18	11	▲ 187
Particles >38µm	ASTM D7647 >20	1	0	8
Particles >71µm	ASTM D7647 >4	0	0	0
Oil Cleanliness	ISO 4406 (c) >20/18/15	20/17/13	18/16/12	▲ 24/22/18

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045	0.65	0.41	0.46




OIL ANALYSIS REPORT

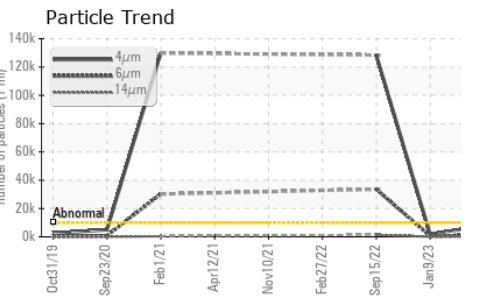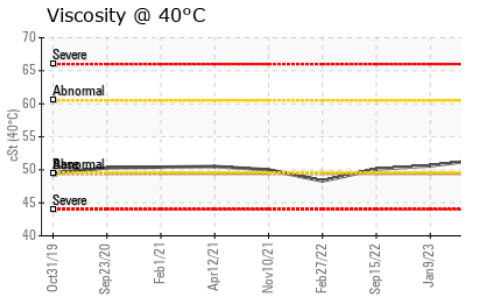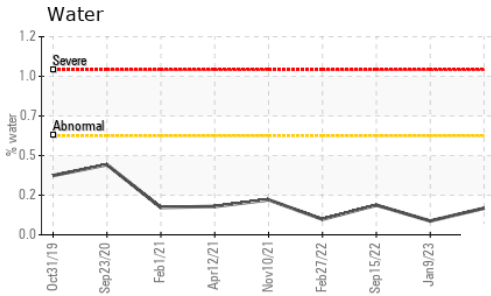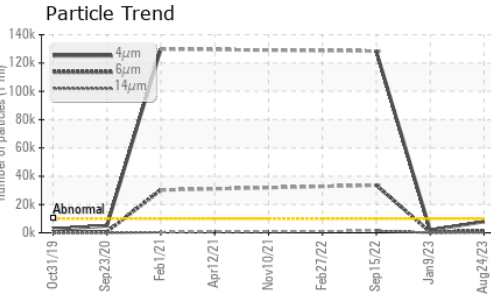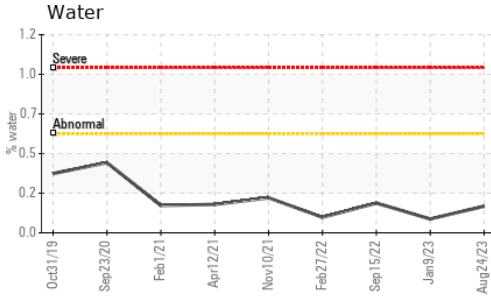






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	LIGHT
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	51.6	50.6

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

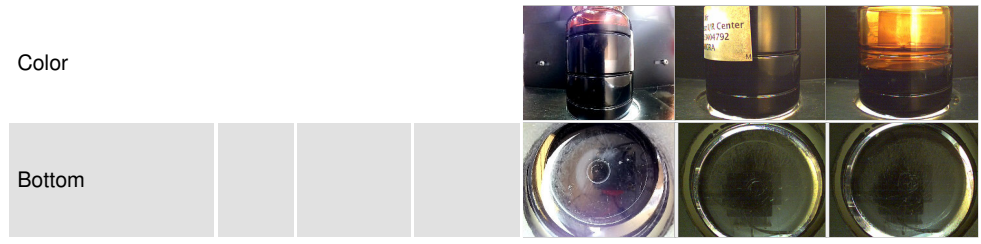

GRAPHS

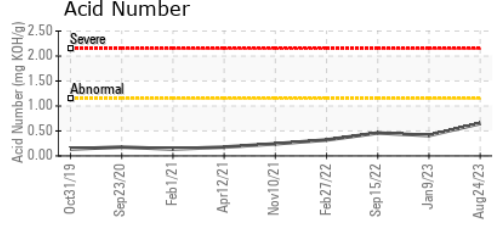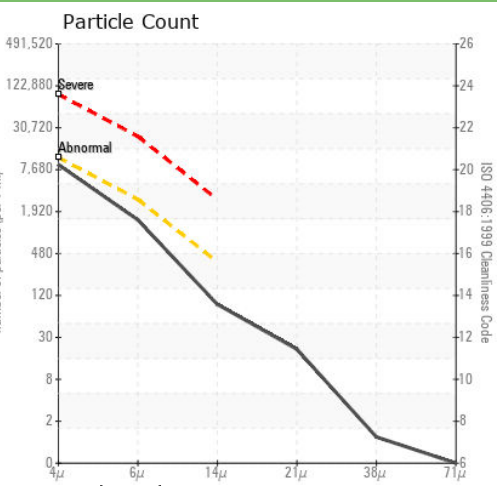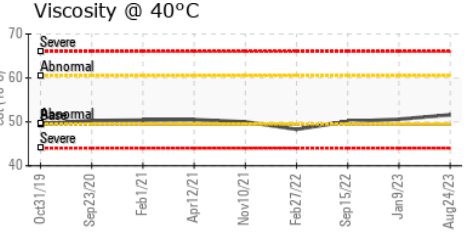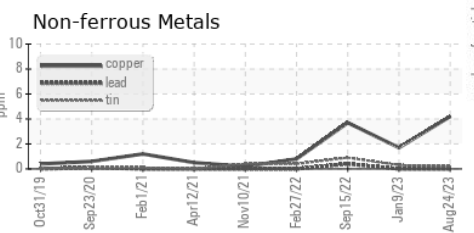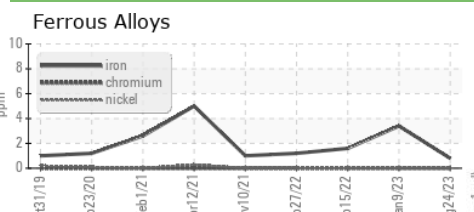

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM17741 **Received** : 25 Aug 2023
Lab Number : 05935429 **Diagnosed** : 28 Aug 2023
Unique Number : 10620700 **Diagnostician** : Doug Bogart
Test Package : IND 2

SMITHFIELD FOODS - GRAYSON
 800 C W STEVENS BLVD
 GRAYSON, KY
 US 41143
 Contact:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: