PROBLEM SUMMARY

Sample Rating Trend

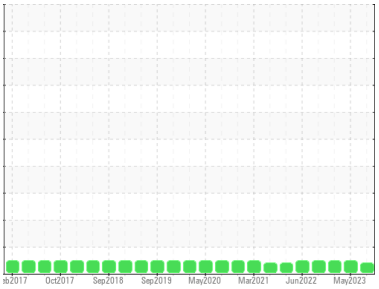

VIS DEBRIS

Machine Id
TOK12838 - SOUTH 400HP (S/N S076091)
Component
Air Compressor
Fluid
USPI MAX FG AIR 46 (--- GAL)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	NORMAL	NORMAL
Debris	scalar	*Visual	NONE	▲ **MODER**	NONE	NONE

Customer Id: THESAL
Sample No.: USPM29424
Lab Number: 05935438
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

15 May 2023 Diag: Doug Bogart

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the component. The amount and size of particulates present in the system is acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

23 Jan 2023 Diag: Doug Bogart

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

03 Oct 2022 Diag: Doug Bogart

NORMAL

Resample at the next service interval to monitor.All component wear rates are normal. There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

OIL ANALYSIS REPORT

Sample Rating Trend

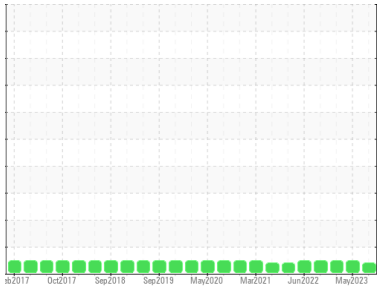

VIS DEBRIS

Machine Id
TOK12838 - SOUTH 400HP (S/N S076091)
Component
Air Compressor
Fluid
USPI MAX FG AIR 46 (--- GAL)

DIAGNOSIS

Recommendation
We recommend you service the filters on this component. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear
All component wear rates are normal.

Contamination
Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**USPM29424**	USPM28964	USPM26314
Sample Date		Client Info		**24 Aug 2023**	15 May 2023	23 Jan 2023
Machine Age	hrs	Client Info		**0**	0	0
Oil Age	hrs	Client Info		**0**	0	0
Oil Changed		Client Info		**N/A**	N/A	N/A
Sample Status				**ABNORMAL**	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	0	0
Chromium	ppm	ASTM D5185m	>4	**0**	0	0
Nickel	ppm	ASTM D5185m	>4	**0**	<1	0
Titanium	ppm	ASTM D5185m		**0**	0	0
Silver	ppm	ASTM D5185m		**0**	0	0
Aluminum	ppm	ASTM D5185m	>10	**0**	<1	0
Lead	ppm	ASTM D5185m	>20	**0**	0	0
Copper	ppm	ASTM D5185m	>40	**0**	0	<1
Tin	ppm	ASTM D5185m	>5	**0**	<1	0
Vanadium	ppm	ASTM D5185m		**<1**	0	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	0	0
Barium	ppm	ASTM D5185m	0	**0**	0	0
Molybdenum	ppm	ASTM D5185m	0	**0**	0	0
Manganese	ppm	ASTM D5185m		**0**	<1	0
Magnesium	ppm	ASTM D5185m	0	**0**	1	0
Calcium	ppm	ASTM D5185m	0	**0**	0	0
Phosphorus	ppm	ASTM D5185m	0	**0**	0	0
Zinc	ppm	ASTM D5185m	0	**0**	0	1
Sulfur	ppm	ASTM D5185m	0	**0**	0	0

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**0**	0	0
Sodium	ppm	ASTM D5185m		**<1**	<1	0
Potassium	ppm	ASTM D5185m	>20	**0**	1	0
Water	%	ASTM D6304	>0.6	**0.019**	0.008	0.005
ppm Water	ppm	ASTM D6304	>6000	**196.6**	81.1	52.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	**---**	557	30
Particles >6µm		ASTM D7647	>2500	**---**	73	11
Particles >14µm		ASTM D7647	>320	**---**	4	1
Particles >21µm		ASTM D7647	>80	**---**	1	1
Particles >38µm		ASTM D7647	>20	**---**	0	0
Particles >71µm		ASTM D7647	>4	**---**	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	**---**	16/13/9	12/11/7

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.16	**0.42**	0.27	0.17

OIL ANALYSIS REPORT

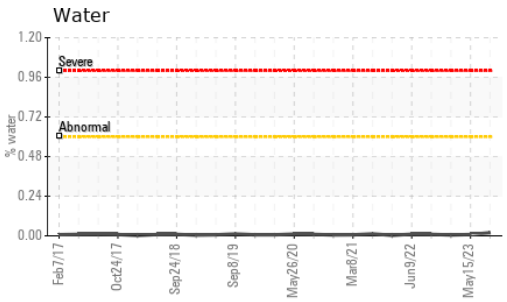

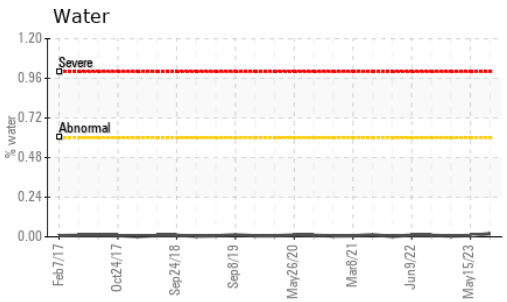

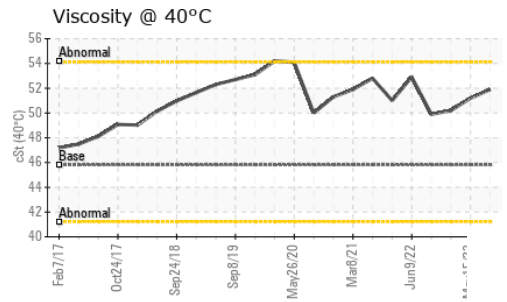

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	▲ **MODER**	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.6	**NEG**	NEG	NEG
Free Water	scalar	*Visual		**NEG**	NEG	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45.8	**51.9**	51.2	50.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

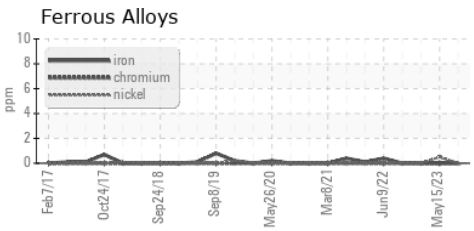

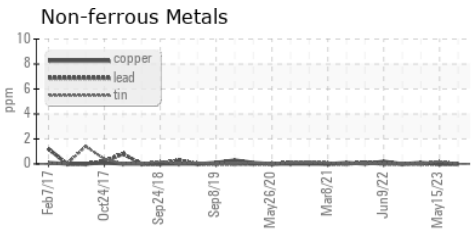

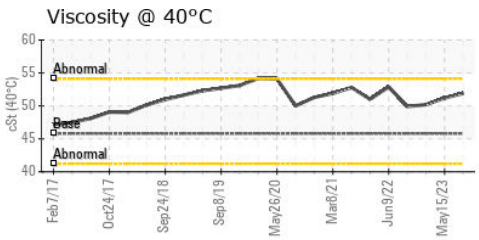

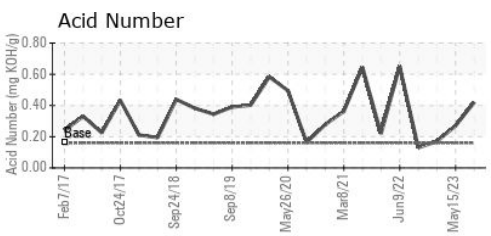

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : USPM29424
Lab Number : 05935438
Unique Number : 10620709
Test Package : IND 2

Received : 25 Aug 2023
Diagnosed : 28 Aug 2023
Diagnostician : Doug Bogart

THE SCHWAN FOOD CO
3019 SCANLAN AVE
SALINA, KS
US 67401
Contact: RICK DUVAL

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: