




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

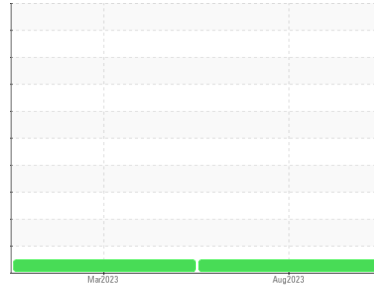

Machine Id  
**MHTF\_B3 MHTF\_B3\_M3**  
 Component  
**Non-Drive End Bearing**  
 Fluid  
**ROYAL PURPLE SYNFILM GT 32 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>RP0033063</b>	RP0012788	---
Sample Date	Client Info	<b>24 Aug 2023</b>	12 Mar 2023	---
Machine Age	hrs Client Info	<b>0</b>	0	---
Oil Age	hrs Client Info	<b>0</b>	0	---
Oil Changed	Client Info	<b>N/A</b>	N/A	---
Sample Status		<b>NORMAL</b>	NORMAL	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>20	<b>2</b>	<1	---
Chromium ppm ASTM D5185m	>20	<b>0</b>	0	---
Nickel ppm ASTM D5185m	>20	<b>&lt;1</b>	0	---
Titanium ppm ASTM D5185m		<b>0</b>	0	---
Silver ppm ASTM D5185m		<b>0</b>	0	---
Aluminum ppm ASTM D5185m	>20	<b>0</b>	<1	---
Lead ppm ASTM D5185m	>20	<b>14</b>	0	---
Copper ppm ASTM D5185m	>20	<b>3</b>	0	---
Tin ppm ASTM D5185m	>20	<b>0</b>	0	---
Vanadium ppm ASTM D5185m		<b>0</b>	0	---
Cadmium ppm ASTM D5185m		<b>0</b>	0	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	0	---
Barium ppm ASTM D5185m		<b>2</b>	2	---
Molybdenum ppm ASTM D5185m		<b>0</b>	0	---
Manganese ppm ASTM D5185m		<b>&lt;1</b>	0	---
Magnesium ppm ASTM D5185m		<b>75</b>	90	---
Calcium ppm ASTM D5185m		<b>4</b>	2	---
Phosphorus ppm ASTM D5185m		<b>10</b>	2	---
Zinc ppm ASTM D5185m		<b>9</b>	<1	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>15	<b>15</b>	2	---
Sodium ppm ASTM D5185m		<b>2</b>	1	---
Potassium ppm ASTM D5185m	>20	<b>1</b>	0	---
Water % ASTM D6304	>2	<b>0.019</b>	0.029	---
ppm Water ppm ASTM D6304		<b>197.8</b>	290.2	---




## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045		<b>0.44</b>	0.322	---

## VISUAL


method	limit/base	current	history1	history2
White Metal scalar *Visual	NONE	<b>NONE</b>	NONE	---
Yellow Metal scalar *Visual	NONE	<b>NONE</b>	NONE	---
Precipitate scalar *Visual	NONE	<b>NONE</b>	NONE	---
Silt scalar *Visual	NONE	<b>NONE</b>	NONE	---
Debris scalar *Visual	NONE	<b>NONE</b>	NONE	---
Sand/Dirt scalar *Visual	NONE	<b>NONE</b>	NONE	---
Appearance scalar *Visual	NORML	<b>NORML</b>	NORML	---
Odor scalar *Visual	NORML	<b>NORML</b>	NORML	---
Emulsified Water scalar *Visual	>2	<b>NEG</b>	NEG	---
Free Water scalar *Visual		<b>NEG</b>	NEG	---

# OIL ANALYSIS REPORT


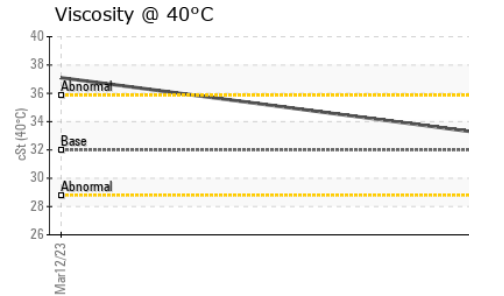
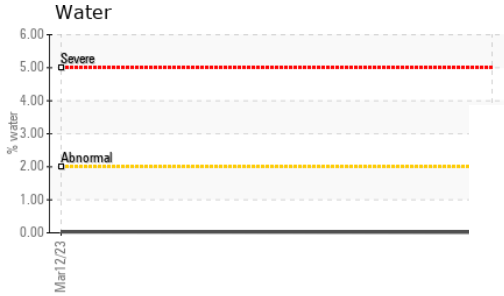
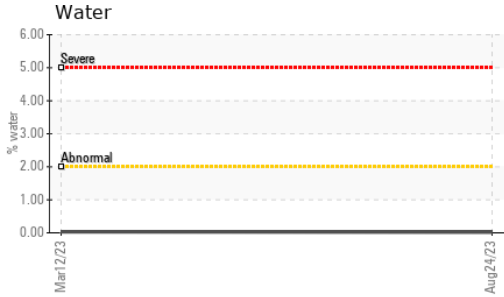


FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	32	<b>33.1</b>	37.1	---

SAMPLE IMAGES		method	limit/base	current	history1	history2
---------------	--	--------	------------	---------	----------	----------

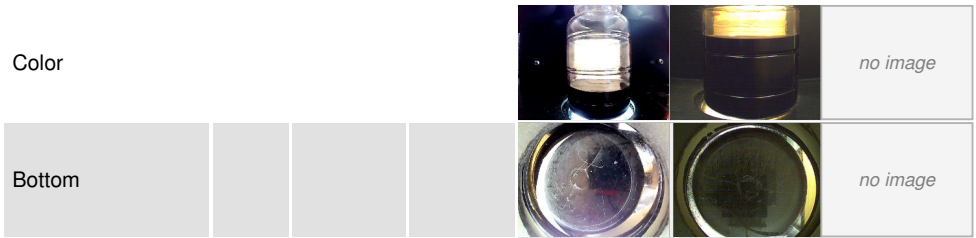

## GRAPHS

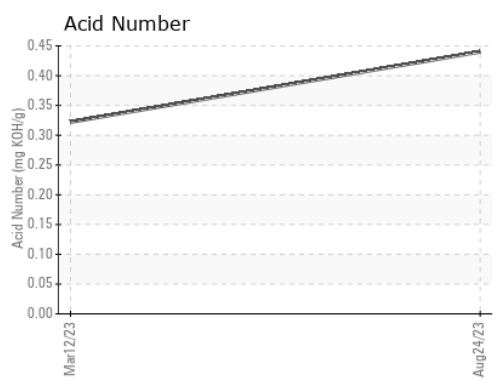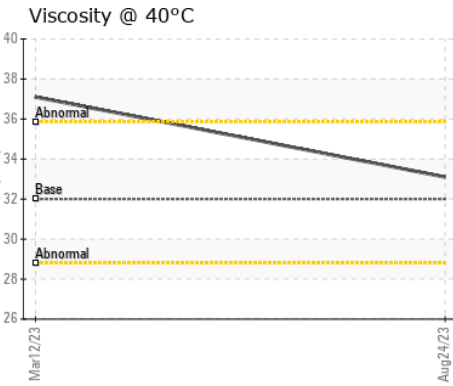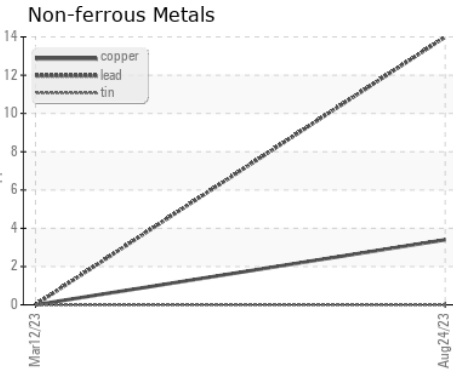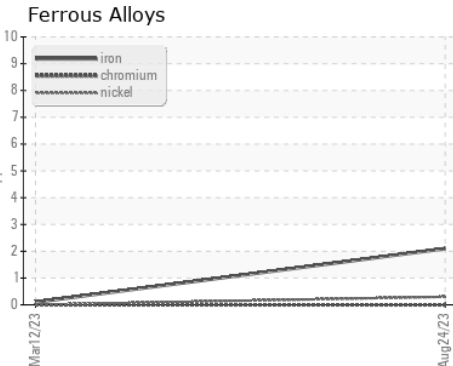

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : RP0033063 **Received** : 25 Aug 2023  
**Lab Number** : **05935509** **Diagnosed** : 28 Aug 2023  
**Unique Number** : 10620780 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**ENERGY TRANSFER - MARCUS HOOK TF**  
 7 COMMERC DRIVE  
 ASTON, PA  
 US 19014  
 Contact: QUITA MORGAN

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (610)220-8386  
 F: