

PROBLEM SUMMARY

Sample Rating Trend

ISO

Hauser

HAU03-3 Generator Outboard Bearing


Case Drain Journal Bearing

CONOCO MULTIPURPOSE R&O OIL ISO 68 (10 GAL)





COMPONENT CONDITION SUMMARY

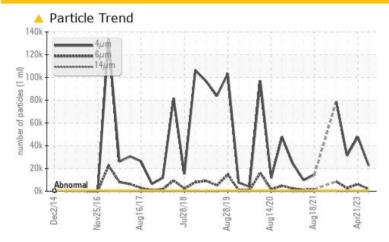

RECOMMENDATION

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

PROBLEMATIC TE	ST RESULTS				
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>640	<u>22435</u>	▲ 47739	▲ 31366
Particles >6µm	ASTM D7647	>160	1750	<u>▲</u> 6227	<u>^</u> 2665
Oil Cleanliness	ISO 4406 (c)	>16/14/12	22/18/12	23/20/14	22/19/13

Customer Id: PPLBUT Sample No.: WC0757755 Lab Number: 05936092 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:

Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter			?	We recommend you service the filters on this component if applicable.

HISTORICAL DIAGNOSIS

21 Apr 2023 Diag: Don Baldridge





We recommend you service the filters on this component. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



06 Nov 2022 Diag: Don Baldridge





We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



24 May 2022 Diag: Jonathan Hester

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.






OIL ANALYSIS REPORT

Hauser

HAU03-3 Generator Outboard Bearing

Case Drain Journal Bearing

CONOCO MULTIPURPOSE R&O OIL ISO 68 (10 GAL)





DIAGNOSIS

Recommendation

We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


SAMPLE INFORM	4 A TIONI	method	limit/base	Aug2019 Aug2020 Aug202		hiotom/O
	MATION		ilmit/base	current	history1	history2
Sample Number		Client Info		WC0757755	WC0757724	WC0715349
Sample Date		Client Info		19 Aug 2023	21 Apr 2023	06 Nov 2022
Machine Age	yrs	Client Info		0	0	0
Oil Age	yrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>60	1	2	1
Chromium	ppm	ASTM D5185m	>20	0	0	0
Nickel	ppm	ASTM D5185m	>20	<1	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>4	0	0	0
Lead	ppm	ASTM D5185m	>250	4	4	4
Copper	ppm	ASTM D5185m	>125	8	8	7
Tin	ppm	ASTM D5185m	>80	4	4	4
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m		1	0	0
Molybdenum	ppm	ASTM D5185m		0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m		<1	<1	<1
Calcium	ppm	ASTM D5185m		0	0	<1
Phosphorus	ppm	ASTM D5185m		11	11	11
Zinc	ppm	ASTM D5185m		5	4	4
Sulfur	ppm	ASTM D5185m		30	23	39
CONTAMINANTS	3	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>50	1	5	2
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	2	1	1
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647	>640	22435	47739	▲ 31366
Particles >6µm		ASTM D7647	>160	<u> </u>	<u>▲</u> 6227	<u>^</u> 2665
Particles >14μm		ASTM D7647	>40	32	<u> </u>	△ 56
Particles >21µm		ASTM D7647	>10	8	<u>^</u> 26	9
Particles >38μm		ASTM D7647	>3	0	<u>4</u>	1
Particles >71μm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>16/14/12	<u>22/18/12</u>	<u>△</u> 23/20/14	<u>22/19/13</u>
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.14	0.072	0.05	0.04




OIL ANALYSIS REPORT



A Par	ticle Tr	end					
_	4 jun	1					
120k - 100k - 10	144	m	-	M	1		
80k -		000100	AL	1	٨		1
60k			M		11.		1
40k -		h	IV		M		N
Ahn	ormal /	L		JA	W_	V.	Maria Maria
0k ⊤ 2	0v25/16	. T1/91Bn	ul28/18	ug28/19 -	720 -	ug18/21.	pr21/23





VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	TIES	method	limit/base	current	history1	history2

/isc @ 40°C	cSt	ASTM D445	68.2	68.2	68.5	68.1

SAMPLE IMAGES n	1
-----------------	---

ethod limit/base current

Particle Count

491 520

history1

history2








GRAPHS

٧

Color











Certificate L2367

Laboratory Sample No. Lab Number **Unique Number**

75

55

cSt (4 60

> : WearCheck USA - 501 Madison Ave., Cary, NC 27513 : WC0757755 : 05936092 : 10621363

Received Diagnosed Diagnostician : Don Baldridge Test Package : IND 2 (Additional Tests: PrtCount)

: 28 Aug 2023 : 29 Aug 2023

Apr21/23

To discuss this sample report, contact Customer Service at 1-800-237-1369.

US 59404 Contact: BRIAN WARD brian.ward@northwestern.com

NORTHWESTERN ENERGY

6700 RAINBOW DAM RD

GREAT FALLS, MT

T:

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

F: (406)533-3401

Contact/Location: BRIAN WARD - PPLBUT