




KAESER 7474242

Component Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

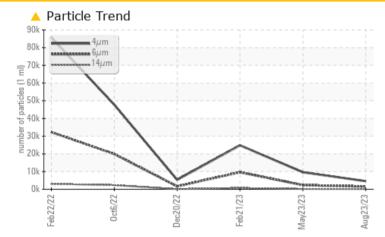

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Sample Rating Trend

PROBLEMATIC TEST RESULTS							
Sample Status		ATTENTION	ABNORMAL	ABNORMAL			
Particles >6µm	ASTM D7647 >130	0 🔺 1565	A 2334	▲ 9642			
Particles >14µm	ASTM D7647 >80	A 153	1 70	A 737			
Particles >21µm	ASTM D7647 >20	<u> </u>	4 0	1 70			
Oil Cleanliness	ISO 4406 (c) >/1	7/13 🔺 19/18/14	🔺 20/18/15	🔺 22/20/17			

Customer Id: CHEJES Sample No.: KC125440 Lab Number: 05936132 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 <u>dougb@wearcheckusa.com</u>

To change component or sample information: Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

23 May 2023 Diag: Don Baldridge

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

21 Feb 2023 Diag: Doug Bogart

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

20 Dec 2022 Diag: Don Baldridge

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



view report





view report

Report Id: CHEJES [WUSCAR] 05936132 (Generated: 08/29/2023 11:51:49) Rev: 1



OIL ANALYSIS REPORT

Machine Id KAESER 7474242 Component

Compressor Fluid KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear


All component wear rates are normal.

Contamination

There is a moderate amount of particulates present in the oil.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

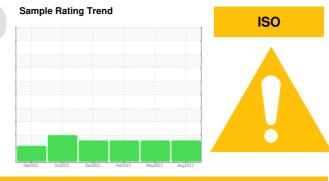



SAMPLE INFORM	ATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC125440	KC104981	KC101626
Sample Date		Client Info		23 Aug 2023	23 May 2023	21 Feb 2023
Machine Age	hrs	Client Info		13796	13795	13591
Oil Age	hrs	Client Info		0	384	1494
Oil Changed		Client Info		N/A	Changed	Not Changd
Sample Status				ATTENTION	ABNORMAL	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	<1	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	0	0	<1
Lead	ppm	ASTM D5185m	>10	<1	0	0
Copper	ppm	ASTM D5185m		<1	2	0
Tin	ppm	ASTM D5185m		0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	90	82	38	59
Molybdenum	ppm	ASTM D5185m	50	0	0	0
Manganese	ppm	ASTM D5185m		0	<1	0
Magnesium	ppm	ASTM D5185m	90	82	71	74
Calcium	ppm	ASTM D5185m		2	2	<1
Phosphorus		ASTM D5185m	2	1	1	1
Zinc	ppm	ASTM D5185m		1	0	<1
	ppm	ASTIVI DOTODIII			0	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	5	2
Sodium	ppm	ASTM D5185m		3	23	15
Potassium	ppm	ASTM D5185m	>20	3	7	0
Water	%	ASTM D6304	>0.05	0.035	0.012	0.011
ppm Water	ppm	ASTM D6304	>500	357.0	122.8	113.6
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4583	9609	24829
Particles >6µm		ASTM D7647	>1300	🔺 1565	A 2334	▲ 9642
Particles >14µm		ASTM D7647	>80	<u> </u>	1 70	A 737
Particles >21µm		ASTM D7647	>20	<u> </u>	<u> </u>	1 70
Particles >38µm		ASTM D7647	>4	2	1	2
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/18/14	▲ 20/18/15	▲ 22/20/17
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.28	0.29



OIL ANALYSIS REPORT






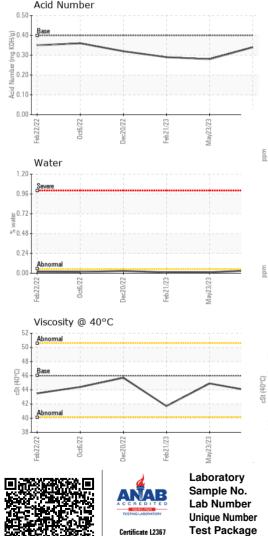

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG	NEG
FLUID PROPERT	IES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	43.8	44.9	41.7
SAMPLE IMAGES	6	method	limit/base	current	history1	history2
Color						

Bottom

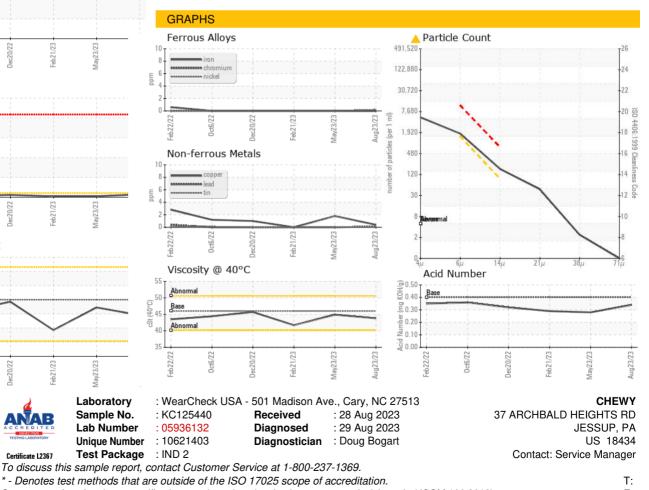

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact/Location: Service Manager - CHEJES

F: