




PROBLEM SUMMARY

Sample Rating Trend

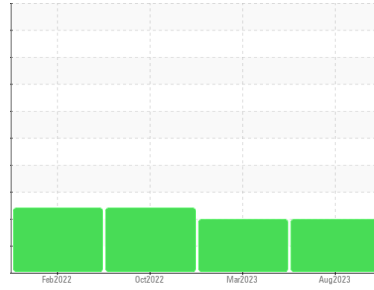

ISO




Machine Id
8043988 (S/N 1665)

Component
Compressor

Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

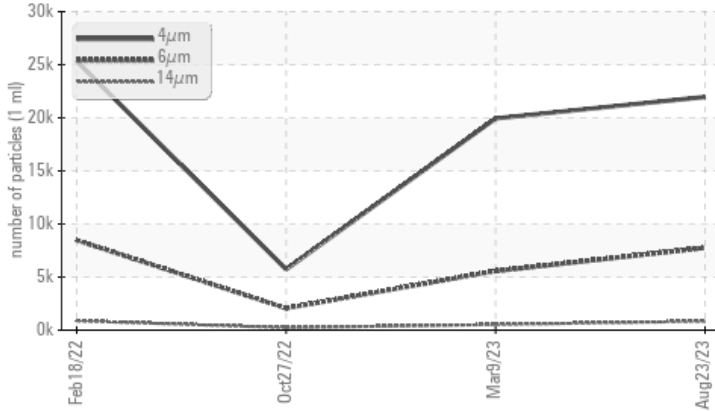

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 7759	▲ 5565	▲ 2052
Particles >14µm	ASTM D7647	>80	▲ 842	▲ 527	▲ 230
Particles >21µm	ASTM D7647	>20	▲ 232	▲ 185	▲ 43
Particles >38µm	ASTM D7647	>4	▲ 6	▲ 16	3
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 22/20/17	▲ 21/20/16	▲ 20/18/15

Customer Id: TRILODNJ
Sample No.: KC100813
Lab Number: 05936138
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

09 Mar 2023 Diag: Don Baldrige

ISO



No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



27 Oct 2022 Diag: Don Baldrige

WEAR



We recommend you service the filters on this component. Resample at the next service interval to monitor. The tin level has decreased, but is still abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

[view report](#)



18 Feb 2022 Diag: Jonathan Hester

WEAR



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. The tin level is abnormal. All other component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


[view report](#)





OIL ANALYSIS REPORT

Sample Rating Trend

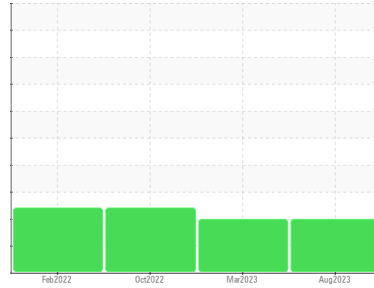

Machine Id
8043988 (S/N 1665)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- QTS)

DIAGNOSIS

Recommendation
 No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear
 All component wear rates are normal.

Contamination
 There is a high amount of particulates present in the oil.

Fluid Condition
 The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KC100813	KC101919	KC106172
Sample Date	Client Info	23 Aug 2023	09 Mar 2023	27 Oct 2022
Machine Age	hrs	4885	3884	3151
Oil Age	hrs	1230	200	1700
Oil Changed	Client Info	Changed	Not Changd	Not Changd
Sample Status		ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS

method	limit/base	current	history1	history2	
Iron	ppm	ASTM D5185m >50	<1	<1	4
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m >3	<1	0	0
Titanium	ppm	ASTM D5185m >3	0	0	0
Silver	ppm	ASTM D5185m >2	0	0	0
Aluminum	ppm	ASTM D5185m >10	0	<1	0
Lead	ppm	ASTM D5185m >10	<1	0	<1
Copper	ppm	ASTM D5185m >50	6	2	11
Tin	ppm	ASTM D5185m >10	10	3	▲ 11
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

method	limit/base	current	history1	history2	
Boron	ppm	ASTM D5185m	0	0	0
Barium	ppm	ASTM D5185m 90	26	83	17
Molybdenum	ppm	ASTM D5185m	0	0	0
Manganese	ppm	ASTM D5185m	0	<1	<1
Magnesium	ppm	ASTM D5185m 90	60	86	50
Calcium	ppm	ASTM D5185m 2	<1	3	0
Phosphorus	ppm	ASTM D5185m	3	2	9
Zinc	ppm	ASTM D5185m	12	2	18

CONTAMINANTS

method	limit/base	current	history1	history2	
Silicon	ppm	ASTM D5185m >25	<1	1	2
Sodium	ppm	ASTM D5185m	13	10	7
Potassium	ppm	ASTM D5185m >20	3	<1	2
Water	%	ASTM D6304 >0.05	0.028	0.013	0.020
ppm Water	ppm	ASTM D6304 >500	282.0	139.5	207.2

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	21967	19943	5730
Particles >6µm	ASTM D7647 >1300	▲ 7759	▲ 5565	▲ 2052
Particles >14µm	ASTM D7647 >80	▲ 842	▲ 527	▲ 230
Particles >21µm	ASTM D7647 >20	▲ 232	▲ 185	▲ 43
Particles >38µm	ASTM D7647 >4	▲ 6	▲ 16	3
Particles >71µm	ASTM D7647 >3	0	1	0
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 22/20/17	▲ 21/20/16	▲ 20/18/15

FLUID DEGRADATION

method	limit/base	current	history1	history2	
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.32	0.42	0.36


OIL ANALYSIS REPORT

▲ Particle Trend

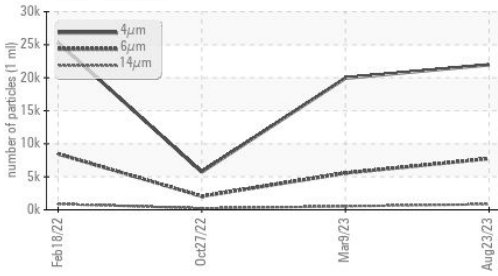

VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	LIGHT	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG


Water

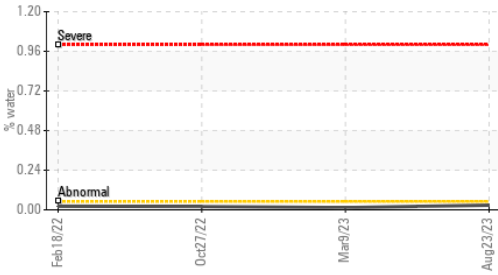

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.1	43.4


SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color

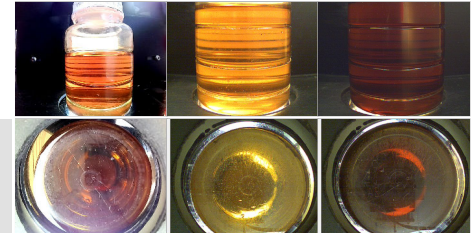


Bottom

Acid Number

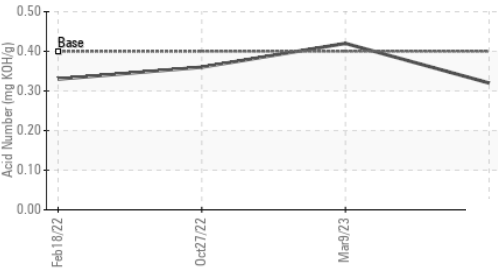


GRAPHS


Ferrous Alloys

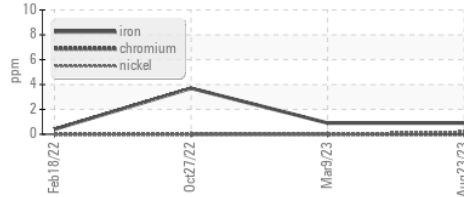


Non-ferrous Metals

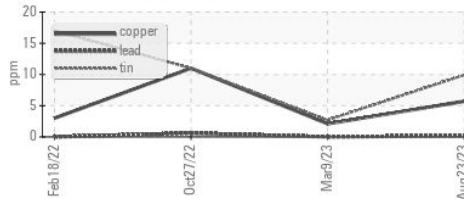


Viscosity @ 40°C

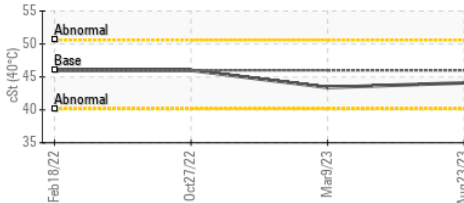

▲ Particle Count

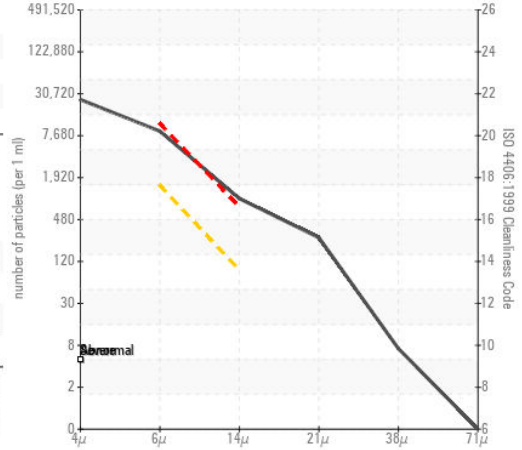

Acid Number

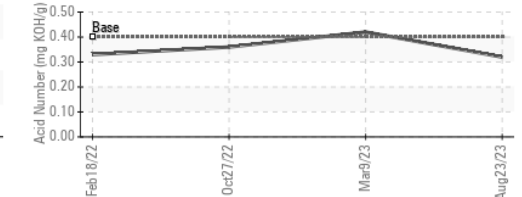

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : KC100813
 Lab Number : 05936138
 Unique Number : 10621409
 Test Package : IND 2

TRI-STATE BUILDING MATERIALS
 65 LODI ST
 LODI, NJ
 US 07644
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: