


PROBLEM SUMMARY

Sample Rating Trend




F00511 - HSC 2-4 (S/N 3380)

Refrigeration Compressor

VILTER 717 COMPRESSOR OIL ISO 68 (--- GAL)

COMPONENT CONDITION SUMMARY

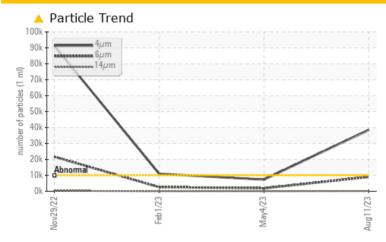

RECOMMENDATION

No corrective action is recommended at this time. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status			ABNORMAL	ATTENTION	ABNORMAL				
Particles >4µm	ASTM D7647	>10000	A 38530	7338	<u>▲</u> 10948				
Particles >6µm	ASTM D7647	>1300	<u> </u>	<u> </u>	<u>\$\text{2583}\$</u>				
Oil Cleanliness	ISO 4406 (c)	>20/17/14	A 22/20/14	A 20/18/12	A 21/19/13				

Customer Id: HORFREWC Sample No.: WC0826178 Lab Number: 05936172 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

04 May 2023 Diag: Doug Bogart

ISO



Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



01 Feb 2023 Diag: Don Baldridge

150



No corrective action is recommended at this time. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.



29 Nov 2022 Diag: Jonathan Hester

ISO




We recommend you service the filters on this component. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





OIL ANALYSIS REPORT



F00511 - HSC 2-4 (S/N 3380)

Refrigeration Compressor

VILTER 717 COMPRESSOR OIL ISO 68 (---

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

There is a high amount of silt (particulates < 14 microns in size) present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

GAL)		Nov202	2 Feb 2023	May2023 Au	ugŽ023	
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		WC0826178	WC0774945	WC0774941
Sample Date		Client Info		11 Aug 2023	04 May 2023	01 Feb 2023
Machine Age	hrs	Client Info		4372	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				ABNORMAL	ATTENTION	ABNORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>8	1	2	2
Chromium	ppm	ASTM D5185m	>2	0	0	0
Nickel	ppm	ASTM D5185m		<1	0	0
Titanium	ppm	ASTM D5185m		0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>3	0	0	0
Lead	ppm	ASTM D5185m	>2	0	0	0
Copper	ppm	ASTM D5185m	>8	0	0	0
Tin	ppm	ASTM D5185m	>4	0	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	0
Barium	ppm	ASTM D5185m	0	1	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		0	0	0
Magnesium	ppm	ASTM D5185m	0	<1	0	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	<1	0	3
Zinc	ppm	ASTM D5185m	0	0	0	0
Sulfur	ppm	ASTM D5185m		0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	0	<1	<1
Sodium	ppm	ASTM D5185m		0	0	0
Potassium	ppm	ASTM D5185m	>20	<1	1	<1
Water	%	ASTM D6304	>0.01	0.002	0.002	0.005
ppm Water	ppm	ASTM D6304	>100	15.4	20.8	53.1
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	▲ 38530	7338	△ 10948
Particles >6µm		ASTM D7647	>1300	<u> </u>	<u>▲</u> 1886	<u>▲</u> 2583
Particles >14μm		ASTM D7647	>160	128	37	44
Particles >21µm		ASTM D7647	>40	17	2	5
Particles >38µm		ASTM D7647	>10	0	0	0
Particles >71µm		ASTM D7647	>3	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/17/14	<u>22/20/14</u>	<u>△</u> 20/18/12	<u>^</u> 21/19/13
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D974	0.2	0.014	0.015	0.014



OIL ANALYSIS REPORT

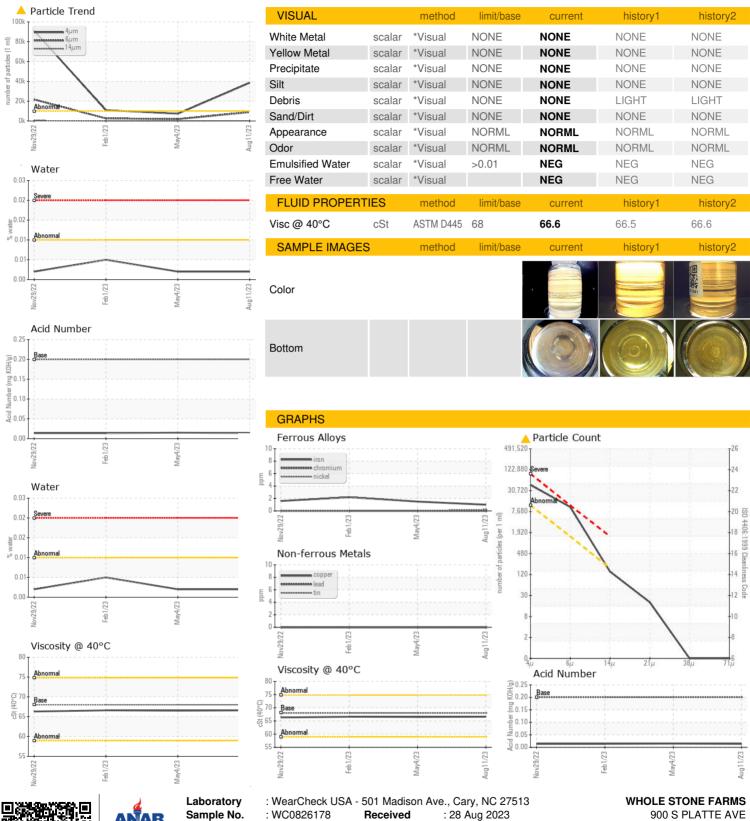



Sample No. Lab Number **Unique Number**

: WC0826178 : 05936172

: 10621443

Received Diagnosed Diagnostician

: 29 Aug 2023 : Doug Bogart

Test Package : IND 2 (Additional Tests: PrtCount) Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

900 S PLATTE AVE FREMONT, NE US 68025

Contact: JERRY SORRICK jasorrick@wholestonefarms.com

T: (402)753-3434 F: x:

Report Id: HORFREWC [WUSCAR] 05936172 (Generated: 08/29/2023 09:49:58) Rev: 1

Contact/Location: JERRY SORRICK - HORFREWC