




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

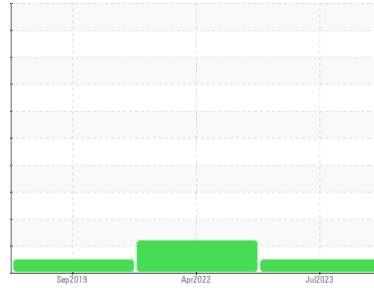

Area  
**HODGE SYN**  
 Machine Id  
**INGERSOLL RAND NV8288U08135**  
 Component  
**Compressor**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>UCH05936240</b>	UCH05624613	UCH04808827
Sample Date	Client Info			<b>20 Jul 2023</b>	22 Apr 2022	23 Sep 2019
Machine Age	hrs	Client Info		<b>12941</b>	11459	7958
Oil Age	hrs	Client Info		<b>0</b>	0	7958
Oil Changed	Client Info			<b>N/A</b>	Not Changd	Changed
Sample Status				<b>NORMAL</b>	SEVERE	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	3	<1
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m		<b>0</b>	0	<1
Titanium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Silver	ppm	ASTM D5185m		<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m	>25	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>&lt;1</b>	0	<1
Tin	ppm	ASTM D5185m	>15	<b>&lt;1</b>	<1	0
Antimony	ppm	ASTM D5185m		<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m		<b>&lt;1</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		<b>0</b>	0	0
Barium	ppm	ASTM D5185m		<b>0</b>	0	187
Molybdenum	ppm	ASTM D5185m		<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	0	<1
Magnesium	ppm	ASTM D5185m		<b>&lt;1</b>	0	3
Calcium	ppm	ASTM D5185m		<b>0</b>	0	8
Phosphorus	ppm	ASTM D5185m		<b>316</b>	282	113
Zinc	ppm	ASTM D5185m		<b>32</b>	24	33
Sulfur	ppm	ASTM D5185m		<b>411</b>	299	28



CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>&lt;1</b>	<1	2
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	1
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	<1	0

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045		<b>0.69</b>	0.65	0.249

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG	0.2%
Free Water	scalar	*Visual		<b>NEG</b>	NEG	0.0%




# OIL ANALYSIS REPORT



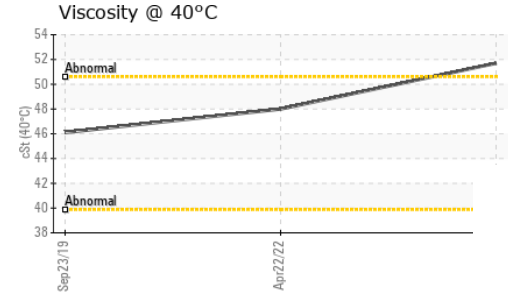
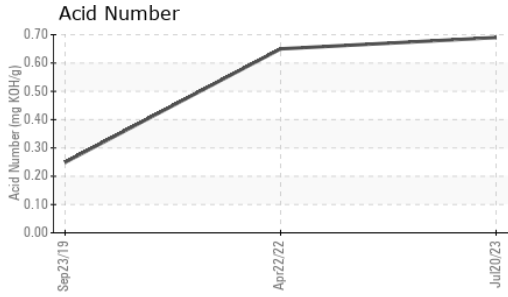


FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	<b>51.7</b>	48.0	46.1

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

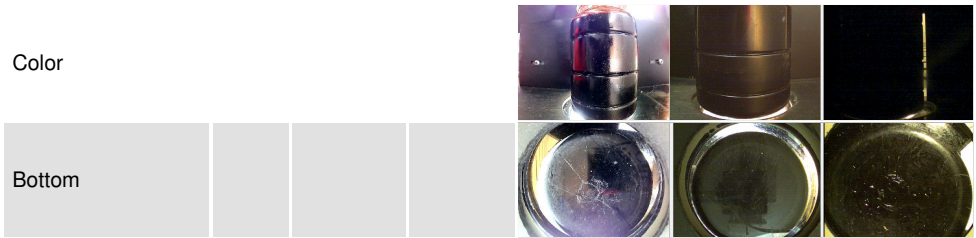

## GRAPHS

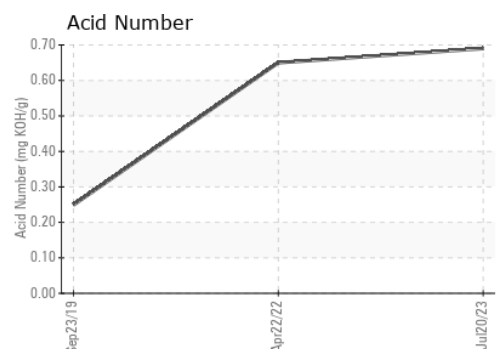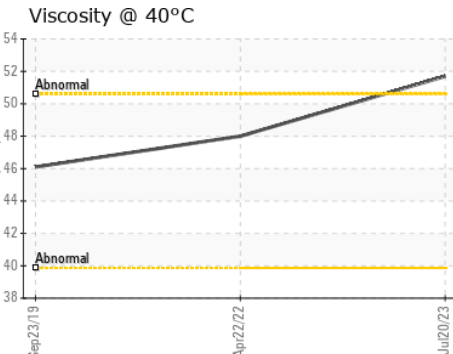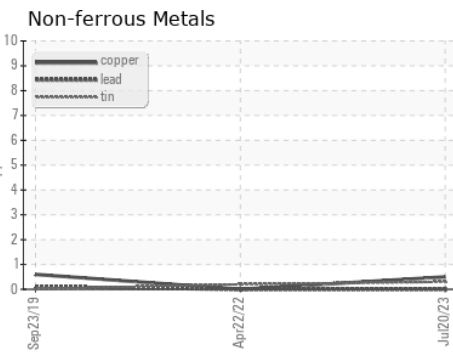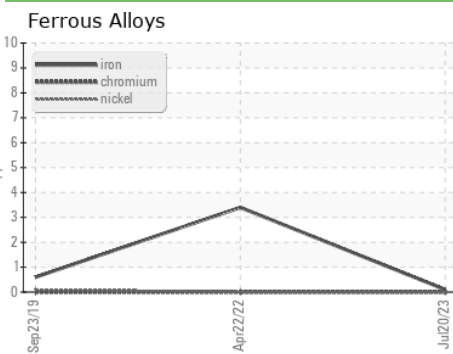

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : UCH05936240 **Received** : 28 Aug 2023  
**Lab Number** : **05936240** **Diagnosed** : 29 Aug 2023  
**Unique Number** : 10621511 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2

**CHARLOTTE COMPRESSOR**  
 338 S SHARON AMITY RD #201  
 CHARLOTTE, NC  
 US 28211  
 Contact: Service  
 service@atlantaaircompressor.com  
 T: (704)399-9993  
 F:

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)