




PROBLEM SUMMARY


Sample Rating Trend

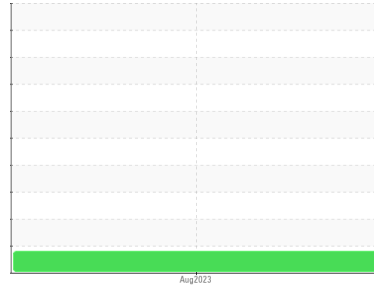

Machine Id
KAESER AS 25 8774588 (S/N 1731)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

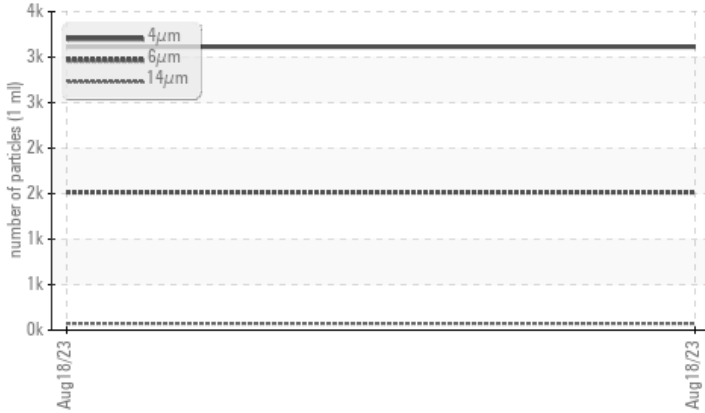

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	---	---
Particles >6µm	ASTM D7647	>1300	▲ 1515	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 19/18/13	---	---

Customer Id: LONAUS
 Sample No.: KCP48005D
 Lab Number: 05936681
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com


RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS

OIL ANALYSIS REPORT

Sample Rating Trend

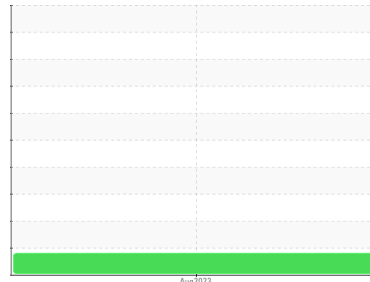

ISO



Machine Id
KAESER AS 25 8774588 (S/N 1731)

Component
Compressor

Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

▲ Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCP48005D	---	---
Sample Date	Client Info	18 Aug 2023	---	---
Machine Age	hrs Client Info	1057	---	---
Oil Age	hrs Client Info	1057	---	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ATTENTION	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<1	---	---
Chromium ppm ASTM D5185m	>10	0	---	---
Nickel ppm ASTM D5185m	>3	0	---	---
Titanium ppm ASTM D5185m	>3	0	---	---
Silver ppm ASTM D5185m	>2	0	---	---
Aluminum ppm ASTM D5185m	>10	<1	---	---
Lead ppm ASTM D5185m	>10	0	---	---
Copper ppm ASTM D5185m	>50	2	---	---
Tin ppm ASTM D5185m	>10	0	---	---
Vanadium ppm ASTM D5185m		0	---	---
Cadmium ppm ASTM D5185m		0	---	---

ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m	0	0	---	---
Barium ppm ASTM D5185m	90	69	---	---
Molybdenum ppm ASTM D5185m	0	0	---	---
Manganese ppm ASTM D5185m		<1	---	---
Magnesium ppm ASTM D5185m	100	88	---	---
Calcium ppm ASTM D5185m	0	3	---	---
Phosphorus ppm ASTM D5185m	0	2	---	---
Zinc ppm ASTM D5185m	0	0	---	---
Sulfur ppm ASTM D5185m	23500	22253	---	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<1	---	---
Sodium ppm ASTM D5185m		14	---	---
Potassium ppm ASTM D5185m	>20	6	---	---
Water % ASTM D6304	>0.05	0.022	---	---
ppm Water ppm ASTM D6304	>500	221.3	---	---






FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		3114	---	---
Particles >6µm ASTM D7647	>1300	▲ 1515	---	---
Particles >14µm ASTM D7647	>80	73	---	---
Particles >21µm ASTM D7647	>20	7	---	---
Particles >38µm ASTM D7647	>4	0	---	---
Particles >71µm ASTM D7647	>3	0	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	▲ 19/18/13	---	---

FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	1.0	0.33	---	---


OIL ANALYSIS REPORT

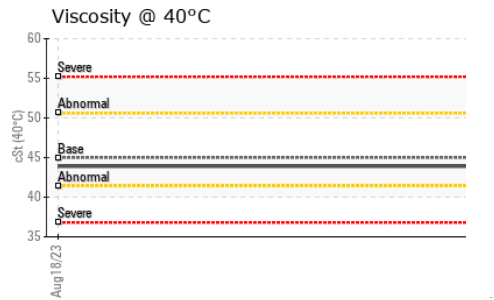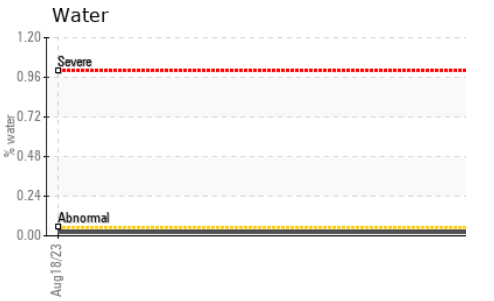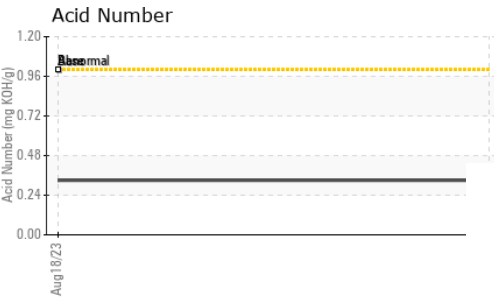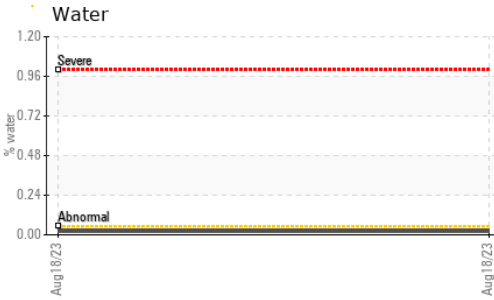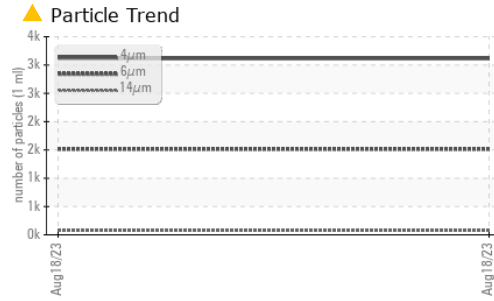





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	43.9	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

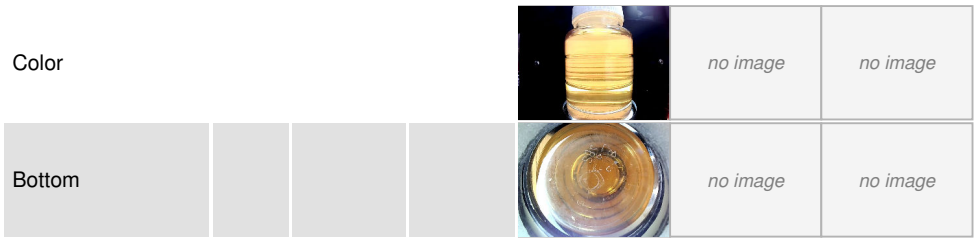

GRAPHS

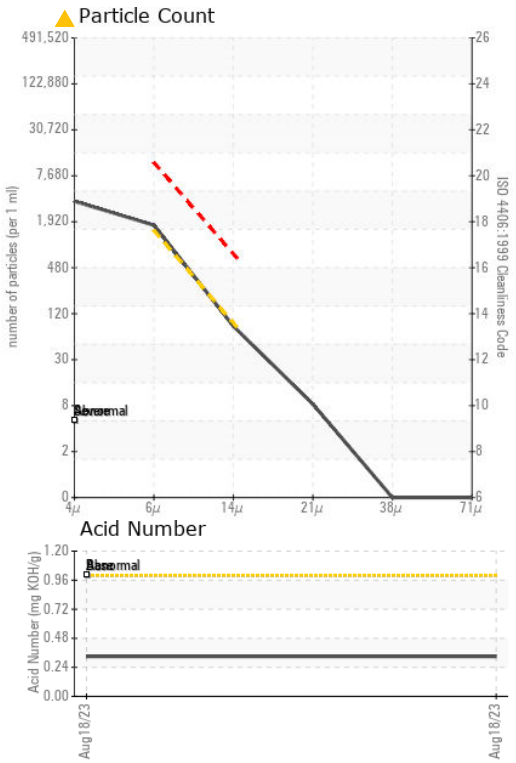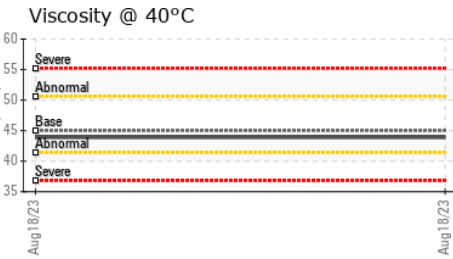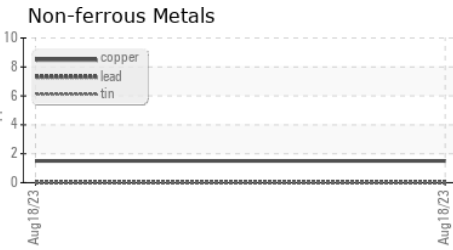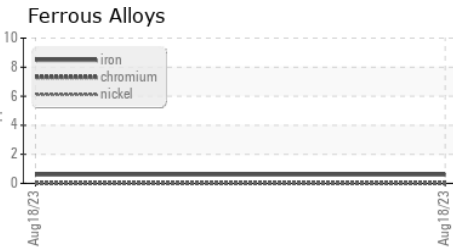

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCP48005D **Received** : 28 Aug 2023
Lab Number : 05936681 **Diagnosed** : 29 Aug 2023
Unique Number : 10621952 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

LONE STAR FOODS
 5202 E BEN WHITE BLVD
 AUSTIN, TX
 US 78741
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: