


## **PROBLEM SUMMARY**

### PLASTIFAR Machine Id KAESER DSD 200 7921276 (S/N 1139)

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

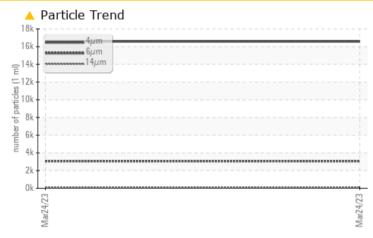

#### RECOMMENDATION

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS						
Sample Status			ABNORMAL			
Particles >6µm	ASTM D7647	>1300	<b>A</b> 3067			
Particles >14µm	ASTM D7647	>80	<mark>人</mark> 95			
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>			


Customer Id: SOLINDEN Sample No.: KCP47735D Lab Number: 05936682 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Angela Borella +1 800-237-1369 angela.borella@wearcheckusa.com

*To change component or sample information:* Customer Service +1 1-800-237-1369 <u>customerservice@wearcheck.com</u>

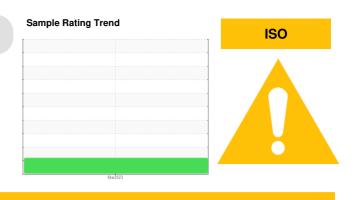

RECOMMENDED ACTIONS						
Action	Status	Date	Done By	Description		
Change Fluid			?	Oil and filter change at the time of sampling has been noted.		
Change Filter			?	Oil and filter change at the time of sampling has been noted.		

HISTORICAL DIAGNOSIS



### **OIL ANALYSIS REPORT**

Sample Number

hrs

hrs

ppm

ppm

Sample Date

Machine Age

Oil Changed

Sample Status

WEAR METALS

Oil Age

Iron

Nickel

Silver

Lead

Tin

Copper

Vanadium

Cadmium

Titanium

Aluminum

Chromium

PLASTIFAR KAESER DSD 200 7921276 (S/N 1139) Component

Compressor

KAESER SIGMA (OEM) M-460 (--- GAL)

#### DIAGNOSIS

#### Recommendation

Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

#### Wear


All component wear rates are normal.

#### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

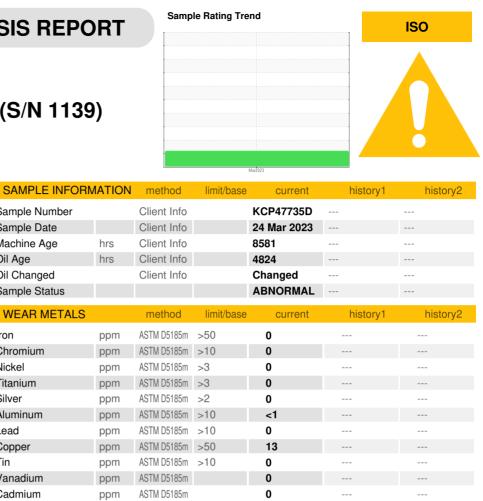

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m	0	0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	100	2		
Calcium	ppm	ASTM D5185m	0	0		
Phosphorus	ppm	ASTM D5185m	0	1		
Zinc	ppm	ASTM D5185m	0	0		
Sulfur	ppm	ASTM D5185m	23500	22668		

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.05	0.009		
ppm Water	ppm	ASTM D6304	>500	98.9		


FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		16577		
Particles >6µm	ASTM D7647	>1300	<b>A</b> 3067		
Particles >14µm	ASTM D7647	>80	<mark>人</mark> 95		
Particles >21µm	ASTM D7647	>20	20		
Particles >38µm	ASTM D7647	>4	0		
Particles >71µm	ASTM D7647	>3	0		
Oil Cleanliness	ISO 4406 (c)	>/17/13	<b>a</b> 21/19/14		
FLUID DEGRADATION	method	limit/base	current	history1	history2


Acid Number (AN)

mg KOH/g ASTM D8045 1.0



# **OIL ANALYSIS REPORT**

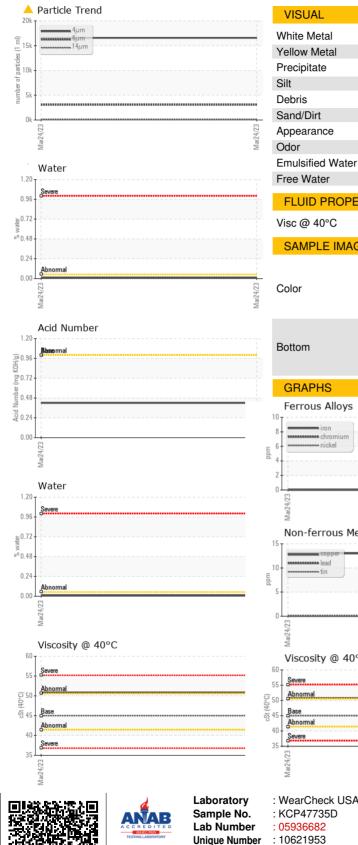

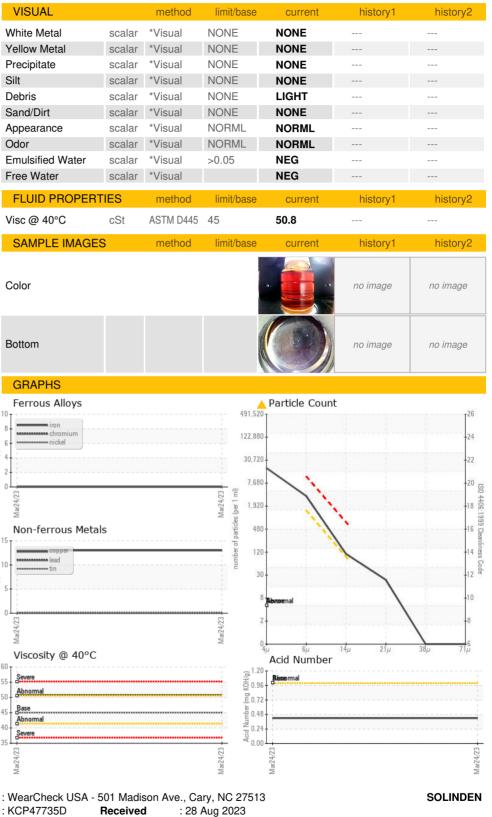

: 29 Aug 2023

Diagnostician : Angela Borella

Diagnosed

Test Package : IND 2 (Additional Tests: KF, PrtCount)

SANTO DOMINGO, ZZ DO Contact: ALEXANDER ACOSTA alexandera@solinden.com T: 012) F:

Certificate L2367