

OIL ANALYSIS REPORT

Sample Rating Trend

NORMAL

PLASTIFAR Machine Id KAESER DSD 200 7041208 (S/N 1101)

Component Compressor

KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable.

Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.


		-		Jan2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC56930		
Sample Date		Client Info		05 Jan 2023		
Machine Age	hrs	Client Info		9683		
Oil Age	hrs	Client Info		4428		
Oil Changed		Client Info		Not Changd		
Sample Status				NORMAL		
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1		
Chromium	ppm	ASTM D5185m	>10	0		
Nickel	ppm	ASTM D5185m	>3	0		
Titanium	ppm	ASTM D5185m	>3	0		
Silver	ppm	ASTM D5185m	>2	0		
Aluminum	ppm	ASTM D5185m	>10	4		
Lead	ppm	ASTM D5185m	>10	0		
Copper	ppm	ASTM D5185m	>50	14		
Tin	ppm	ASTM D5185m	>10	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m	90	0		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m	90	7		
Calcium	ppm	ASTM D5185m	2	0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
CONTAMINANTS	\$	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	2		
Sodium	ppm	ASTM D5185m		5		
Potassium	ppm	ASTM D5185m	>20	2		
Water	%	ASTM D6304	>0.05	0.012		
ppm Water	ppm	ASTM D6304	>500	122.6		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		4497		
Particles >6µm		ASTM D7647	>1300	1169		
Particles >14µm		ASTM D7647	>80	72		
Particles >21µm		ASTM D7647	>20	24		
Particles >38µm		ASTM D7647	>4	1		
Particles >71µm		ASTM D7647	>3	0		
Oil Cleanliness		ISO 4406 (c)	>/17/13	19/17/13		
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.35		




OIL ANALYSIS REPORT





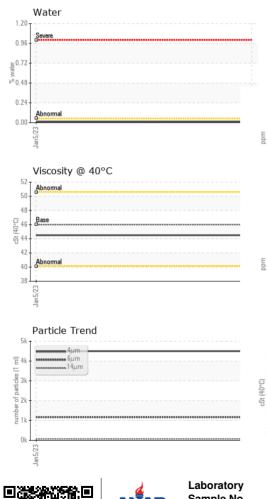

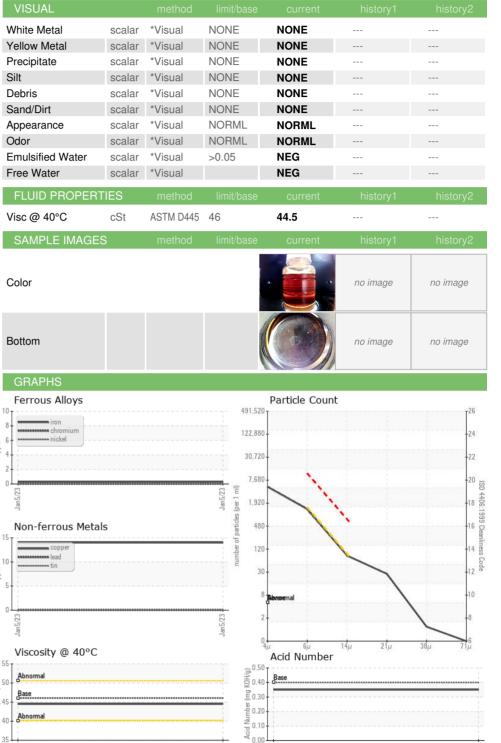

lan5/23 an5/73 SOLINDEN : WearCheck USA - 501 Madison Ave., Cary, NC 27513 Sample No. : 28 Aug 2023 : KC56930 Received Lab Number : 05936684 SANTO DOMINGO, ZZ Diagnosed : 29 Aug 2023 : Angela Borella Unique Number : 10621955 Diagnostician DO Test Package : IND 2 Contact: ALEXANDER ACOSTA Certificate L2367 To discuss this sample report, contact Customer Service at 1-800-237-1369. alexandera@solinden.com T: * - Denotes test methods that are outside of the ISO 17025 scope of accreditation. F:

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)