




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

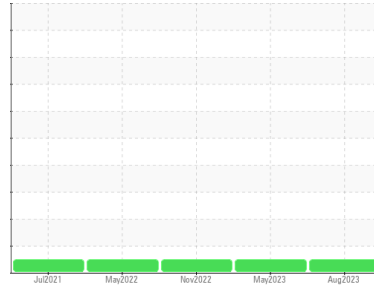

Machine Id  
**6072598 (S/N 1065)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) M-460 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			<b>KCPA004269</b>	KCP52369	KCP47117D
Sample Date	Client Info			<b>18 Aug 2023</b>	10 May 2023	07 Nov 2022
Machine Age	hrs	Client Info		<b>48297</b>	45905	41491
Oil Age	hrs	Client Info		<b>0</b>	0	3000
Oil Changed	Client Info			<b>N/A</b>	Changed	Changed
Sample Status				<b>NORMAL</b>	NORMAL	NORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<b>&lt;1</b>	1	2
Chromium	ppm	ASTM D5185m	>10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m	>3	<b>0</b>	<1	<1
Titanium	ppm	ASTM D5185m	>3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m	>2	<b>0</b>	0	0
Aluminum	ppm	ASTM D5185m	>10	<b>1</b>	2	2
Lead	ppm	ASTM D5185m	>10	<b>0</b>	0	<1
Copper	ppm	ASTM D5185m	>50	<b>6</b>	7	5
Tin	ppm	ASTM D5185m	>10	<b>0</b>	<1	0
Vanadium	ppm	ASTM D5185m		<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m		<b>0</b>	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	<b>0</b>	0	0
Barium	ppm	ASTM D5185m	90	<b>0</b>	2	0
Molybdenum	ppm	ASTM D5185m	0	<b>0</b>	<1	0
Manganese	ppm	ASTM D5185m		<b>&lt;1</b>	<1	0
Magnesium	ppm	ASTM D5185m	100	<b>4</b>	4	2
Calcium	ppm	ASTM D5185m	0	<b>0</b>	0	<1
Phosphorus	ppm	ASTM D5185m	0	<b>2</b>	4	0
Zinc	ppm	ASTM D5185m	0	<b>94</b>	81	31
Sulfur	ppm	ASTM D5185m	23500	<b>22806</b>	23813	22532

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<b>0</b>	0	1
Sodium	ppm	ASTM D5185m		<b>1</b>	<1	2
Potassium	ppm	ASTM D5185m	>20	<b>0</b>	1	<1
Water	%	ASTM D6304	>0.05	<b>0.005</b>	0.008	0.008
ppm Water	ppm	ASTM D6304	>500	<b>56.7</b>	84.8	87.3

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		<b>2694</b>	2425	3304
Particles >6µm		ASTM D7647	>1300	<b>679</b>	622	903
Particles >14µm		ASTM D7647	>80	<b>42</b>	53	40
Particles >21µm		ASTM D7647	>20	<b>11</b>	15	8
Particles >38µm		ASTM D7647	>4	<b>0</b>	2	1
Particles >71µm		ASTM D7647	>3	<b>0</b>	0	0
Oil Cleanliness		ISO 4406 (c)	>--/17/13	<b>19/17/13</b>	18/16/13	19/17/12

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	<b>0.44</b>	0.53	0.46


# OIL ANALYSIS REPORT

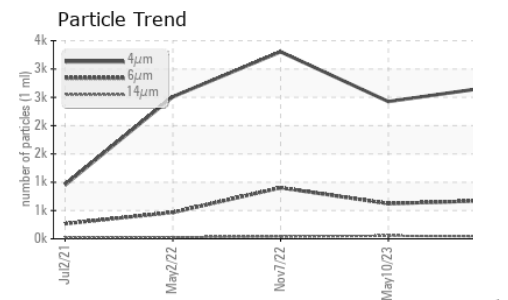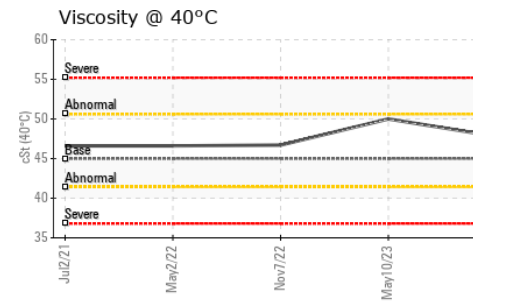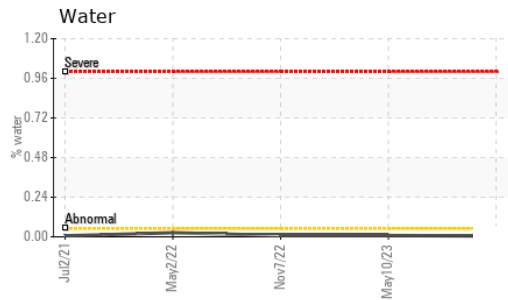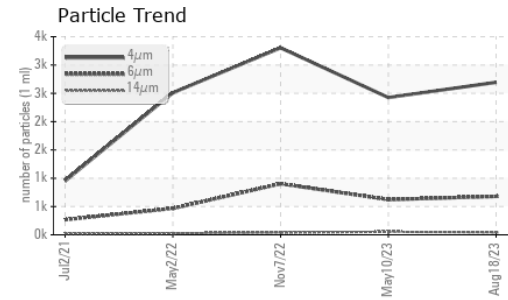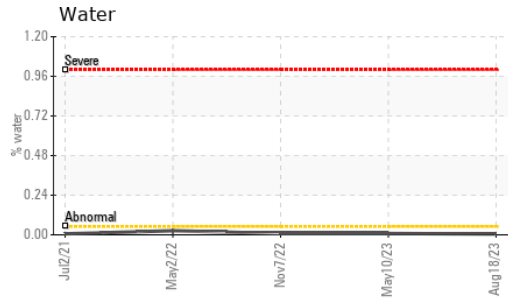






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	47.8	50.0

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

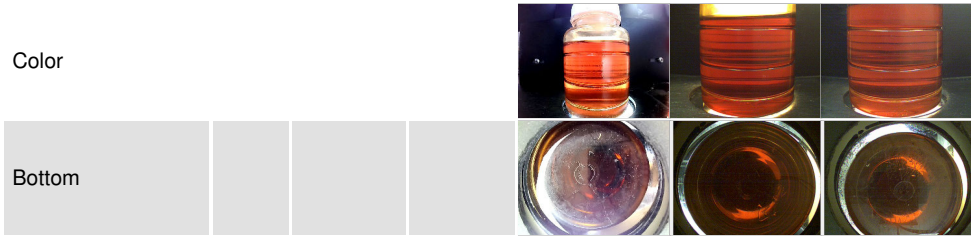

## GRAPHS

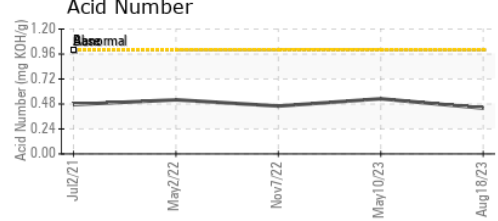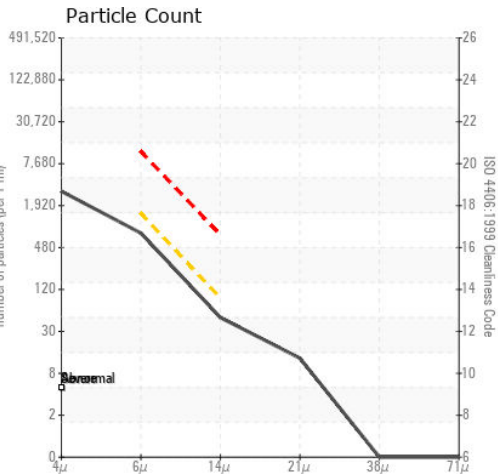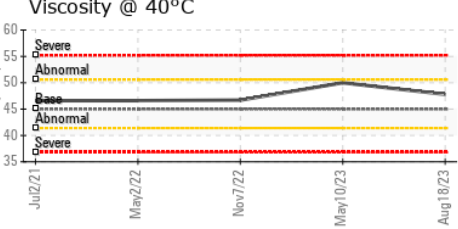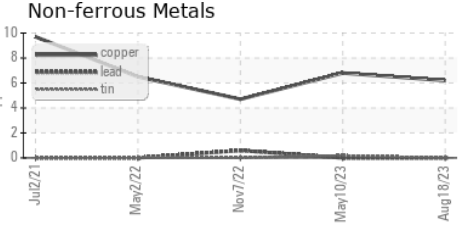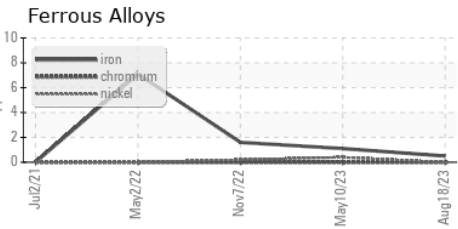

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA004269 **Received** : 28 Aug 2023  
**Lab Number** : 05936729 **Diagnosed** : 29 Aug 2023  
**Unique Number** : 10622000 **Diagnostician** : Angela Borella  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**BALL SCREWS & ACTUATORS**  
 48767 KATO RD  
 FREMONT, CA  
 US 94538  
 Contact: JOSEPH QUERRERO  
 joseph.querrero@thomsonlinear.com  
 T:  
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)