




PROBLEM SUMMARY


Sample Rating Trend

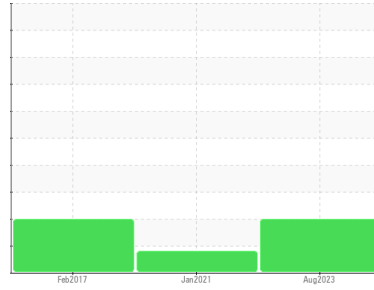

Machine Id
KAESER SM 11 1031371 (S/N 1006)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

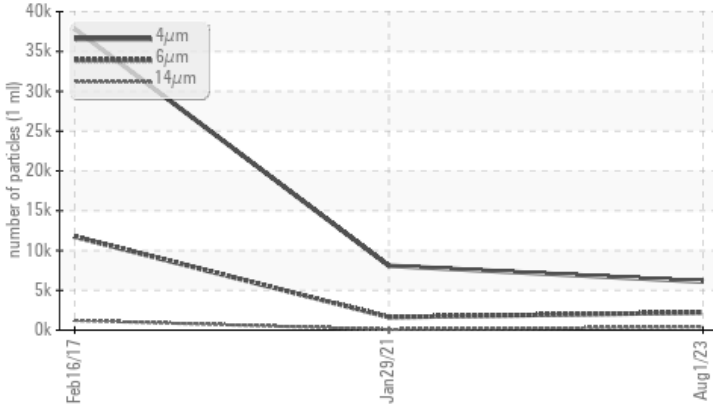

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status	ASTM D7647	Limit	ABNORMAL	ATTENTION	ABNORMAL
Particles >6µm	ASTM D7647	>1300	▲ 2218	▲ 1631	▲ 11743
Particles >14µm	ASTM D7647	>80	▲ 408	▲ 83	▲ 1212
Particles >21µm	ASTM D7647	>20	▲ 172	18	▲ 420
Particles >38µm	ASTM D7647	>4	▲ 15	0	▲ 25
Oil Cleanliness	ISO 4406 (c)	>17/13	▲ 18/16	▲ 18/14	▲ 21/17

Customer Id: PICWES
 Sample No.: KCPA005935
 Lab Number: 05936749
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Angela Borella +1 800-237-1369
angela.borella@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

29 Jan 2021 Diag: Angela Borella

ISO



Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a moderate amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



16 Feb 2017 Diag: Don Baldrige

ISO




No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report



Machine Id
KAESER SM 11 1031371 (S/N 1006)

Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- GAL)

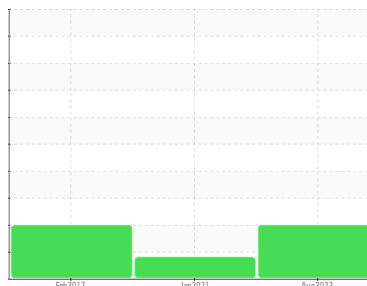

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			KCPA005935	KCP28036	KC43910
Sample Date	Client Info			01 Aug 2023	29 Jan 2021	16 Feb 2017
Machine Age	hrs	Client Info		34362	29903	21589
Oil Age	hrs	Client Info		0	0	0
Oil Changed	Client Info			N/A	Changed	Changed
Sample Status				ABNORMAL	ATTENTION	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	2	<1
Chromium	ppm	ASTM D5185m	>10	0	0	0
Nickel	ppm	ASTM D5185m	>3	0	0	0
Titanium	ppm	ASTM D5185m	>3	0	0	0
Silver	ppm	ASTM D5185m	>2	0	0	0
Aluminum	ppm	ASTM D5185m	>10	<1	<1	0
Lead	ppm	ASTM D5185m	>10	0	0	<1
Copper	ppm	ASTM D5185m	>50	24	7	21
Tin	ppm	ASTM D5185m	>10	0	0	0
Antimony	ppm	ASTM D5185m		---	0	0
Vanadium	ppm	ASTM D5185m		0	0	0
Cadmium	ppm	ASTM D5185m		0	0	0






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	10	<1
Barium	ppm	ASTM D5185m	90	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	<1	0
Magnesium	ppm	ASTM D5185m	100	<1	40	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	5	4	44
Zinc	ppm	ASTM D5185m	0	4	33	7
Sulfur	ppm	ASTM D5185m	23500	21810	15855	19245

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	0	<1
Sodium	ppm	ASTM D5185m		<1	10	0
Potassium	ppm	ASTM D5185m	>20	0	0	2
Water	%	ASTM D6304	>0.05	0.008	0.020	0.005
ppm Water	ppm	ASTM D6304	>500	82.7	202.9	50

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		6098	8085	37838
Particles >6µm		ASTM D7647	>1300	▲ 2218	▲ 1631	▲ 11743
Particles >14µm		ASTM D7647	>80	▲ 408	▲ 83	▲ 1212
Particles >21µm		ASTM D7647	>20	▲ 172	18	▲ 420
Particles >38µm		ASTM D7647	>4	▲ 15	0	▲ 25
Particles >71µm		ASTM D7647	>3	1	0	1
Oil Cleanliness		ISO 4406 (c)	>17/13	▲ 18/16	▲ 18/14	▲ 21/17

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.41	0.358	0.290

OIL ANALYSIS REPORT

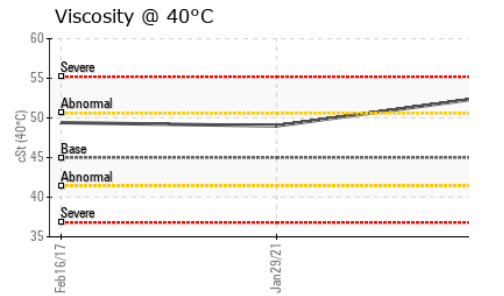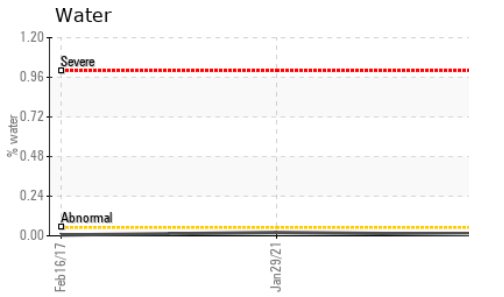
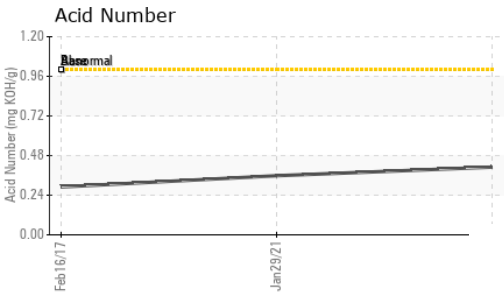
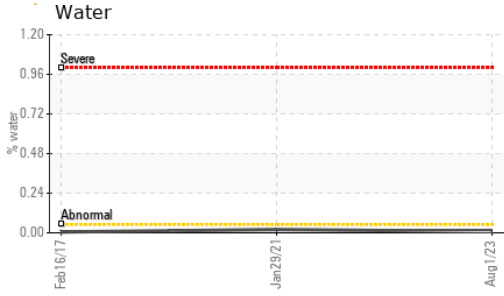
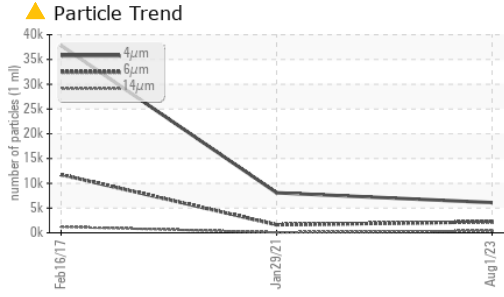


PARAMETER	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	VLITE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445 45	52.7	49.0	49.41

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

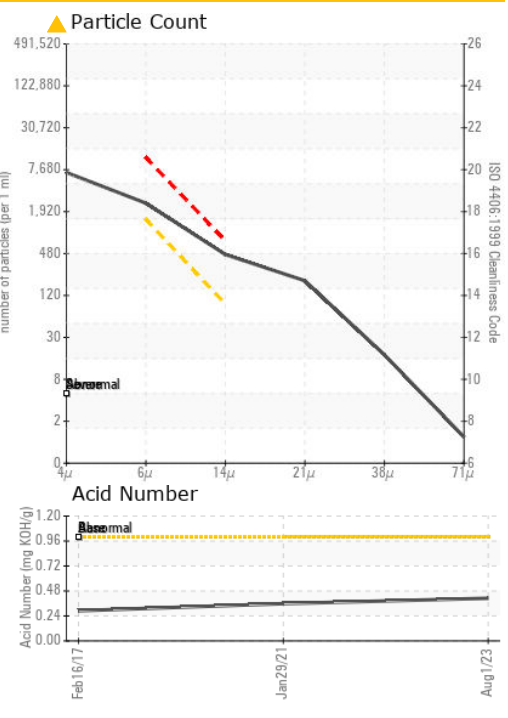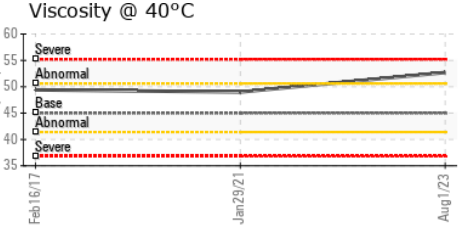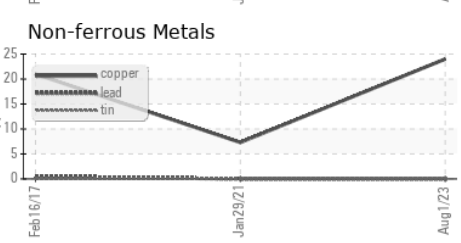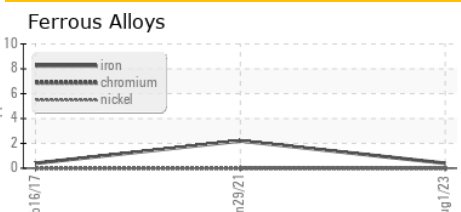

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA005935 **Received** : 28 Aug 2023
Lab Number : 05936749 **Diagnosed** : 29 Aug 2023
Unique Number : 10622020 **Diagnostician** : Angela Borella
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PICK HEATERS
 730 S INDIANA AVE
 WEST BEND, WI
 US 53095
 Contact:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: