

PROBLEM SUMMARY

Sample Rating Trend

WATER






Air Compressor

NOT GIVEN (--- GAL)

COMPONENT CONDITION SUMMARY

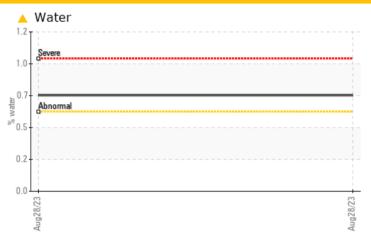



RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS									
Sample Status				ABNORMAL					
Water	%	ASTM D6304	>0.6	△ 0.723					
ppm Water	ppm	ASTM D6304	>6000	7234.2					
Particles >4µm		ASTM D7647	>10000	23794					
Particles >6µm		ASTM D7647	>2500	10587					
Particles >14μm		ASTM D7647	>320	1910					
Particles >21μm		ASTM D7647	>80	459					
Oil Cleanliness		ISO 4406 (c)	>20/18/15	22/21/18					

Customer Id: CARALBNEW Sample No.: USPM29418 Lab Number: 05936761 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Doug Bogart +1 (800)237-1369 x4016 dougb@wearcheckusa.com


To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED ACTIONS							
Action	Status	Date	Done By	Description			
Change Filter			?	We recommend you service the filters on this component.			

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT





NOT GIVEN (--- GAL)

DIAGNOSIS

Machine Id **40HP** Component

Recommendation

Air Compressor

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil. There is a moderate concentration of water present in the oil.


Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

		†				
				Aug2023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM29418		
Sample Date		Client Info		28 Aug 2023		
Machine Age	hrs	Client Info		62210		
Oil Age	hrs	Client Info		0		
Oil Changed		Client Info		N/A		
Sample Status				ABNORMAL		
WEAR METALS		method	limit/base	current	history1	history2
	10.10.100					
Iron Chromium	ppm	ASTM D5185m ASTM D5185m	>50 >4	0		
Nickel		ASTM D5185m	>4	0		
Titanium	ppm	ASTM D5185m	>4	0		
Silver	ppm	ASTM D5185m		0		
	ppm		. 10			
Aluminum	ppm	ASTM D5185m		<1		
Lead	ppm	ASTM D5185m	>20	0		
Copper	ppm	ASTM D5185m		<1		
Tin	ppm	ASTM D5185m	>5	0		
Vanadium	ppm	ASTM D5185m		0		
Cadmium	ppm	ASTM D5185m		0		
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0		
Barium	ppm	ASTM D5185m		3		
Molybdenum	ppm	ASTM D5185m		0		
Manganese	ppm	ASTM D5185m		<1		
Magnesium	ppm	ASTM D5185m		0		
Calcium	ppm	ASTM D5185m		0		
Phosphorus	ppm	ASTM D5185m		<1		
Zinc	ppm	ASTM D5185m		0		
Sulfur	ppm	ASTM D5185m		7		
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1		
Sodium	ppm	ASTM D5185m		<1		
Potassium	ppm	ASTM D5185m	>20	0		
Water	%	ASTM D6304	>0.6	△ 0.723		
ppm Water	ppm	ASTM D6304	>6000	▲ 7234.2		
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	23794		
Particles >6µm		ASTM D7647	>2500	10587		
Particles >14µm		ASTM D7647	>320	1910		
Particles >21µm		ASTM D7647	>80	<u>▲</u> 459		
Particles >38µm		ASTM D7647	>20	12		
Particles >71µm		ASTM D7647	>4	1		
Oil Cleanliness		ISO 4406 (c)	>20/18/15	<u>^</u> 22/21/18		
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	- III III Dago	0.40		
AND MAINDER (AIN)	my NOTI/Y	70 LINI D0043		0.70	=	· -



OIL ANALYSIS REPORT

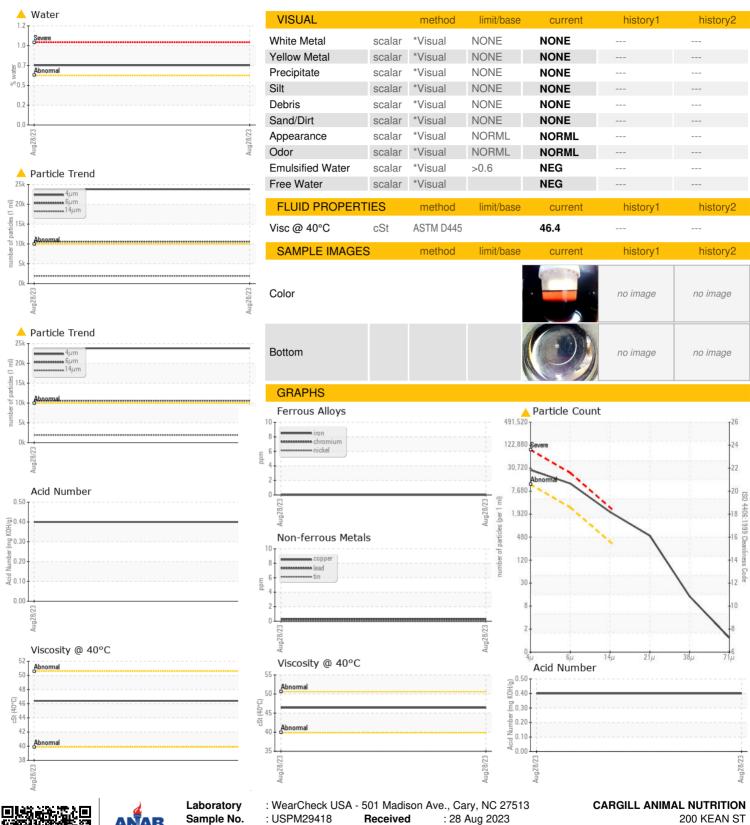



Certificate L2367

Sample No. Lab Number Unique Number Test Package

: USPM29418 : 05936761

Received Diagnosed

: 10622032 Diagnostician : IND 2

200 KEAN ST ALBANY, NY US 12202

Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

: 29 Aug 2023

: Doug Bogart

T: F: