




PROBLEM SUMMARY


Sample Rating Trend

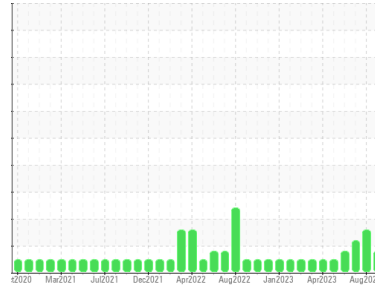

Machine Id
C-39
 Component
Screw Compressor
 Fluid
INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

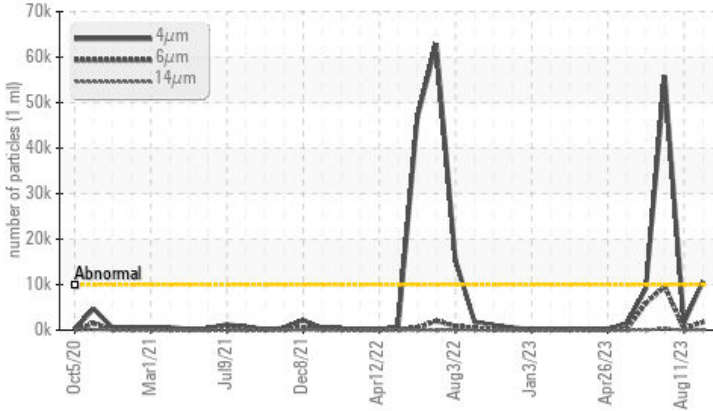

RECOMMENDATION

No corrective action is recommended at this time.
 Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647 >10000	▲ 10748	1542	▲ 55747
Oil Cleanliness	ISO 4406 (c) >20/18/15	▲ 21/18/14	18/15/12	▲ 23/20/15

Customer Id: UGIMESWC
 Sample No.: WC0820241
 Lab Number: 05937234
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

11 Aug 2023 Diag: Doug Bogart

WATER



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a light concentration of water present in the oil. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 Jul 2023 Diag: Don Baldrige

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



03 Jul 2023 Diag: Jonathan Hester

ISO



No corrective action is recommended at this time. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

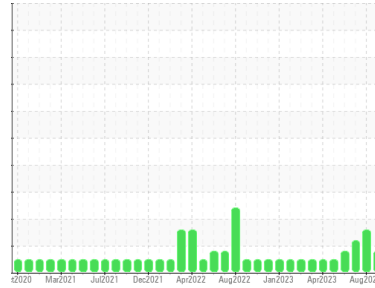

ISO



Machine Id

C-39

Component

Screw Compressor

Fluid

INGERSOLL-RAND SSR ULTRA COOLANT (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0820241	WC0820245	WC0820304
Sample Date	Client Info		23 Aug 2023	11 Aug 2023	19 Jul 2023
Machine Age	days	Client Info	0	0	0
Oil Age	days	Client Info	0	0	0
Oil Changed	Client Info		N/A	N/A	N/A
Sample Status			ATTENTION	ABNORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >60	0	<1	4
Chromium	ppm	ASTM D5185m >4	<1	0	0
Nickel	ppm	ASTM D5185m	0	0	<1
Titanium	ppm	ASTM D5185m	<1	<1	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >5	0	0	0
Lead	ppm	ASTM D5185m >10	<1	0	1
Copper	ppm	ASTM D5185m >30	<1	<1	<1
Tin	ppm	ASTM D5185m >15	<1	<1	0
Vanadium	ppm	ASTM D5185m	<1	<1	0
Cadmium	ppm	ASTM D5185m	<1	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	0	0	0
Barium	ppm	ASTM D5185m 500	850	801	397
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	<1	0	0
Magnesium	ppm	ASTM D5185m 0	6	<1	<1
Calcium	ppm	ASTM D5185m 0	0	0	<1
Phosphorus	ppm	ASTM D5185m 20	4	44	169
Zinc	ppm	ASTM D5185m 0	13	0	1
Sulfur	ppm	ASTM D5185m 200	402	352	267

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	11	<1	2
Sodium	ppm	ASTM D5185m	9	1	<1
Potassium	ppm	ASTM D5185m >20	4	<1	0
Water	%	ASTM D6304 >0.1	0.00	▲ 0.189	0.091
ppm Water	ppm	ASTM D6304 >1000	0.00	▲ 1895.8	916.9






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 10748	1542	▲ 55747
Particles >6µm	ASTM D7647	>2500	1761	314	▲ 9517
Particles >14µm	ASTM D7647	>320	85	23	271
Particles >21µm	ASTM D7647	>80	21	5	52
Particles >38µm	ASTM D7647	>20	0	0	3
Particles >71µm	ASTM D7647	>4	0	0	2
Oil Cleanliness	ISO 4406 (c)	>20/18/15	▲ 21/18/14	18/15/12	▲ 23/20/15

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.077	0.079	0.22


OIL ANALYSIS REPORT

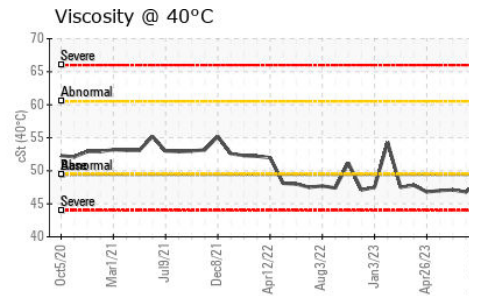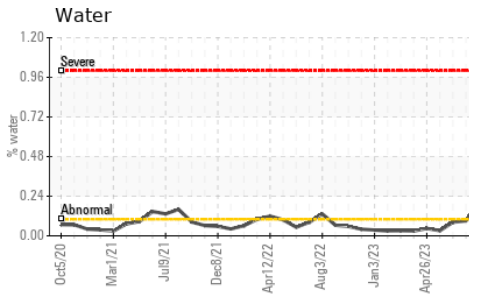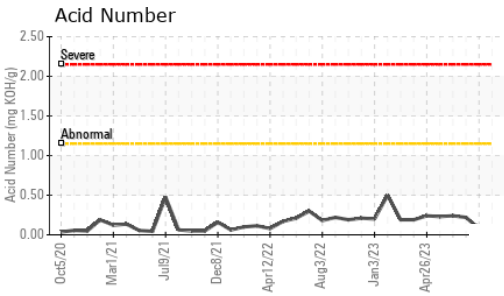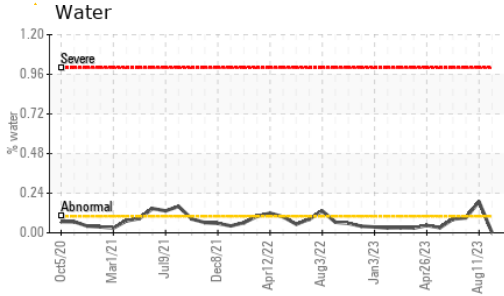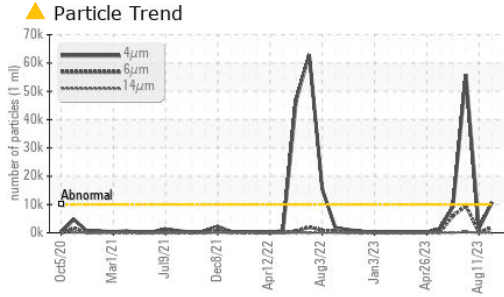






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.1	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	49.4	49.7	48.2

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

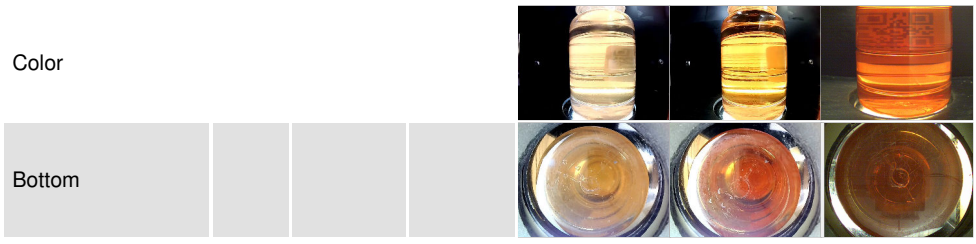

GRAPHS

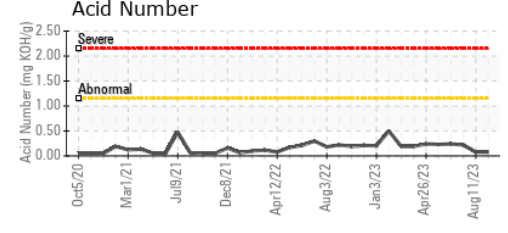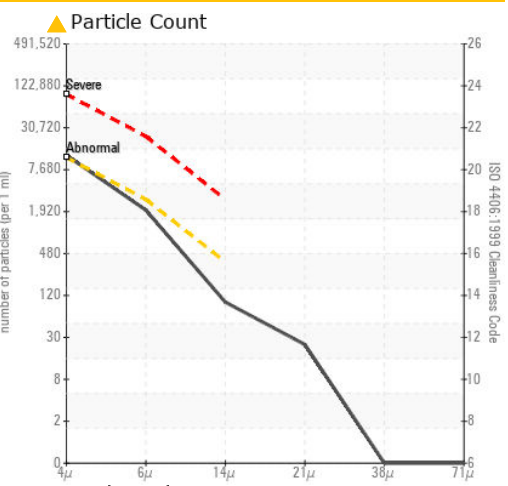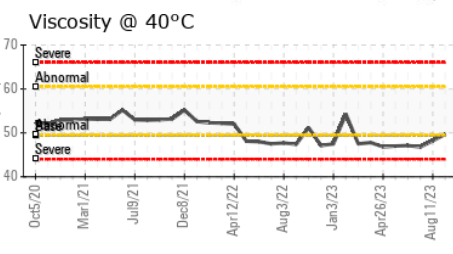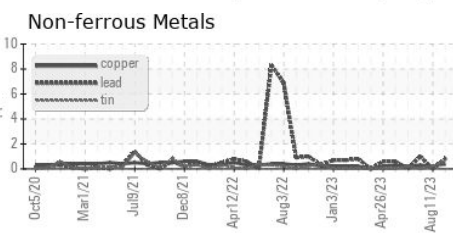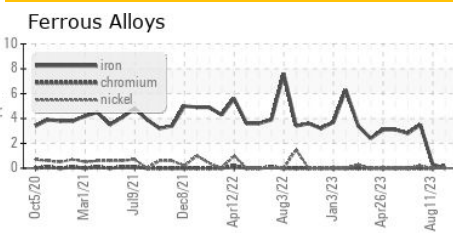

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0820241 **Received** : 29 Aug 2023
Lab Number : 05937234 **Diagnosed** : 30 Aug 2023
Unique Number : 10622505 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, PrtCount)

UGI ENERGY SERVICES - LNG FACILITY
 80 ENERGY LN
 MESHOPPEN, PA
 US 18630
 Contact: JOE BARRETT
 jbarrett@ugies.com
 T:
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)