


# **OIL ANALYSIS REPORT**

## Sample Rating Trend



**NORMAL** 



# SULLAIR 6 PRO (S/N 201306200074)

Component

Compressor

USPI FG AIR 46 (--- LTR)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

#### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

#2015 Feb2017 Smp2018 Ju2019 Mm2020 Mm2021 Feb2022 Feb2023						
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		USPM29427	USPM28319	USPM26459
Sample Date		Client Info		28 Aug 2023	21 May 2023	06 Feb 2023
Machine Age	hrs	Client Info		0	0	0
Oil Age	hrs	Client Info		0	0	0
Oil Changed		Client Info		N/A	N/A	N/A
Sample Status				NORMAL	NORMAL	NORMAL
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	0
Chromium	ppm	ASTM D5185m	>10	<1	0	0
Nickel	ppm	ASTM D5185m		0	<1	0
Titanium	ppm	ASTM D5185m		<1	0	0
Silver	ppm	ASTM D5185m		0	0	0
Aluminum	ppm	ASTM D5185m	>25	0	0	0
Lead	ppm	ASTM D5185m	>25	<1	0	0
Copper	ppm	ASTM D5185m	>50	<1	<1	<1
Tin	ppm	ASTM D5185m	>15	<1	0	<1
Vanadium	ppm	ASTM D5185m		<1	0	0
Cadmium	ppm	ASTM D5185m		<1	0	0
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	0
Barium	ppm	ASTM D5185m	0	0	0	0
Molybdenum	ppm	ASTM D5185m	0	0	0	0
Manganese	ppm	ASTM D5185m		<1	0	0
Magnesium	ppm	ASTM D5185m	0	0	<1	0
Calcium	ppm	ASTM D5185m	0	0	0	0
Phosphorus	ppm	ASTM D5185m	0	1	0	0
Zinc	ppm	ASTM D5185m	0	2	0	0
Sulfur	ppm	ASTM D5185m	0	0	0	0
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	0
Sodium	ppm	ASTM D5185m		<1	0	<1
Potassium	ppm	ASTM D5185m	>20	2	<1	0
Water	%	ASTM D6304	>0.1	0.007	0.008	0.003
ppm Water	ppm	ASTM D6304	>1000	74.5	80.8	33.7
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647	>10000	256	508	200
Particles >6µm		ASTM D7647	>2500	89	181	65
Particles >14µm		ASTM D7647	>320	16	28	8
Particles >21µm		ASTM D7647	>80	4	8	3
Particles >38µm		ASTM D7647	>20	0	1	0
Particles >71µm		ASTM D7647	>4	0	0	0
Oil Cleanliness		ISO 4406 (c)	>20/18/15	15/14/11	16/15/12	15/13/10
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.15	0.67	0.90	0.57



## OIL ANALYSIS REPORT

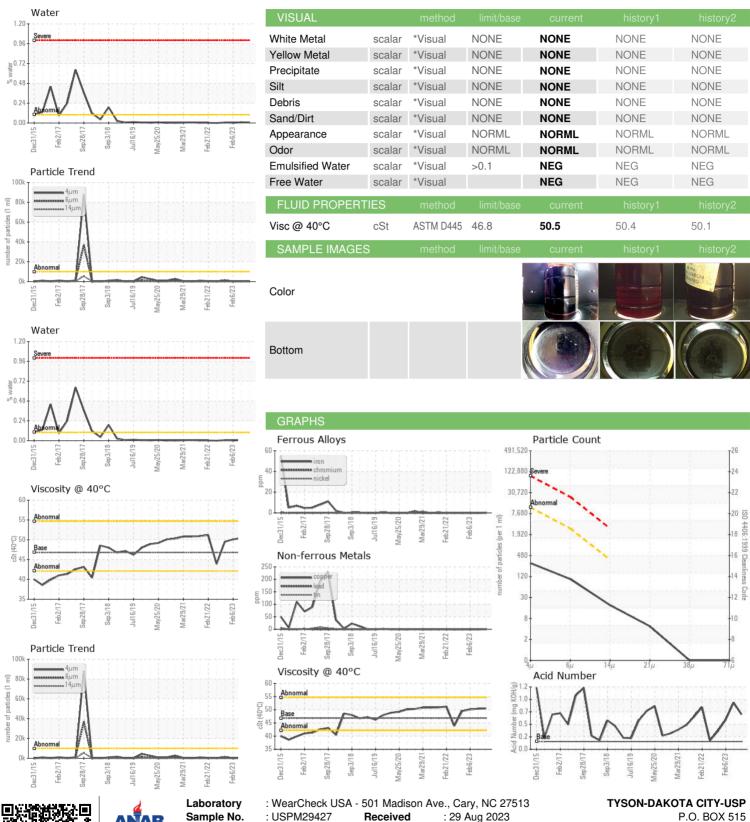





Certificate L2367

Sample No. Lab Number **Unique Number** 

: 05937283

: USPM29427 : 10622554 Test Package : IND 2

Received : 29 Aug 2023 : 30 Aug 2023 Diagnosed

: Doug Bogart Diagnostician

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation. Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: (605)235-2396 F: (605)235-2960

DAKOTA CITY, NE

Contact: RICHARD KOCH

US 68731