




PROBLEM SUMMARY

Sample Rating Trend

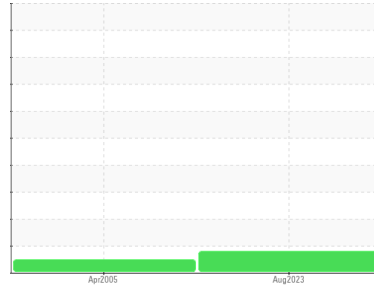


ISO



Machine Id
TURBO FAN (S/N 31010101)
 Component
Bearing
 Fluid
SHELL TELLUS 46 (46 GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

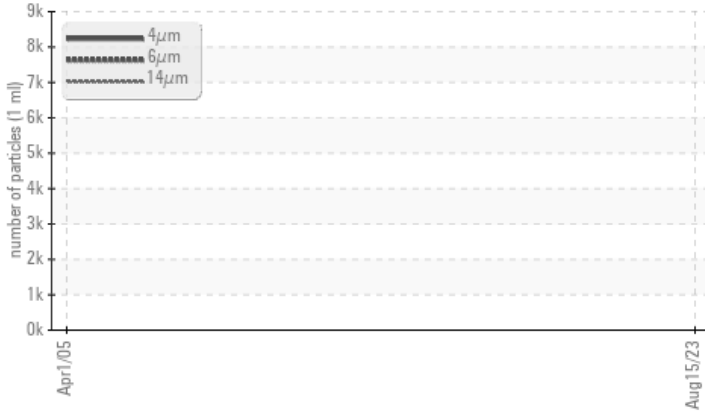

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ATTENTION	NORMAL	---
Particles >6µm	ASTM D7647	>1300	▲ 1386	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/14	▲ 20/18/14	---	---

Customer Id: LEPWAV
 Sample No.: WC0776130
 Lab Number: 05937653
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

01 Apr 2005 Diag:

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. There is no indication of any contamination in the component. The condition of oil is suitable for further service.


view report





OIL ANALYSIS REPORT

Sample Rating Trend

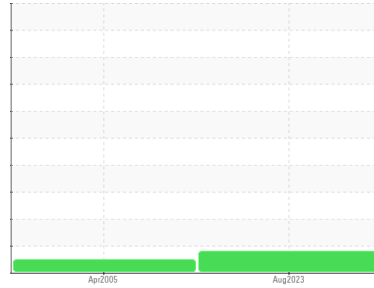

ISO



Machine Id
TURBO FAN (S/N 31010101)

Component
Bearing

Fluid
SHELL TELLUS 46 (46 GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number	Client Info			WC0776130	WCI2058278	---
Sample Date	Client Info			15 Aug 2023	01 Apr 2005	---
Machine Age	yrs	Client Info		20	21345	---
Oil Age	yrs	Client Info		1	4383	---
Oil Changed	Client Info			Not Chngd	Not Chngd	---
Sample Status				ATTENTION	NORMAL	---

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>20	<1	2	---
Chromium	ppm	ASTM D5185m	>20	0	0	---
Nickel	ppm	ASTM D5185m	>20	<1	0	---
Titanium	ppm	ASTM D5185m		0	0	---
Silver	ppm	ASTM D5185m		0	0	---
Aluminum	ppm	ASTM D5185m	>20	0	0	---
Lead	ppm	ASTM D5185m	>20	0	2	---
Copper	ppm	ASTM D5185m	>20	0	<1	---
Tin	ppm	ASTM D5185m	>20	0	0	---
Antimony	ppm	ASTM D5185m		---	9	---
Vanadium	ppm	ASTM D5185m		0	0	---
Cadmium	ppm	ASTM D5185m		0	0	---






ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0.0	0	0	---
Barium	ppm	ASTM D5185m	0	2	0	---
Molybdenum	ppm	ASTM D5185m	0	0	<1	---
Manganese	ppm	ASTM D5185m		0	0	---
Magnesium	ppm	ASTM D5185m	11	60	<1	---
Calcium	ppm	ASTM D5185m	35	19	79	---
Phosphorus	ppm	ASTM D5185m	266	283	342	---
Zinc	ppm	ASTM D5185m	276	338	404	---
Sulfur	ppm	ASTM D5185m	1847	724	1154	---

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>15	2	<1	---
Sodium	ppm	ASTM D5185m		0	0	---
Potassium	ppm	ASTM D5185m	>20	0	0	---

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		8387	---	---
Particles >6µm		ASTM D7647	>1300	1386	---	---
Particles >14µm		ASTM D7647	>160	90	---	---
Particles >21µm		ASTM D7647	>40	28	---	---
Particles >38µm		ASTM D7647	>10	1	---	---
Particles >71µm		ASTM D7647	>3	0	---	---
Oil Cleanliness		ISO 4406 (c)	>--/17/14	20/18/14	---	---

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.36	0.42	0.519	---

OIL ANALYSIS REPORT

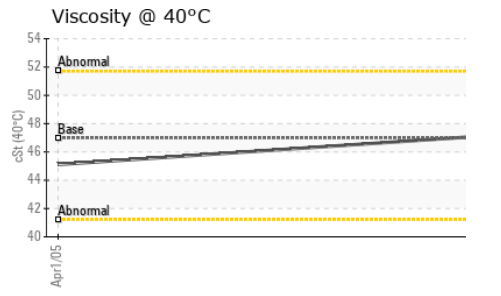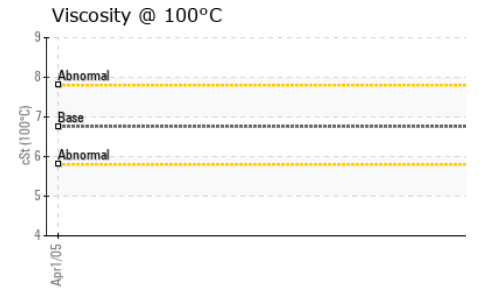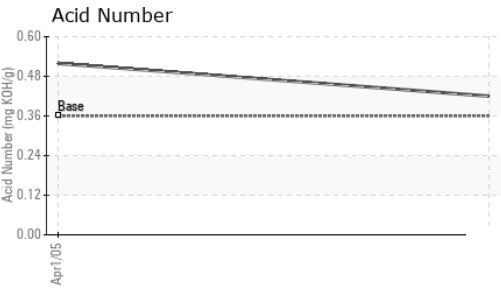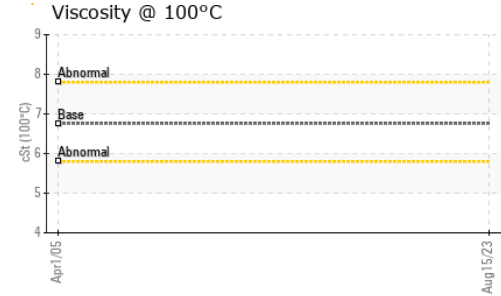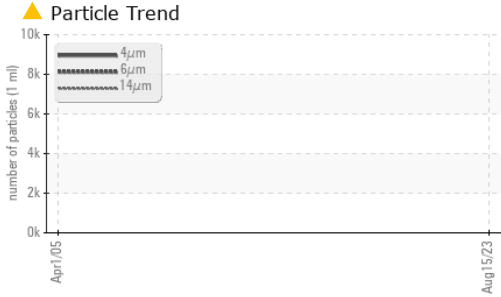






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46.99	47.15	45.11
Visc @ 100°C	cSt	ASTM D445	6.76	7.34	---
Viscosity Index (VI)	Scale	ASTM D2270	96	117	---

SAMPLE IMAGES

	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

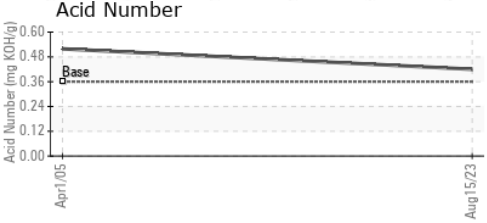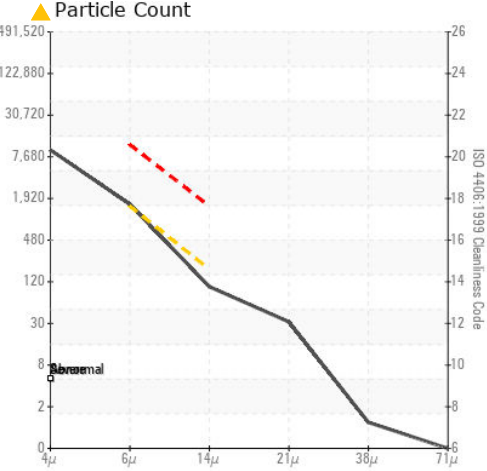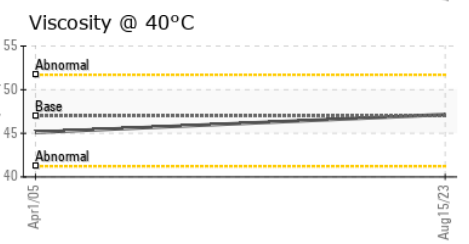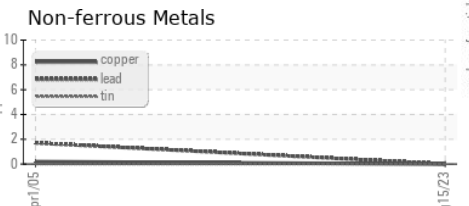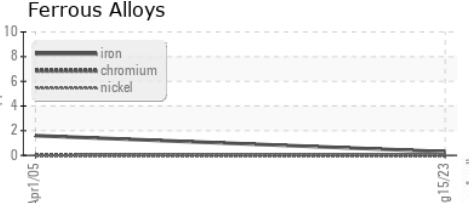

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0776130 **Received** : 29 Aug 2023
Lab Number : 05937653 **Diagnosed** : 04 Sep 2023
Unique Number : 10622924 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KV100, PrtCount, VI)

LEPRINO FOODS - WAVERLY
 400 LEPRINO AVE
 WAVERLY, NY
 US 14892
 Contact: ED TWINING
 ETWINING@LEPRINOFOODS.COM
 T:
 F: (570)882-7290

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)