


PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
COMPRESSOR STATIONS/RED HILLS EAST AREA
Machine Id
ABU (S/N 5329X5976)
Component
Compressor
Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

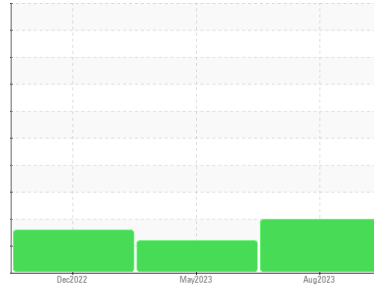

COMPONENT CONDITION SUMMARY

▲ Particle Trend

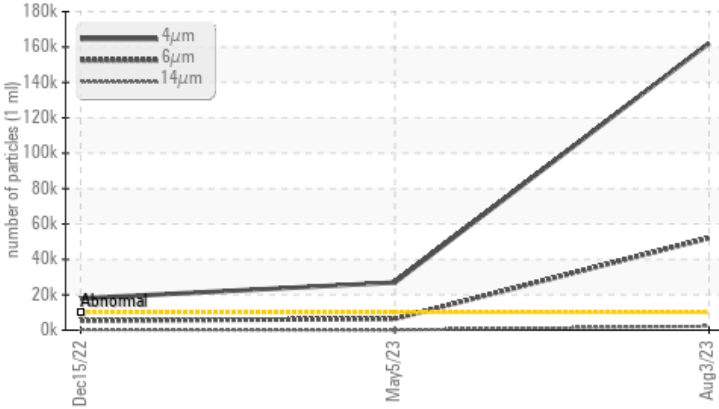

RECOMMENDATION

We recommend you service the filters on this component. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	ABNORMAL	ABNORMAL
Particles >4µm	ASTM D7647	>10000	▲ 162162	▲ 26928	▲ 17913
Particles >6µm	ASTM D7647	>1300	▲ 51971	▲ 6341	▲ 5350
Particles >14µm	ASTM D7647	>320	▲ 2187	102	▲ 331
Particles >21µm	ASTM D7647	>80	▲ 362	16	59
Oil Cleanliness	ISO 4406 (c)	>20/17/15	▲ 25/23/18	▲ 22/20/14	▲ 21/20/16

Customer Id: EOGMID
Sample No.: TO60001241
Lab Number: 05937889
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Filter	---	---	?	We recommend you service the filters on this component.

HISTORICAL DIAGNOSIS

05 May 2023 Diag: Angela Borella

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



15 Dec 2022 Diag: Jonathan Hester

ISO



We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report




OIL ANALYSIS REPORT

Sample Rating Trend

ISO

Area
COMPRESSOR STATIONS/RED HILLS EAST AREA
 Machine Id
ABU (S/N 5329X5976)
 Component
Compressor
 Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

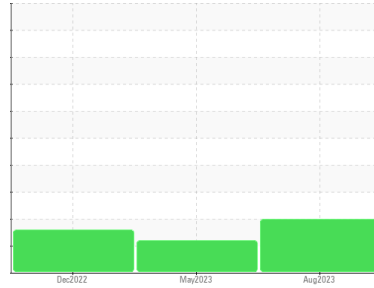

DIAGNOSIS

Recommendation

We recommend you service the filters on this component. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION	method	limit/base	current	history1	history2
Sample Number	Client Info		TO60001241	TO60000815	TO70000207
Sample Date	Client Info		03 Aug 2023	05 May 2023	15 Dec 2022
Machine Age	hrs	Client Info	61704	0	56626
Oil Age	hrs	Client Info	61704	0	56626
Oil Changed	Client Info		N/A	N/A	Not Changd
Sample Status			ABNORMAL	ABNORMAL	ABNORMAL

WEAR METALS	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	2	<1	13
Chromium	ppm	ASTM D5185m >10	0	<1	<1
Nickel	ppm	ASTM D5185m	<1	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	<1	0
Aluminum	ppm	ASTM D5185m >25	3	0	<1
Lead	ppm	ASTM D5185m >25	0	0	<1
Copper	ppm	ASTM D5185m >50	0	0	0
Tin	ppm	ASTM D5185m >15	1	0	2
Vanadium	ppm	ASTM D5185m	0	<1	0
Cadmium	ppm	ASTM D5185m	0	<1	0






ADDITIVES	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	6	<1	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 0	2	<1	2
Calcium	ppm	ASTM D5185m 0	0	<1	3
Phosphorus	ppm	ASTM D5185m 0	28	31	18
Zinc	ppm	ASTM D5185m 0	0	<1	<1
Sulfur	ppm	ASTM D5185m 0	1514	1764	840

CONTAMINANTS	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	0	3	0
Potassium	ppm	ASTM D5185m >20	2	<1	1
Water	%	ASTM D6304 >2.26	0.645	0.466	0.219
ppm Water	ppm	ASTM D6304 >22600	6450.0	4660	2190

FLUID CLEANLINESS	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	▲ 162162	▲ 26928	▲ 17913
Particles >6µm	ASTM D7647	>1300	▲ 51971	▲ 6341	▲ 5350
Particles >14µm	ASTM D7647	>320	▲ 2187	102	▲ 331
Particles >21µm	ASTM D7647	>80	▲ 362	16	59
Particles >38µm	ASTM D7647	>20	11	1	2
Particles >71µm	ASTM D7647	>4	0	0	1
Oil Cleanliness	ISO 4406 (c)	>20/17/15	▲ 25/23/18	▲ 22/20/14	▲ 21/20/16

FLUID DEGRADATION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.81	0.81	0.30

OIL ANALYSIS REPORT

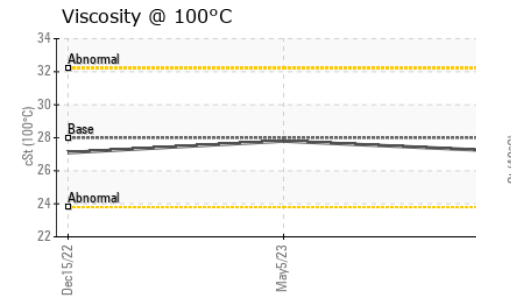
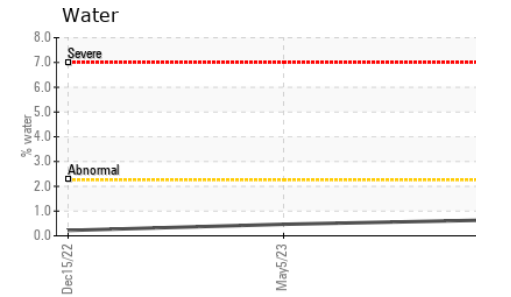
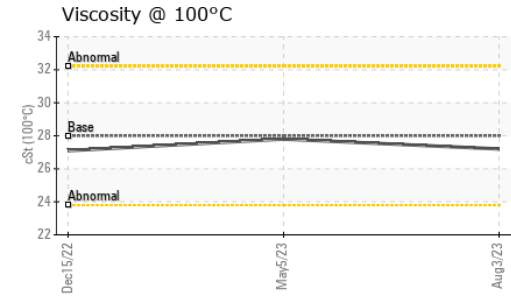
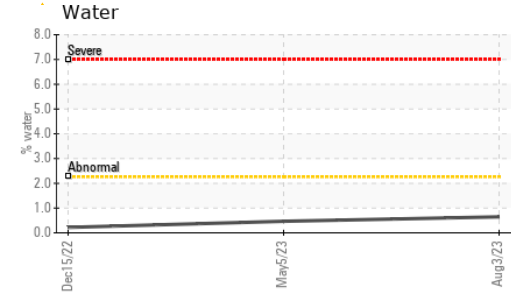
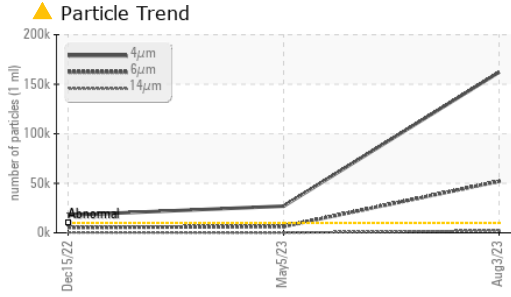


VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	LIGHT	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	157	148
Visc @ 100°C	cSt	ASTM D445	28	27.2	27.1
Viscosity Index (VI)	Scale	ASTM D2270	224	211	221

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

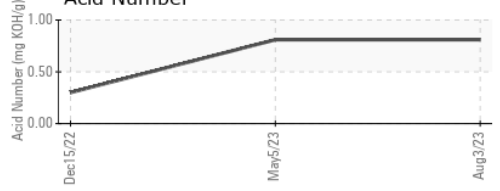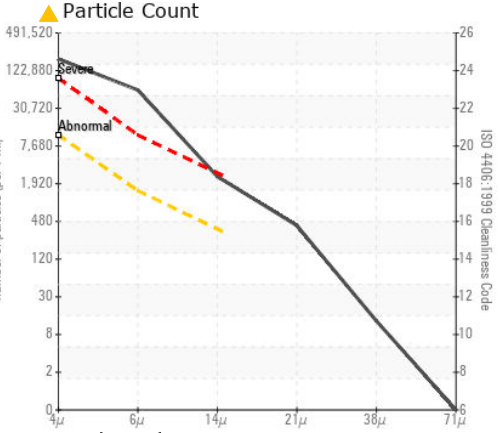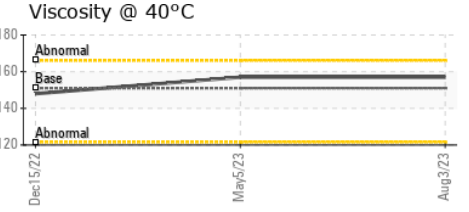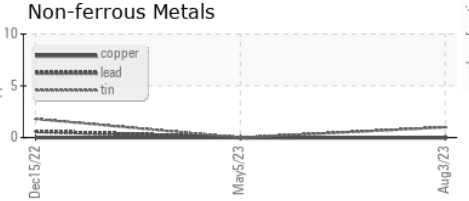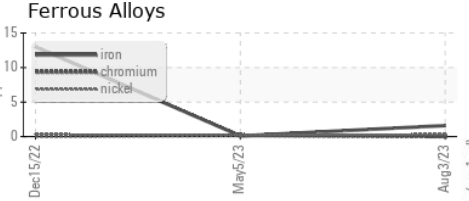

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001241 **Received** : 29 Aug 2023
Lab Number : 05937889 **Diagnosed** : 31 Aug 2023
Unique Number : 10628501 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: HERMAN GARZA
 herman_garza@egoresources.com
 T: (432)686-3600
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)