


PROBLEM SUMMARY

Sample Rating Trend

ISO




Area
COMPRESSOR STATIONS/RED HILLS EAST AREA
Machine Id
BRONCO (S/N LE10363)
Component
Compressor
Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

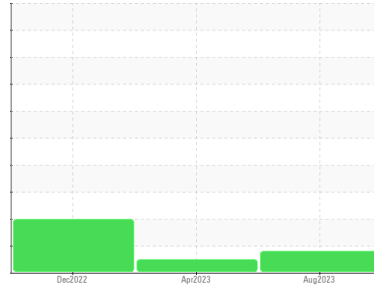

COMPONENT CONDITION SUMMARY

▲ Particle Trend

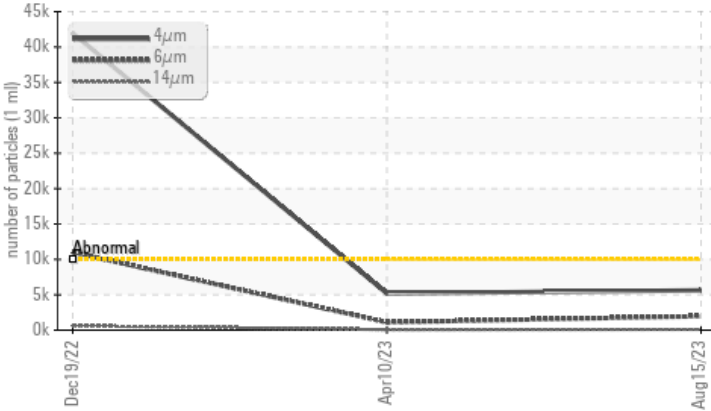

RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status		ATTENTION	NORMAL	ABNORMAL
Particles >6µm	ASTM D7647 >1300	▲ 1964	1103	▲ 10990
Oil Cleanliness	ISO 4406 (c) >20/17/15	▲ 20/18/14	20/17/13	▲ 23/21/16

Customer Id: EOGMID
Sample No.: TO60001220
Lab Number: 05937892
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
Don Baldrige +1
don.b505@comcast.net

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

There are no recommended actions for this sample.

HISTORICAL DIAGNOSIS

10 Apr 2023 Diag: Don Baldrige

NORMAL



Resample at the next service interval to monitor. All component wear rates are normal. The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



19 Dec 2022 Diag: Jonathan Hester

ISO




We recommend you service the filters on this component if applicable. Resample at the next service interval to monitor. All component wear rates are normal. There is a high amount of particulates present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report



OIL ANALYSIS REPORT

Sample Rating Trend

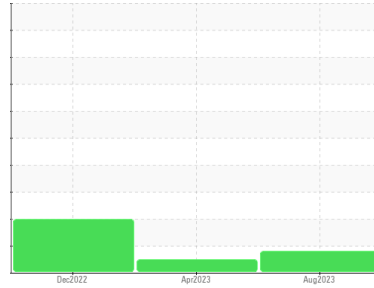

Area
COMPRESSOR STATIONS/RED HILLS EAST AREA
Machine Id
BRONCO (S/N LE10363)
Component
Compressor
Fluid
TULCO LUBSOIL LPG WS 150 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a moderate amount of silt (particulates < 14 microns in size) present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		TO60001220	TO60000846	TO70000202
Sample Date	Client Info		15 Aug 2023	10 Apr 2023	19 Dec 2022
Machine Age	hrs	Client Info	11991	12630	8042
Oil Age	hrs	Client Info	11991	4588	3356
Oil Changed	Client Info		Oil Added	Filtered	Changed
Sample Status			ATTENTION	NORMAL	ABNORMAL

WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	1	0
Chromium	ppm	ASTM D5185m >10	0	0	0
Nickel	ppm	ASTM D5185m	<1	<1	<1
Titanium	ppm	ASTM D5185m	0	0	0
Silver	ppm	ASTM D5185m	0	0	0
Aluminum	ppm	ASTM D5185m >25	3	0	<1
Lead	ppm	ASTM D5185m >25	0	0	<1
Copper	ppm	ASTM D5185m >50	0	0	0
Tin	ppm	ASTM D5185m >15	1	<1	1
Vanadium	ppm	ASTM D5185m	0	0	0
Cadmium	ppm	ASTM D5185m	0	0	0

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m 0	2	<1	0
Barium	ppm	ASTM D5185m 0	0	0	0
Molybdenum	ppm	ASTM D5185m 0	0	0	0
Manganese	ppm	ASTM D5185m	0	0	0
Magnesium	ppm	ASTM D5185m 0	2	<1	<1
Calcium	ppm	ASTM D5185m 0	0	1	<1
Phosphorus	ppm	ASTM D5185m 0	2	5	8
Zinc	ppm	ASTM D5185m 0	0	1	1
Sulfur	ppm	ASTM D5185m 0	136	9	44

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	0	<1	<1
Sodium	ppm	ASTM D5185m	0	<1	0
Potassium	ppm	ASTM D5185m >20	1	<1	1
Water	%	ASTM D6304 >2.26	0.664	0.614	0.410
ppm Water	ppm	ASTM D6304 >22600	6642.4	6140	4100






FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>10000	5626	5192	▲ 41951
Particles >6µm	ASTM D7647	>1300	▲ 1964	1103	▲ 10990
Particles >14µm	ASTM D7647	>320	100	65	▲ 615
Particles >21µm	ASTM D7647	>80	12	17	▲ 133
Particles >38µm	ASTM D7647	>20	0	3	3
Particles >71µm	ASTM D7647	>4	0	2	1
Oil Cleanliness	ISO 4406 (c)	>20/17/15	▲ 20/18/14	20/17/13	▲ 23/21/16

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.29	0.17	0.13


OIL ANALYSIS REPORT

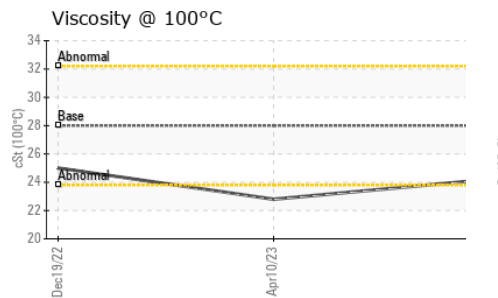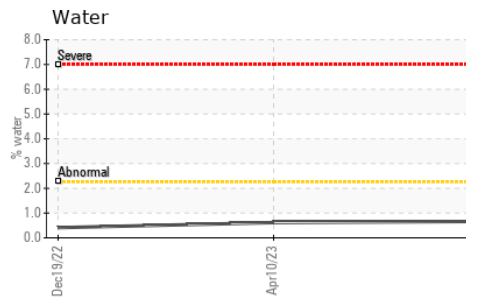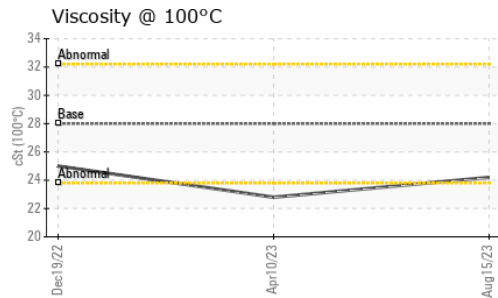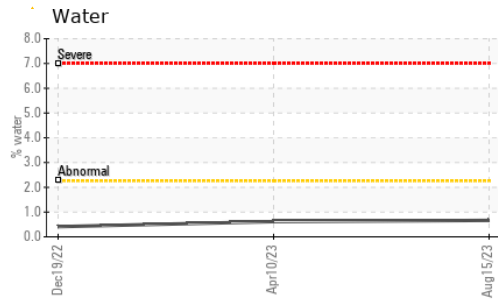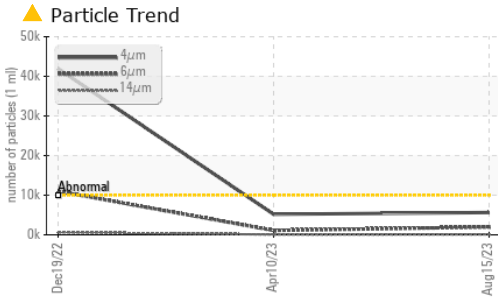






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	NONE
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>2.26	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	151	132	122
Visc @ 100°C	cSt	ASTM D445	28	24.2	22.8
Viscosity Index (VI)	Scale	ASTM D2270	224	216	217

SAMPLE IMAGES

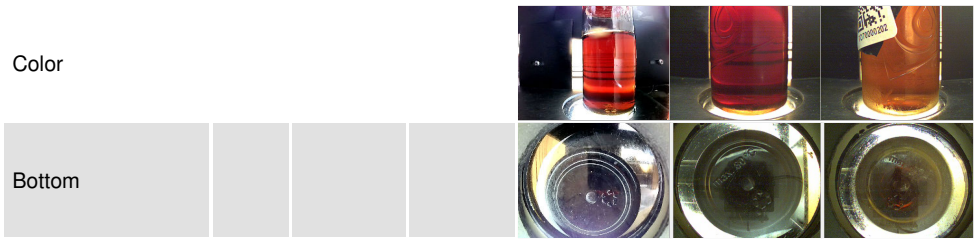

GRAPHS

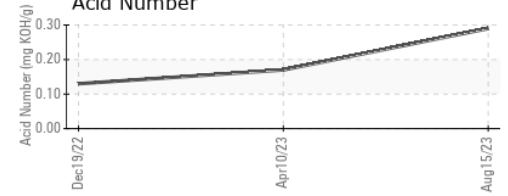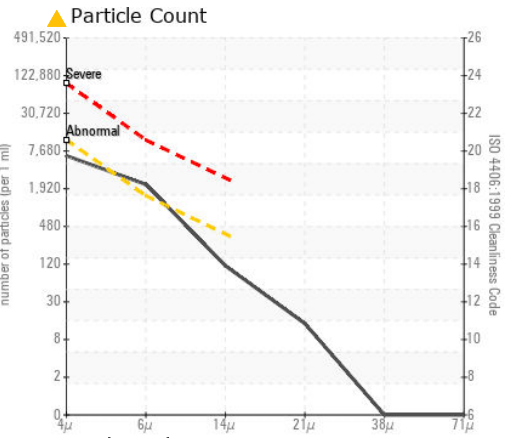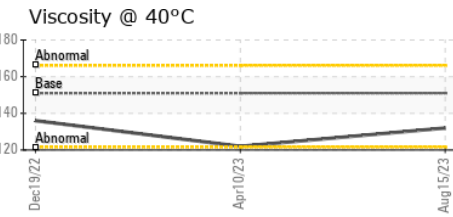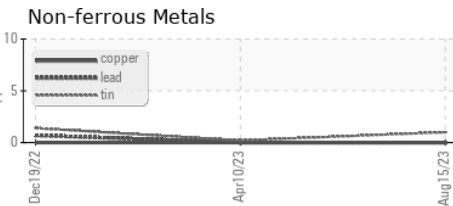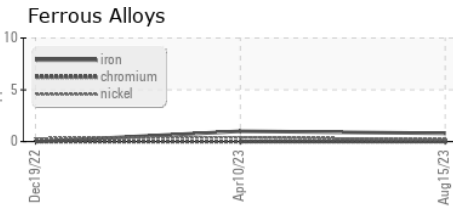

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : TO60001220 **Received** : 29 Aug 2023
Lab Number : 05937892 **Diagnosed** : 31 Aug 2023
Unique Number : 10628504 **Diagnostician** : Don Baldrige
Test Package : IND 2 (Additional Tests: KF, KV100, PrtCount, VI)

MIDLAND - EOG RESOURCES INC.
 5509 CHAMPIONS DRIVE
 MIDLAND, TX
 US 79706
 Contact: CARLOS ROMO
 carlos_romo@eogresources.com
 T: (432)640-7785
 F:

To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)