




# COOLANT REPORT

Sample Rating Trend

**NORMAL**

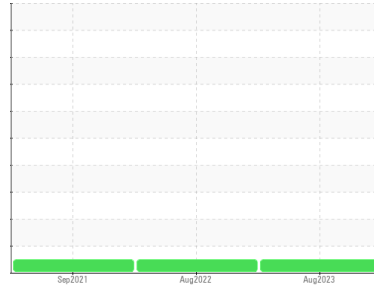

Machine Id  
**SJN-GP-BL01**

Component  
**Coolant**  
Fluid

**CHEVRON HEAVY DUTY PF COOLANT (--- GAL)**

## DIAGNOSIS

### Recommendation

The fluid is suitable for further service.

### Corrosion

All metal levels are normal indicating no corrosion in the cooling system.

### Contaminants

There is no indication of any contamination in the coolant.

### Coolant Condition

Glycol and nitrite levels are acceptable. The pH level of this fluid is within the acceptable limits.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>WC0764407</b>	WC0692040	WC0565636
Sample Date	Client Info	<b>21 Aug 2023</b>	23 Aug 2022	07 Sep 2021
Machine Age	hrs Client Info	<b>0</b>	0	0
Oil Age	hrs Client Info	<b>0</b>	0	0
Oil Changed	Client Info	<b>N/A</b>	Not Changd	Not Changd
Sample Status		<b>NORMAL</b>	NORMAL	NORMAL

## PHYSICAL TEST RESULTS

method	limit/base	current	history1	history2
Specific Gravity	*ASTM D1298	<b>1.066</b>	1.066	---
pH	Scale 0-14 ASTM D1287	<b>8.80</b>	8.93	9.10
Nitrites	ppm AP-053:2009	<b>1388</b>	1276	1352
Reserve Alkalinity	Scale 0-20 *ASTM D1121	<b>---</b>	---	---
Percentage Glycol	% ASTM D3321	<b>48.9</b>	48.8	49
Freezing Point	°F ASTM D3321	<b>-31</b>	-31	-35
Total Dissolved Solids		<b>206.5</b>	194.0	224.0
Carboxylate		<b>n/a</b>	n/a	n/a

## CORROSION INHIBITORS

method	limit/base	current	history1	history2
Silicon	ppm ASTM D6130	<b>95</b>	124	125
Phosphorus	ppm ASTM D6130	<b>3</b>	0	10
Boron	ppm ASTM D6130	<b>444</b>	500	421
Molybdenum	ppm ASTM D6130	<b>119</b>	136	104

## CORROSION

method	limit/base	current	history1	history2
Iron	ppm ASTM D6130	<b>18</b>	18	12
Aluminum	ppm ASTM D6130	<b>1</b>	<1	<1
Copper	ppm ASTM D6130	<b>&lt;1</b>	<1	<1
Lead	ppm ASTM D6130	<b>&lt;1</b>	0	0
Tin	ppm ASTM D6130	<b>&lt;1</b>	0	0
Zinc	ppm ASTM D6130	<b>&lt;1</b>	0	0

## CONTAMINANTS

method	limit/base	current	history1	history2
Chlorine	ppm ASTM D6130	<b>28</b>	15	13

## CARRIER SALTS


method	limit/base	current	history1	history2
Sodium	ppm ASTM D6130	<b>2629</b>	1629	1442
Potassium	ppm ASTM D6130	<b>36</b>	34	18







## SCALE POTENTIAL

method	limit/base	current	history1	history2
Calcium	ppm ASTM D6130	<b>15</b>	17	14
Magnesium	ppm ASTM D6130	<b>&lt;1</b>	<1	<1






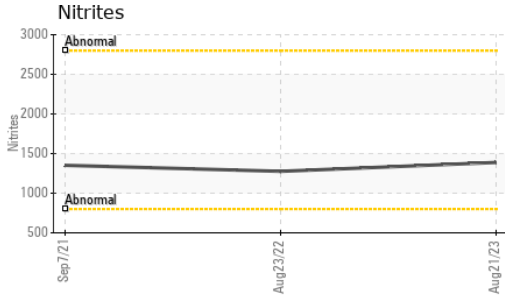


# COOLANT REPORT



VISUAL	method	limit/base	current	history1	history2
Coolant Color	*Visual	Grn/Prpl	<b>Pink</b>	Pink	Pink
Coolant Appearance	*Visual	Clear	<b>normal</b>	normal	normal
Color					
Bottom					

## GRAPHS

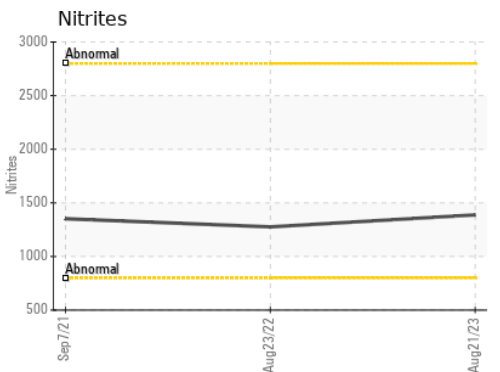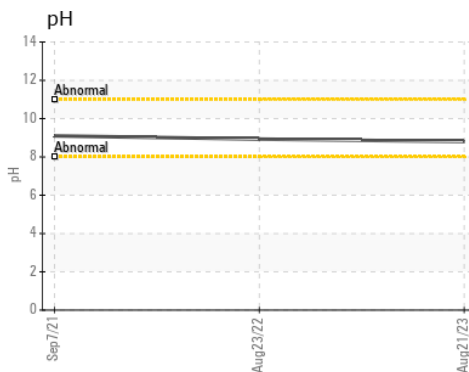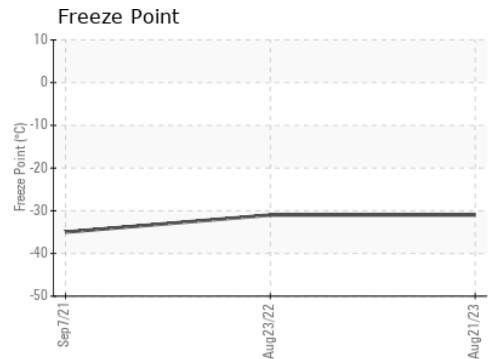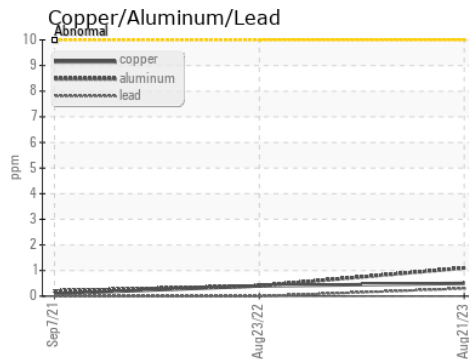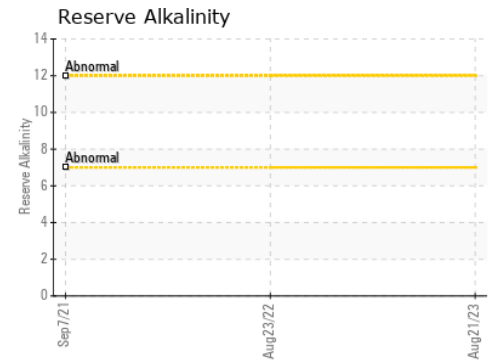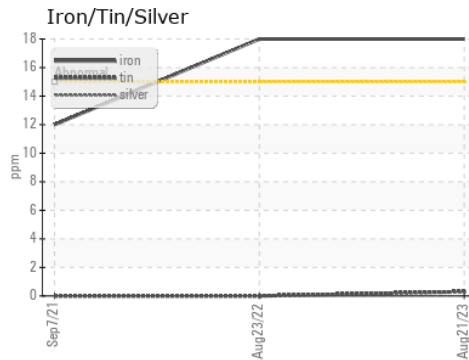

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0764407 **Received** : 29 Aug 2023  
**Lab Number** : 05938036 **Diagnosed** : 31 Aug 2023  
**Unique Number** : 10628648 **Diagnostician** : Doug Bogart  
**Test Package** : COOL- ( Additional Tests: COOL, ICP )

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

**EDL NA Recips-South Jordan**  
 South Jordan Powerstation, 10473 S. Bacchus Hwy.  
 South Jordan, UT  
 US 84095  
 Contact: Aaron Klein  
 aaron.klein@edlenergy.com

T:  
F: