

# **PROBLEM SUMMARY**


Sample Rating Trend



## <sup>Machine Id</sup> 7916183 (S/N 1051) Component

Compressor Fluic KAESER SIGMA (OEM) M-460 (--- GAL)

### COMPONENT CONDITION SUMMARY

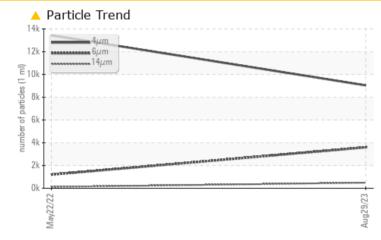

### RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### **PROBLEMATIC TEST RESULTS**

Sample Status			ABNORMAL	ATTENTION	
Particles >6µm	ASTM D7647	>1300	<u> </u>	1198	
Particles >14µm	ASTM D7647	>80	<b>489</b>	<b>1</b> 18	
Particles >21µm	ASTM D7647	>20	<u> </u>	26	
Particles >38µm	ASTM D7647	>4	<b>4</b> 5	0	
Oil Cleanliness	ISO 4406 (c)	>/17/13	<u> </u>	🔺 21/17/14	

Customer Id: ASYLAS Sample No.: KCPA004268 Lab Number: 05938292 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data: Don Baldridge +1 don.b505@comcast.net

To change component or sample information: Customer Service +1 1-800-237-1369 customerservice@wearcheck.com

RECOMMENDED	ACTIONS			
Action	Status	Date	Done By	Description
Change Fluid			?	Oil and filter change at the time of sampling has been noted.
Change Filter			?	Oil and filter change at the time of sampling has been noted.

### HISTORICAL DIAGNOSIS



### 22 May 2022 Diag: Angela Borella

The oil change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a moderate amount of silt (particulates < 14 microns in size) present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.





# **OIL ANALYSIS REPORT**

### Sample Rating Trend

ISO

Machine Id 7916183 (S/N 1051) Component

Compressor Fluid KAESER SIGMA (OEM) M-460 (--- GAL)

### DIAGNOSIS

#### Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is a high amount of particulates present in the oil.

#### Fluid Condition


The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

		-	May2022	Aug2023		
SAMPLE INFORM	IATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA004268	KCP45272	
Sample Date		Client Info		29 Aug 2023	22 May 2022	
Machine Age	hrs	Client Info		249	126	
Oil Age	hrs	Client Info		0	0	
Oil Changed		Client Info		Changed	Changed	
Sample Status				ABNORMAL	ATTENTION	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	2	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	<1	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	0	<1	
Copper	ppm	ASTM D5185m	>50	<1	2	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m	-	0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	88	4	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	<1	
Magnesium	ppm	ASTM D5185m	100	87	74	
Calcium	ppm	ASTM D5185m	0	1	3	
Phosphorus	ppm	ASTM D5185m	0	0	4	
Zinc	ppm	ASTM D5185m	0	<1	1	
Sulfur	ppm	ASTM D5185m	23500	23709	18084	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	<1	<1	
Sodium	ppm	ASTM D5185m		0	9	
Potassium	ppm	ASTM D5185m	>20	<1	2	
Water	%	ASTM D6304		0.041	0.022	
ppm Water	ppm	ASTM D6304		415.0	222.7	
FLUID CLEANLIN	ESS	method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		9042	13437	
Particles >6µm		ASTM D7647	>1300	<u> </u>	1198	
Particles >14µm		ASTM D7647	>80	<u> </u>	<b>1</b> 18	
Particles >21μm		ASTM D7647	>20	<u> </u>	26	
Particles >38μm		ASTM D7647	>4	<b>5</b>	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	<b>20/19/16</b>	▲ 21/17/14	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	0.42	0.36	
· · /	_ 5					

Contact/Location: Service Manager - ASYLAS



# **OIL ANALYSIS REPORT**

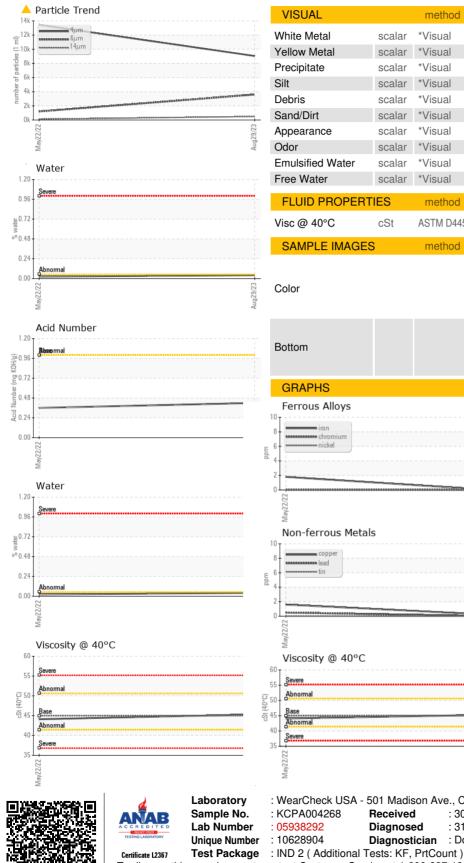

calar calar calar calar calar	*Visual *Visual *Visual	NONE NONE NONE	NONE NONE NONE	history1 NONE NONE NONE	history2
calar calar calar	*Visual *Visual	NONE	NONE	NONE	
calar calar	*Visual		_		
calar		NONL			
	*Visual	NONE	NONE	NONE	
	*Visual	NONE	LIGHT	NONE	
calar	*Visual	NONE	NONE	NONE	
calar	*Visual	NORML	NORML	NORML	
calar	*Visual	NORML	NORML	NORML	
		>0.05			
			NEG		
S	method	limit/base	current	history1	history2
St	ASTM D445	45	45.3	44.1	
	method	limit/base	current	history1	history2
					no image
			$\bigcirc$		no image
			Particle Count		
		491,520			T <sup>26</sup>
		122,880 -			-24
		30,720			-22
		7,680	~ `		-20
		9/23 1 ml)	1.		+18 +16 +14
		aug2 1,920.			-18
				<ul> <li></li> </ul>	16
		rof bi	×.		
		ag 120·			-14
					-12
		8	<b>Sierene</b> mal		10
		EZ/ 2.			
		Aug 29			
		4		14µ 21µ	38µ 71µ
		-1.20	Acia Number		
		0/HO: 0.96	Base mal		
		Ĕ 0.72			
		- e 0.48			
		P 0.24			
			2		
		g29/2	y22/2		
		Aur	Ma		
	calar calar S	calar *Visual calar *Visual S method St ASTM D445	calar *Visual >0.05 calar *Visual *Visual S method limit/base St ASTM D445 45 method limit/base 491,520- 122,880- 30,720- 7,660 122,880- 30,720- 30,720-	calar *Visual >0.05 NEG calar *Visual NEG S method limit/base current St ASTM D445 45 45.3 method limit/base current imit/base current Particle Count 122,880 1920 19	calar *Visual >0.05 NEG NEG calar *Visual IImit/base current history1 St ASTM D445 45 45 45.3 44.1 method IImit/base current history1 iImit/base current history1 Particle Count Particle Count 122,880 1,90

To discuss this sample report, contact Customer Service at 1-800-237-1369. \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

Contact: Service Manager