

# **OIL ANALYSIS REPORT**

Sample Rating Trend

**NORMAL** 



7297557 (S/N 1530)

Component

**Compressor** Fluid

KAESER SIGMA (OEM) S-460 (--- GAL)

### Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.


### **Fluid Condition**

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Sep 2022	Aug <sup>2</sup> 023		
SAMPLE INFORM	AATION	ام مالم می			المراجعة المراجعة	history O
	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KC124250	KC85954	
Sample Date		Client Info		22 Aug 2023	15 Sep 2022	
Machine Age	hrs	Client Info		1333	685	
Oil Age	hrs	Client Info		0	439	
Oil Changed		Client Info		Changed	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	<1	<1	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	<1	0	
Aluminum	ppm	ASTM D5185m	>10	<1	<1	
Lead	ppm	ASTM D5185m	>10	<1	0	
Copper	ppm	ASTM D5185m	>50	1	1	
Tin	ppm	ASTM D5185m	>10	<1	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m		0	0	
Barium	ppm	ASTM D5185m	90	7	9	
Molybdenum	ppm	ASTM D5185m		0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	90	71	66	
Calcium	ppm	ASTM D5185m	2	0	0	
Phosphorus	ppm	ASTM D5185m		<1	34	
Zinc	ppm	ASTM D5185m		1	2	
CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	0	1	
Sodium	ppm	ASTM D5185m		16	14	
Potassium	ppm	ASTM D5185m	>20	4	4	
Water	%	ASTM D6304	>0.05	0.037	△ 0.132	
ppm Water	ppm	ASTM D6304	>500	371.7	<u></u> 1320	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		669	627	
Particles >6µm		ASTM D7647	>1300	211	125	
Particles >14µm		ASTM D7647	>80	25	9	
Particles >21µm		ASTM D7647	>20	8	2	
Particles >38μm		ASTM D7647	>4	0	0	
Particles >71µm		ASTM D7647	>3	0	0	
Oil Cleanliness		ISO 4406 (c)	>/17/13	17/15/12	16/14/10	
FLUID DEGRADA	TION	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.4	0.34	0.34	



## **OIL ANALYSIS REPORT**

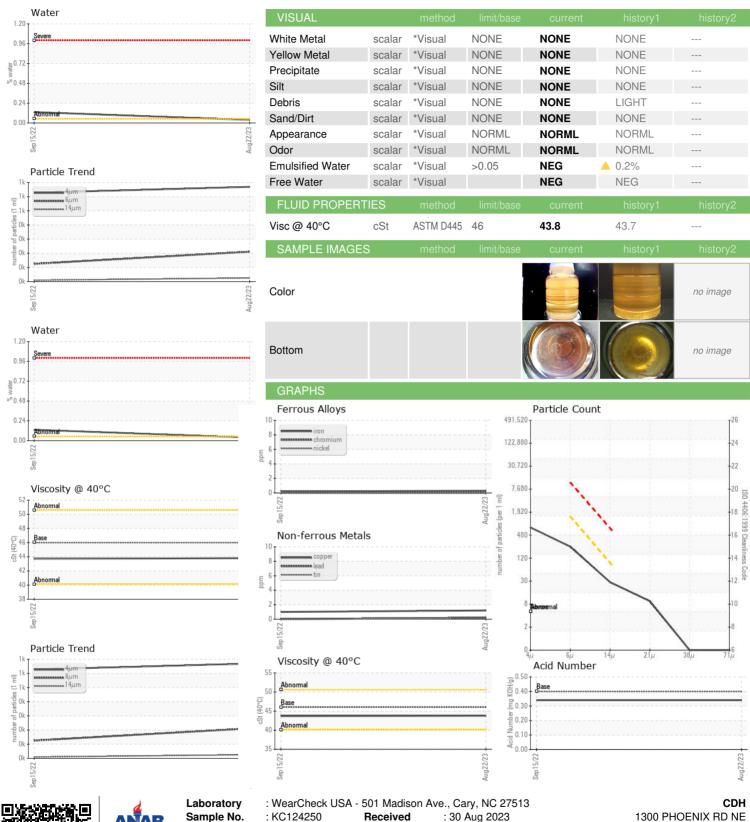



Certificate L2367

Sample No. Lab Number **Unique Number** Test Package

: KC124250 . 05938300 : 10628912

: 30 Aug 2023 Received : 31 Aug 2023 Diagnosed

: Doug Bogart Diagnostician

WARREN, OH US 44483 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

: IND 2

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T: F: