



PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id
KAESER SFC 22 8734489 (S/N 1053)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

COMPONENT CONDITION SUMMARY

▲ Particle Trend

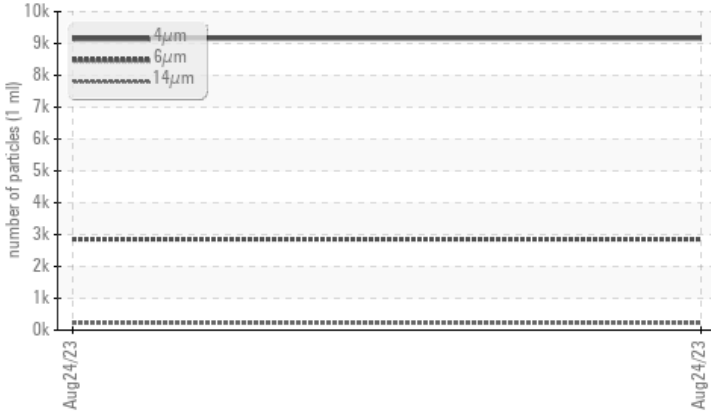

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status			ABNORMAL	---	---
Particles >6µm	ASTM D7647	>1300	▲ 2854	---	---
Particles >14µm	ASTM D7647	>80	▲ 218	---	---
Particles >21µm	ASTM D7647	>20	▲ 58	---	---
Particles >38µm	ASTM D7647	>4	▲ 5	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ 20/19/15	---	---

Customer Id: PROWRA
Sample No.: KCPA003727
Lab Number: 05938309
Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:
 Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
 Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.

HISTORICAL DIAGNOSIS



OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id
KAESER SFC 22 8734489 (S/N 1053)
 Component
Compressor
 Fluid
KAESER SIGMA (OEM) S-460 (--- GAL)

DIAGNOSIS

Recommendation

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is a high amount of particulates present in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	KCPA003727	---	---
Sample Date	Client Info	24 Aug 2023	---	---
Machine Age	hrs	Client Info	3838	---
Oil Age	hrs	Client Info	0	---
Oil Changed	Client Info	Changed	---	---
Sample Status		ABNORMAL	---	---

WEAR METALS

method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<1	---
Chromium	ppm	ASTM D5185m >10	0	---
Nickel	ppm	ASTM D5185m >3	0	---
Titanium	ppm	ASTM D5185m >3	0	---
Silver	ppm	ASTM D5185m >2	0	---
Aluminum	ppm	ASTM D5185m >10	1	---
Lead	ppm	ASTM D5185m >10	0	---
Copper	ppm	ASTM D5185m >50	8	---
Tin	ppm	ASTM D5185m >10	0	---
Vanadium	ppm	ASTM D5185m	0	---
Cadmium	ppm	ASTM D5185m	0	---

ADDITIVES

method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	---
Barium	ppm	ASTM D5185m 90	<1	---
Molybdenum	ppm	ASTM D5185m	0	---
Manganese	ppm	ASTM D5185m	0	---
Magnesium	ppm	ASTM D5185m 90	13	---
Calcium	ppm	ASTM D5185m 2	0	---
Phosphorus	ppm	ASTM D5185m	<1	---
Zinc	ppm	ASTM D5185m	33	---
Sulfur	ppm	ASTM D5185m	20120	---

CONTAMINANTS

method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<1	---
Sodium	ppm	ASTM D5185m	4	---
Potassium	ppm	ASTM D5185m >20	4	---
Water	%	ASTM D6304 >0.05	0.017	---
ppm Water	ppm	ASTM D6304 >500	174.8	---

FLUID CLEANLINESS


method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	9166	---	---
Particles >6µm	ASTM D7647 >1300	▲ 2854	---	---
Particles >14µm	ASTM D7647 >80	▲ 218	---	---
Particles >21µm	ASTM D7647 >20	▲ 58	---	---
Particles >38µm	ASTM D7647 >4	▲ 5	---	---
Particles >71µm	ASTM D7647 >3	0	---	---
Oil Cleanliness	ISO 4406 (c) >--/17/13	▲ 20/19/15	---	---

FLUID DEGRADATION


method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	0.40	---

OIL ANALYSIS REPORT


▲ Particle Trend

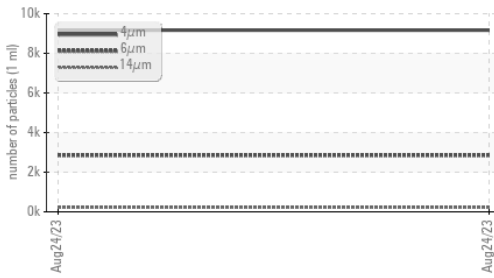


Water

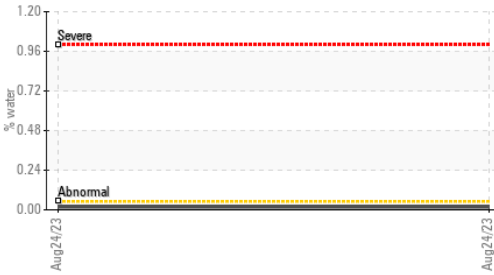

Acid Number

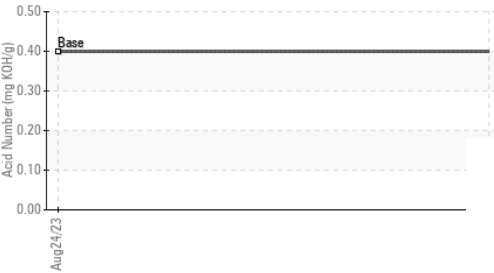

Water

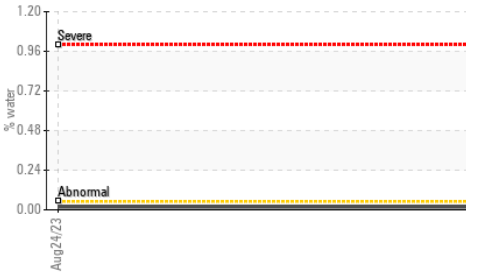

Viscosity @ 40°C



VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	LIGHT	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.05	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	44.5	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------


Color				no image	no image
Bottom				no image	no image

GRAPHS


Ferrous Alloys




Non-ferrous Metals

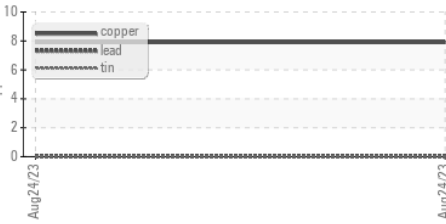

Viscosity @ 40°C

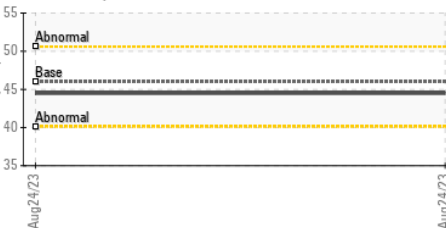

▲ Particle Count

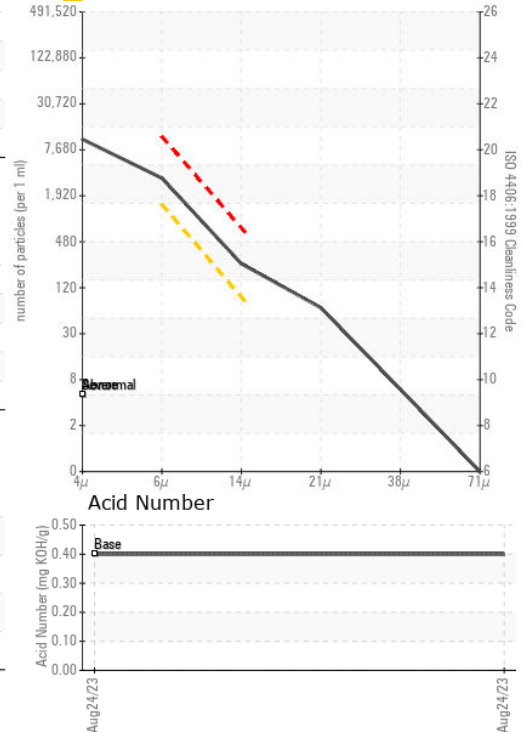

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA003727 **Received** : 30 Aug 2023
Lab Number : 05938309 **Diagnosed** : 31 Aug 2023
Unique Number : 10628921 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

PRO-HEALTH
 36635 A ST
 WRAY, CO
 US 80758

Contact: SERVICE MANAGER

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:
F: