PROBLEM SUMMARY

Sample Rating Trend

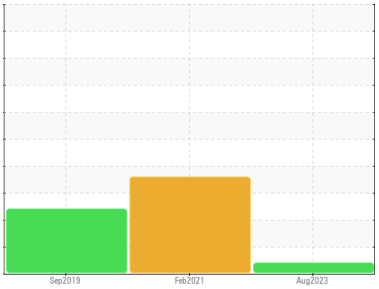

VIS DEBRIS

Machine Id
KAESER SM 7.5 6259582 (S/N 1027)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

COMPONENT CONDITION SUMMARY

No relevant graphs to display

RECOMMENDATION

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

PROBLEMATIC TEST RESULTS

Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL
Debris	scalar	*Visual	NONE	▲ **MODER**	▲ MODER	▲ MODER

Customer Id: CASFORCO
Sample No.: KCPA003856
Lab Number: 05938316
Test Package: IND 2

To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Change Fluid	---	---	?	Oil and filter change at the time of sampling has been noted.
Change Filter	---	---	?	Oil and filter change at the time of sampling has been noted.
Alert	---	---	?	We were unable to perform a particle count due to a high concentration of particles present in this sample.

HISTORICAL DIAGNOSIS

25 Feb 2021 Diag: Don Baldridge

WATER

Oil and filter change at the time of sampling has been noted. We recommend an early resample in 500 hours to monitor this condition. We were unable to perform a particle count due to a high concentration of particles present in this sample.All component wear rates are normal. There is a light concentration of water present in the oil. Free water present. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid.

view report

25 Sep 2019 Diag: Don Baldridge

ISO

No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor.All component wear rates are normal. There is a high amount of particulates present in the oil. Moderate concentration of visible dirt/debris present in the oil. The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

view report

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

Sample Rating Trend

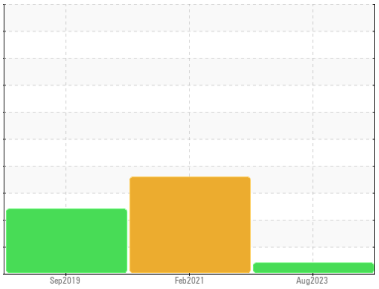

VIS DEBRIS

Machine Id
KAESER SM 7.5 6259582 (S/N 1027)
Component
Compressor
Fluid
KAESER SIGMA (OEM) M-460 (--- QTS)

DIAGNOSIS

Recommendation
No corrective action is recommended at this time. Oil and filter change at the time of sampling has been noted. Resample at the next service interval to monitor. We were unable to perform a particle count due to a high concentration of particles present in this sample.

Wear
All component wear rates are normal.

Contamination
Moderate concentration of visible dirt/debris present in the oil.

Fluid Condition
The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION		method	limit/base	current	history1	history2
Sample Number		Client Info		**KCPA003856**	KCP27008	KCP16645
Sample Date		Client Info		**23 Aug 2023**	25 Feb 2021	25 Sep 2019
Machine Age	hrs	Client Info		**14126**	7071	3471
Oil Age	hrs	Client Info		**0**	3600	3471
Oil Changed		Client Info		**Changed**	Changed	Changed
Sample Status				**ABNORMAL**	ABNORMAL	ABNORMAL

WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	**0**	<1	2
Chromium	ppm	ASTM D5185m	>10	**0**	0	0
Nickel	ppm	ASTM D5185m	>3	**0**	0	0
Titanium	ppm	ASTM D5185m	>3	**0**	0	0
Silver	ppm	ASTM D5185m	>2	**0**	<1	<1
Aluminum	ppm	ASTM D5185m	>10	**<1**	<1	<1
Lead	ppm	ASTM D5185m	>10	**0**	1	3
Copper	ppm	ASTM D5185m	>50	**44**	32	14
Tin	ppm	ASTM D5185m	>10	**0**	0	0
Antimony	ppm	ASTM D5185m		**---**	3	2
Vanadium	ppm	ASTM D5185m		**0**	<1	0
Cadmium	ppm	ASTM D5185m		**0**	0	0

ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	**0**	1	0
Barium	ppm	ASTM D5185m	90	**<1**	<1	0
Molybdenum	ppm	ASTM D5185m	0	**0**	1	0
Manganese	ppm	ASTM D5185m		**0**	0	0
Magnesium	ppm	ASTM D5185m	100	**0**	1	<1
Calcium	ppm	ASTM D5185m	0	**0**	0	0
Phosphorus	ppm	ASTM D5185m	0	**2**	0	0
Zinc	ppm	ASTM D5185m	0	**0**	<1	1
Sulfur	ppm	ASTM D5185m	23500	**19400**	12552	13462

CONTAMINANTS		method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	**2**	4	<1
Sodium	ppm	ASTM D5185m		**0**	<1	0
Potassium	ppm	ASTM D5185m	>20	**<1**	0	2
Water	%	ASTM D6304	>0.05	**0.009**	▲ 0.204	0.005
ppm Water	ppm	ASTM D6304	>500	**99.3**	▲ 2040	51.1

FLUID CLEANLINESS		method	limit/base	current	history1	history2
Particles >4µm		ASTM D7647		**---**	---	146463
Particles >6µm		ASTM D7647	>1300	**---**	---	▲ 63008
Particles >14µm		ASTM D7647	>80	**---**	---	▲ 5984
Particles >21µm		ASTM D7647	>20	**---**	---	▲ 1533
Particles >38µm		ASTM D7647	>4	**---**	---	▲ 91
Particles >71µm		ASTM D7647	>3	**---**	---	▲ 9
Oil Cleanliness		ISO 4406 (c)	>--/17/13	**---**	---	▲ 23/20

FLUID DEGRADATION		method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	1.0	**0.37**	0.346	0.310

KAESER COMPRESSORS
Built for a lifetime.

OIL ANALYSIS REPORT

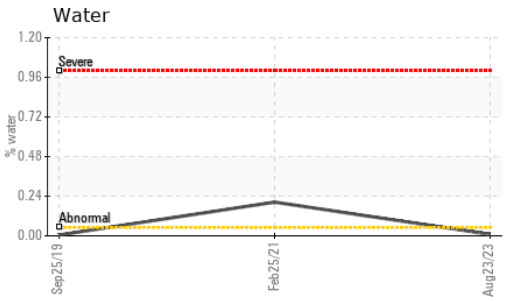

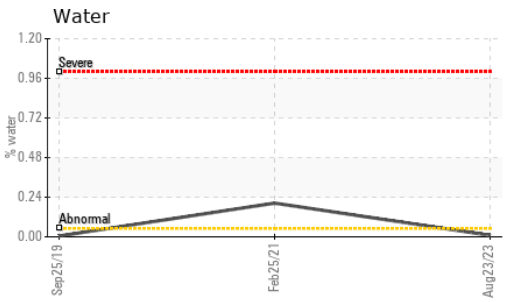

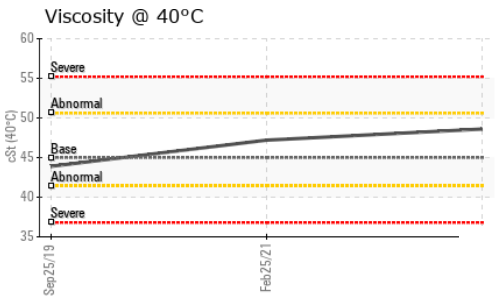

VISUAL		method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	**NONE**	NONE	NONE
Precipitate	scalar	*Visual	NONE	**NONE**	NONE	NONE
Silt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Debris	scalar	*Visual	NONE	▲ **MODER**	▲ MODER	▲ MODER
Sand/Dirt	scalar	*Visual	NONE	**NONE**	NONE	NONE
Appearance	scalar	*Visual	NORML	**NORML**	NORML	NORML
Odor	scalar	*Visual	NORML	**NORML**	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	**NEG**	▲ 0.2%	NEG
Free Water	scalar	*Visual		**NEG**	▲ 2.0	NEG

FLUID PROPERTIES		method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	45	**48.6**	47.2	43.9

SAMPLE IMAGES	method	limit/base	current	history1	history2
Color					
Bottom					

GRAPHS

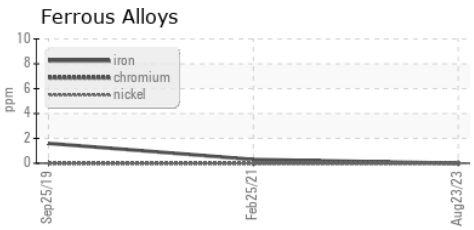

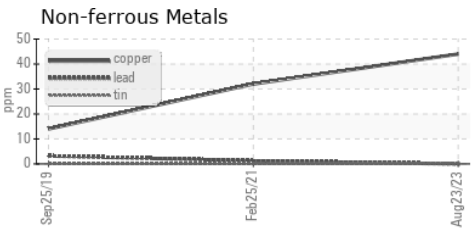

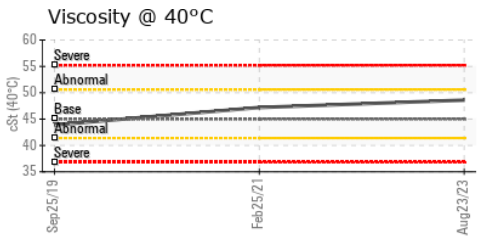

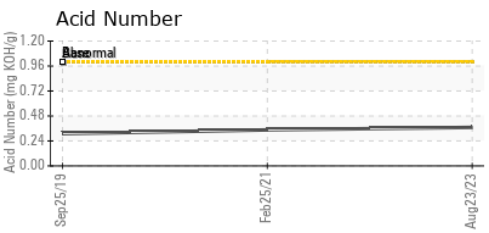

ANAB ACCREDITED ISO/IEC 17025 TESTING LABORATORY
Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : KCPA003856 **Received** : 30 Aug 2023
Lab Number : 05938316 **Diagnosed** : 31 Aug 2023
Unique Number : 10628928 **Diagnostician** : Doug Bogart
Test Package : IND 2 (Additional Tests: KF, PrtCount)

To discuss this sample report, contact Customer Service at 1-800-237-1369.
** - Denotes test methods that are outside of the ISO 17025 scope of accreditation.*
Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

CASTORENA MARBLE
1934 E LINCOLN AVE
FORT COLLINS, CO
US 80524
Contact:
T:
F: