



# PROBLEM SUMMARY

Sample Rating Trend




ISO



Machine Id  
**1634**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## COMPONENT CONDITION SUMMARY

### ▲ Particle Trend

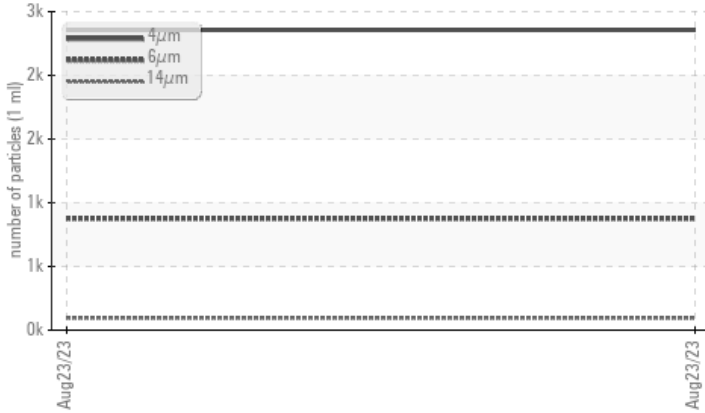

## RECOMMENDATION

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

## PROBLEMATIC TEST RESULTS

Sample Status			<b>ATTENTION</b>	---	---
Particles >14µm	ASTM D7647	>80	▲ <b>95</b>	---	---
Particles >21µm	ASTM D7647	>20	▲ <b>33</b>	---	---
Oil Cleanliness	ISO 4406 (c)	>--/17/13	▲ <b>18/17/14</b>	---	---

Customer Id: CTMSAL  
 Sample No.: KC05938321  
 Lab Number: 05938321  
 Test Package: IND 2



To manage this report scan the QR code

To discuss the diagnosis or test data:  
 Doug Bogart +1 (800)237-1369 x4016  
[dougb@wearcheckusa.com](mailto:dougb@wearcheckusa.com)

To change component or sample information:  
 Customer Service +1 1-800-237-1369  
[customerservice@wearcheck.com](mailto:customerservice@wearcheck.com)

## RECOMMENDED ACTIONS

*There are no recommended actions for this sample.*

## HISTORICAL DIAGNOSIS



# OIL ANALYSIS REPORT

Sample Rating Trend



ISO



Machine Id  
**1634**  
 Component  
**Compressor**  
 Fluid  
**KAESER SIGMA (OEM) S-460 (--- GAL)**

## DIAGNOSIS

### ▲ Recommendation

No corrective action is recommended at this time. The filter change at the time of sampling has been noted. Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### ▲ Contamination

There is a moderate amount of particulates present in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

method	limit/base	current	history1	history2
Sample Number	Client Info	<b>KC05938321</b>	---	---
Sample Date	Client Info	<b>23 Aug 2023</b>	---	---
Machine Age	hrs Client Info	<b>5024</b>	---	---
Oil Age	hrs Client Info	<b>0</b>	---	---
Oil Changed	Client Info	<b>N/A</b>	---	---
Sample Status		<b>ATTENTION</b>	---	---

## WEAR METALS

method	limit/base	current	history1	history2
Iron ppm ASTM D5185m	>50	<b>&lt;1</b>	---	---
Chromium ppm ASTM D5185m	>10	<b>0</b>	---	---
Nickel ppm ASTM D5185m	>3	<b>0</b>	---	---
Titanium ppm ASTM D5185m	>3	<b>0</b>	---	---
Silver ppm ASTM D5185m	>2	<b>0</b>	---	---
Aluminum ppm ASTM D5185m	>10	<b>&lt;1</b>	---	---
Lead ppm ASTM D5185m	>10	<b>0</b>	---	---
Copper ppm ASTM D5185m	>50	<b>12</b>	---	---
Tin ppm ASTM D5185m	>10	<b>0</b>	---	---
Vanadium ppm ASTM D5185m		<b>0</b>	---	---
Cadmium ppm ASTM D5185m		<b>0</b>	---	---

## ADDITIVES

method	limit/base	current	history1	history2
Boron ppm ASTM D5185m		<b>0</b>	---	---
Barium ppm ASTM D5185m	90	<b>0</b>	---	---
Molybdenum ppm ASTM D5185m		<b>0</b>	---	---
Manganese ppm ASTM D5185m		<b>0</b>	---	---
Magnesium ppm ASTM D5185m	90	<b>31</b>	---	---
Calcium ppm ASTM D5185m	2	<b>0</b>	---	---
Phosphorus ppm ASTM D5185m		<b>&lt;1</b>	---	---
Zinc ppm ASTM D5185m		<b>9</b>	---	---

## CONTAMINANTS

method	limit/base	current	history1	history2
Silicon ppm ASTM D5185m	>25	<b>&lt;1</b>	---	---
Sodium ppm ASTM D5185m		<b>10</b>	---	---
Potassium ppm ASTM D5185m	>20	<b>2</b>	---	---
Water % ASTM D6304	>0.05	<b>0.023</b>	---	---
ppm Water ppm ASTM D6304	>500	<b>233.8</b>	---	---






## FLUID CLEANLINESS

method	limit/base	current	history1	history2
Particles >4µm ASTM D7647		<b>2357</b>	---	---
Particles >6µm ASTM D7647	>1300	<b>876</b>	---	---
Particles >14µm ASTM D7647	>80	▲ <b>95</b>	---	---
Particles >21µm ASTM D7647	>20	▲ <b>33</b>	---	---
Particles >38µm ASTM D7647	>4	<b>2</b>	---	---
Particles >71µm ASTM D7647	>3	<b>0</b>	---	---
Oil Cleanliness ISO 4406 (c)	>--/17/13	▲ <b>18/17/14</b>	---	---

## FLUID DEGRADATION

method	limit/base	current	history1	history2
Acid Number (AN) mg KOH/g ASTM D8045	0.4	<b>0.32</b>	---	---

# OIL ANALYSIS REPORT

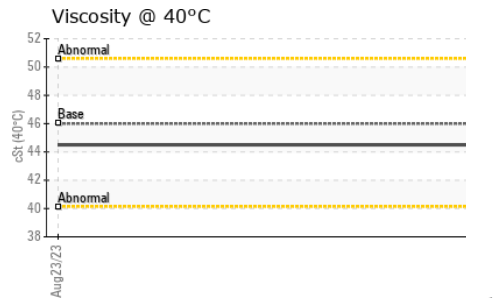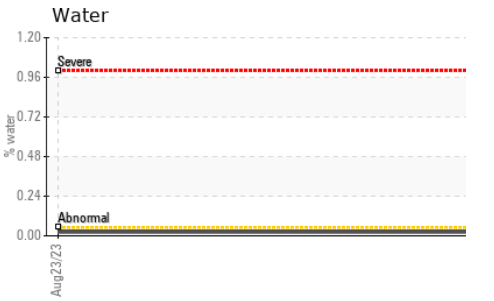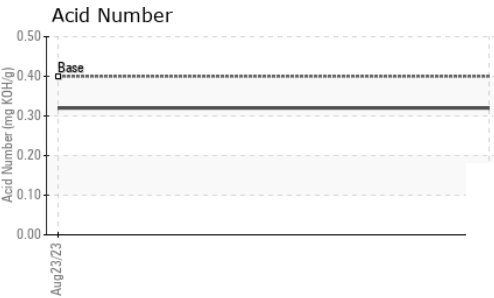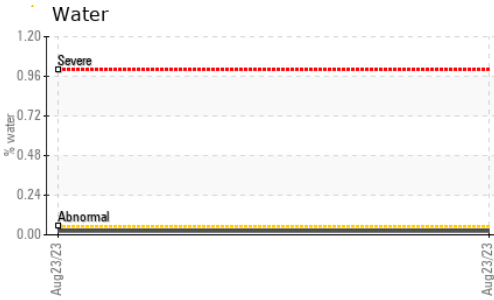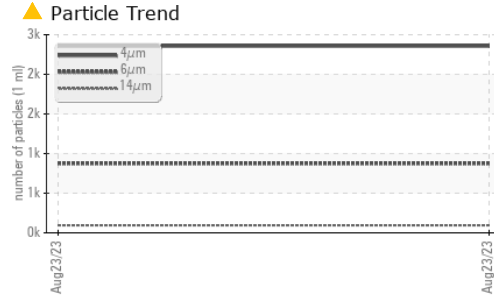





VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	---
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	---
Silt	scalar	*Visual	NONE	<b>NONE</b>	---
Debris	scalar	*Visual	NONE	<b>NONE</b>	---
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	---
Appearance	scalar	*Visual	NORML	<b>NORML</b>	---
Odor	scalar	*Visual	NORML	<b>NORML</b>	---
Emulsified Water	scalar	*Visual	>0.05	<b>NEG</b>	---
Free Water	scalar	*Visual		<b>NEG</b>	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	46	<b>44.5</b>	---

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

Color				no image	no image
Bottom				no image	no image

## GRAPHS

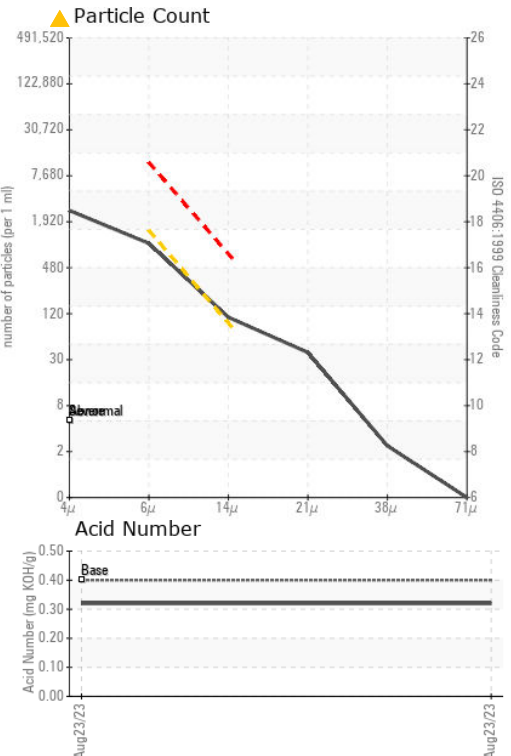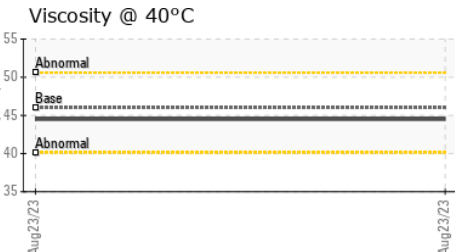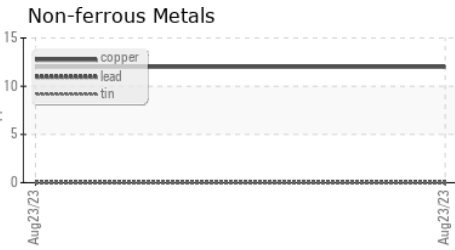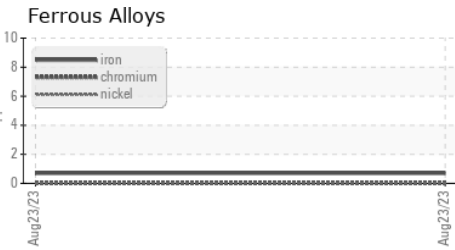

Certificate L2367

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KC05938321 **Received** : 30 Aug 2023  
**Lab Number** : 05938321 **Diagnosed** : 31 Aug 2023  
**Unique Number** : 10628933 **Diagnostician** : Doug Bogart  
**Test Package** : IND 2

**CTM LABELING**  
 1318 QUAKER CIR  
 SALEM, OH  
 US 44460  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.

\* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: