




# OIL ANALYSIS REPORT

Sample Rating Trend

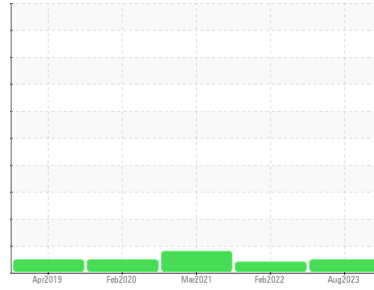

**NORMAL**



Machine Id  
**KAESER ASD 30 5783115 (S/N 1303)**

Component  
**Compressor**

Fluid  
**KAESER SIGMA (OEM) S-460 (--- QTS)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>KCPA001763</b>	KCP41002	KCP27029
Sample Date	Client Info		<b>08 Aug 2023</b>	21 Feb 2022	03 Mar 2021
Machine Age	hrs	Client Info	<b>38332</b>	27264	18786
Oil Age	hrs	Client Info	<b>0</b>	8478	18786
Oil Changed	Client Info		<b>N/A</b>	Changed	Changed
Sample Status			<b>NORMAL</b>	ATTENTION	ATTENTION

## WEAR METALS

	method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m >50	<b>0</b>	<1	<1
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	0
Nickel	ppm	ASTM D5185m >3	<b>0</b>	0	0
Titanium	ppm	ASTM D5185m >3	<b>0</b>	0	0
Silver	ppm	ASTM D5185m >2	<b>0</b>	0	<1
Aluminum	ppm	ASTM D5185m >10	<b>&lt;1</b>	<1	<1
Lead	ppm	ASTM D5185m >10	<b>0</b>	<1	0
Copper	ppm	ASTM D5185m >50	<b>18</b>	9	11
Tin	ppm	ASTM D5185m >10	<b>0</b>	0	<1
Antimony	ppm	ASTM D5185m	<b>---</b>	---	0
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	0
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	0

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	17
Barium	ppm	ASTM D5185m 90	<b>0</b>	9	0
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	0
Manganese	ppm	ASTM D5185m	<b>0</b>	0	0
Magnesium	ppm	ASTM D5185m 90	<b>6</b>	52	38
Calcium	ppm	ASTM D5185m 2	<b>0</b>	1	0
Phosphorus	ppm	ASTM D5185m	<b>2</b>	6	14
Zinc	ppm	ASTM D5185m	<b>107</b>	102	84
Sulfur	ppm	ASTM D5185m	<b>22281</b>	17833	17238

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >25	<b>0</b>	1	0
Sodium	ppm	ASTM D5185m	<b>6</b>	7	17
Potassium	ppm	ASTM D5185m >20	<b>&lt;1</b>	2	2
Water	%	ASTM D6304 >0.05	<b>0.010</b>	0.010	0.014
ppm Water	ppm	ASTM D6304 >500	<b>106.9</b>	109.3	146.1






## FLUID CLEANLINESS

	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647		<b>1636</b>	7499	4833
Particles >6µm	ASTM D7647 >1300		<b>457</b>	▲ 1573	1260
Particles >14µm	ASTM D7647 >80		<b>17</b>	76	▲ 114
Particles >21µm	ASTM D7647 >20		<b>4</b>	16	▲ 31
Particles >38µm	ASTM D7647 >4		<b>0</b>	1	2
Particles >71µm	ASTM D7647 >3		<b>0</b>	0	0
Oil Cleanliness	ISO 4406 (c) >--/17/13		<b>18/16/11</b>	▲ 18/13	▲ 17/14

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045 0.4	<b>0.43</b>	0.35	0.371


# OIL ANALYSIS REPORT

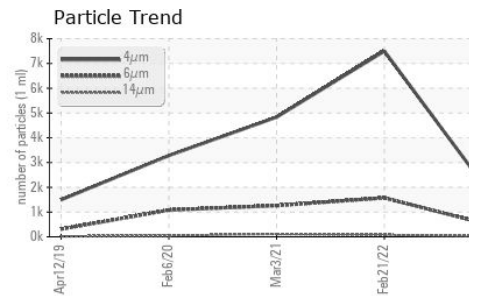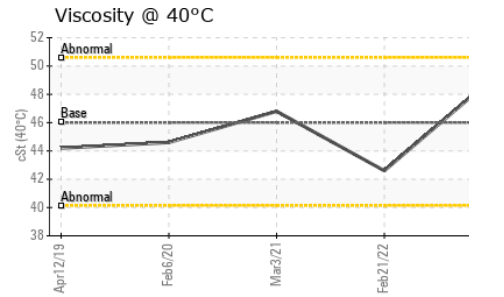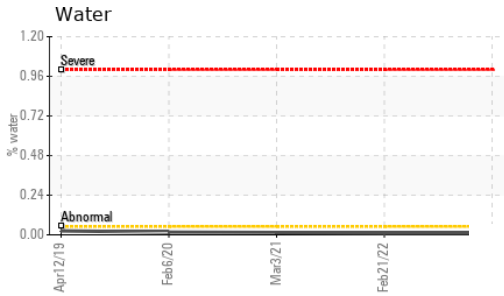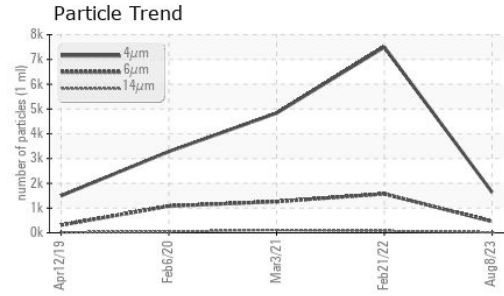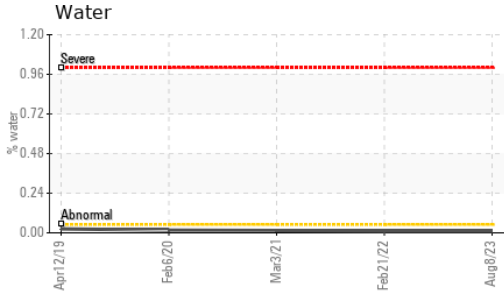






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	NONE
Yellow Metal	scalar	*Visual	NONE	NONE	NONE
Precipitate	scalar	*Visual	NONE	NONE	NONE
Silt	scalar	*Visual	NONE	NONE	NONE
Debris	scalar	*Visual	NONE	NONE	LIGHT
Sand/Dirt	scalar	*Visual	NONE	NONE	NONE
Appearance	scalar	*Visual	NORML	NORML	NORML
Odor	scalar	*Visual	NORML	NORML	NORML
Emulsified Water	scalar	*Visual	>0.05	NEG	NEG
Free Water	scalar	*Visual		NEG	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2	
Visc @ 40°C	cSt	ASTM D445	46	49.1	42.6	46.8

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

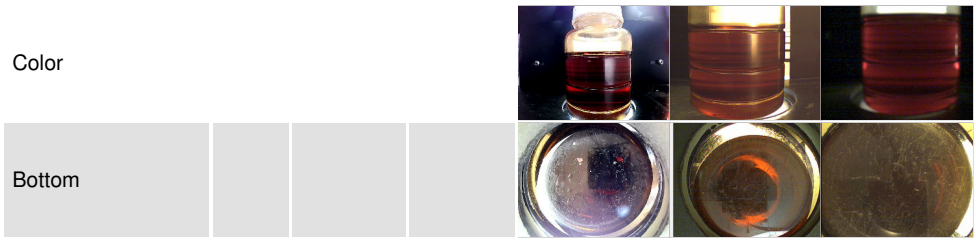

## GRAPHS

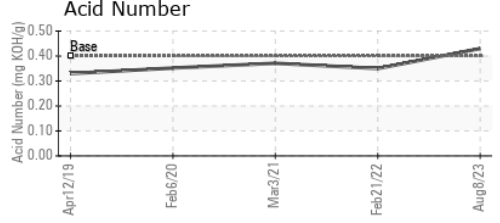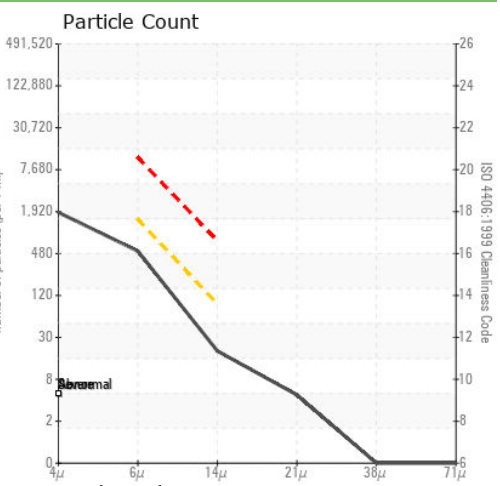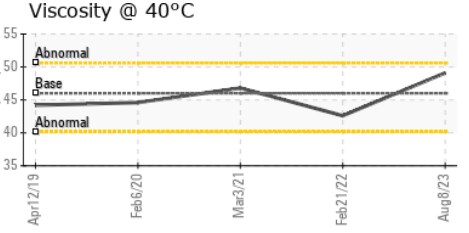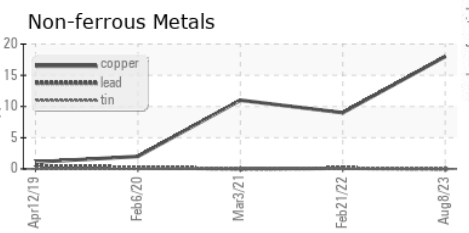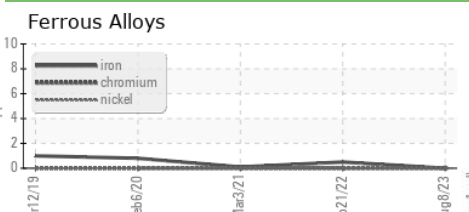

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : KCPA001763 **Received** : 30 Aug 2023  
**Lab Number** : 05938873 **Diagnosed** : 31 Aug 2023  
**Unique Number** : 10629485 **Diagnostician** : Don Baldrige  
**Test Package** : IND 2 ( Additional Tests: KF, PrtCount )

**CBRE**  
 5000 RENAISSANCE DR  
 NEW FREEDOM, PA  
 US 17349  
 Contact: Service Manager

To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

T:  
F: