


OIL ANALYSIS REPORT

Sample Rating Trend



NORMAL



Machine Id **4827408 (S/N 1066)**

Component

Compressor Fluid

KAESER SIGMA (OEM) M-460 (--- GAL)

Recommendation

Resample at the next service interval to monitor.

All component wear rates are normal.

Contamination

The amount and size of particulates present in the system are acceptable. There is no indication of any contamination in the oil.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

			Jan 2023	Aug ² 023		
SAMPLE INFORM	MATION	method	limit/base	current	history1	history2
Sample Number		Client Info		KCPA004367	KCP53129	
Sample Date		Client Info		09 Aug 2023	31 Jan 2023	
Machine Age	hrs	Client Info		74571	70010	
Oil Age	hrs	Client Info		0	7818	
Oil Changed		Client Info		N/A	Changed	
Sample Status				NORMAL	ABNORMAL	
WEAR METALS		method	limit/base	current	history1	history2
Iron	ppm	ASTM D5185m	>50	0	0	
Chromium	ppm	ASTM D5185m	>10	0	0	
Nickel	ppm	ASTM D5185m	>3	0	0	
Titanium	ppm	ASTM D5185m	>3	0	0	
Silver	ppm	ASTM D5185m	>2	0	0	
Aluminum	ppm	ASTM D5185m	>10	<1	0	
Lead	ppm	ASTM D5185m	>10	0	0	
Copper	ppm	ASTM D5185m	>50	1	3	
Tin	ppm	ASTM D5185m	>10	0	0	
Vanadium	ppm	ASTM D5185m		0	0	
Cadmium	ppm	ASTM D5185m		0	0	
ADDITIVES		method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	0	
Barium	ppm	ASTM D5185m	90	0	0	
Molybdenum	ppm	ASTM D5185m	0	0	0	
Manganese	ppm	ASTM D5185m		0	0	
Magnesium	ppm	ASTM D5185m	100	2	1	
Calcium	ppm	ASTM D5185m	0	0	0	
Phosphorus	ppm	ASTM D5185m	0	<1	3	
Zinc	ppm	ASTM D5185m	0	2	2	
Sulfur	ppm	ASTM D5185m	23500	21679	17120	
CONTAMINANTS	;	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m	>25	9	11	
Sodium	ppm	ASTM D5185m		2	0	
Potassium	ppm	ASTM D5185m	>20	0	<1	
Water	%	ASTM D6304	>0.05	0.002	0.005	
ppm Water	ppm	ASTM D6304	>500	21.4	52.8	
FLUID CLEANLIN	IESS	method	limit/base	current	history1	history2
Particles >4μm		ASTM D7647		1645	41880	
Particles >6µm		ASTM D7647	>1300	516	17700	
Particles >14μm		ASTM D7647	>80	39	<u> </u>	
Particles >21µm		ASTM D7647	>20	7	<u>436</u>	
Particles >38µm		ASTM D7647	>4	0	<u>^</u> 26	
Particles >71µm		ASTM D7647	>3	0	1	
Oil Cleanliness		ISO 4406 (c)	>/17/13	18/16/12	<u>\$\rightarrow\$ 23/21/18</u>	
FLUID DEGRADA	ATION	method	limit/base	current	history1	history2
Asid Number (ANI)	ma 1/011/-	ACTM DOGGE	1.0	0.41	0.40	

Acid Number (AN)


mg KOH/g ASTM D8045 1.0

0.40

0.41



OIL ANALYSIS REPORT

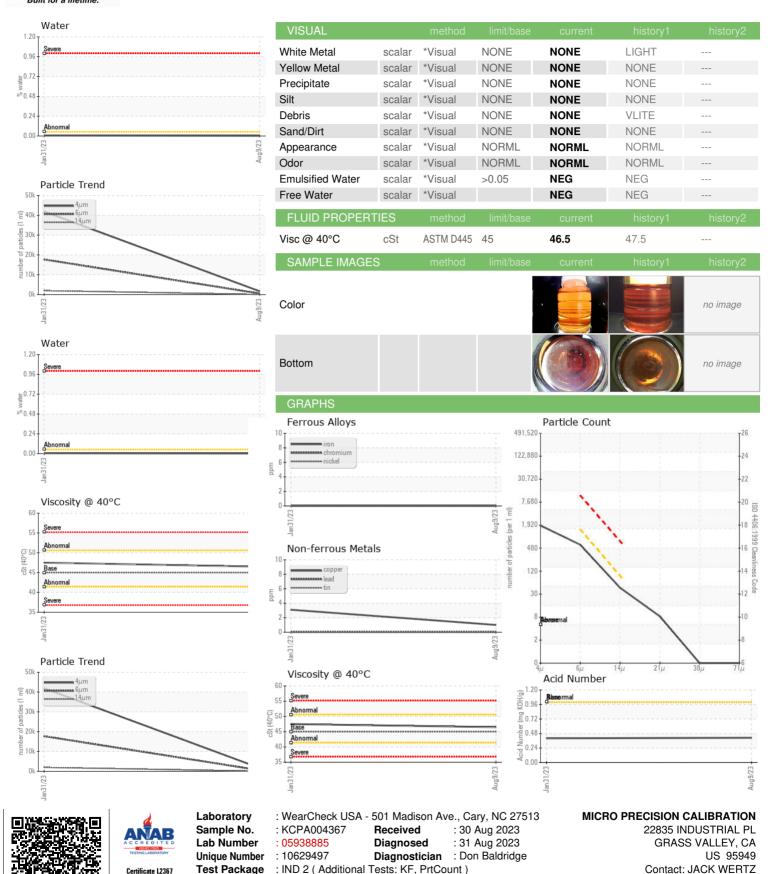

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

jack.wertz@microprecision.com

T: F: