




PROBLEM SUMMARY

Sample Rating Trend

WEAR




Machine Id
49262091 (S/N 13336)
Component
Hydraulic System
Fluid
MOBIL DTE 24 (--- GAL)

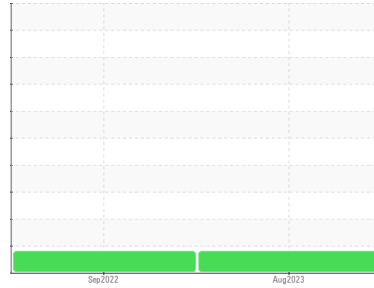

COMPONENT CONDITION SUMMARY

▲ Non-ferrous Metals

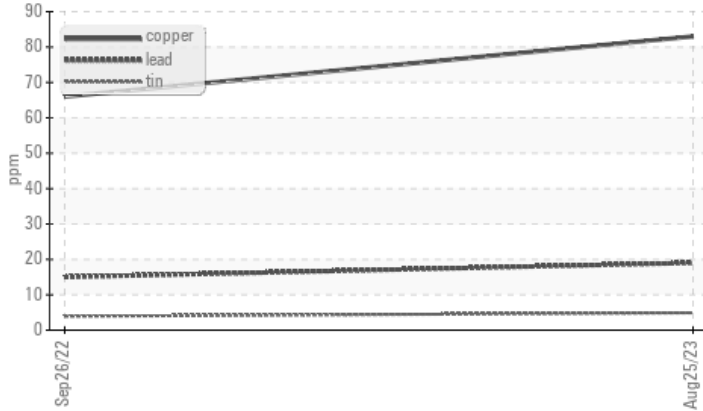

RECOMMENDATION

No corrective action is recommended at this time.
Resample at the next service interval to monitor.

PROBLEMATIC TEST RESULTS

Sample Status				MARGINAL	ABNORMAL	---
Copper	ppm	ASTM D5185m	>200	▲ 83	▲ 66	---

Customer Id: TECGRENC
Sample No.: WC0844264
Lab Number: 05939036
Test Package: PLANT



To manage this report scan the QR code

To discuss the diagnosis or test data:
Doug Bogart +1 (800)237-1369 x4016
dougb@wearcheckusa.com

To change component or sample information:
Customer Service +1 1-800-237-1369
customerservice@wearcheck.com

RECOMMENDED ACTIONS

Action	Status	Date	Done By	Description
Information Required	---	---	?	Please specify the brand, type, and viscosity of the oil on your next sample.

HISTORICAL DIAGNOSIS

26 Sep 2022 Diag: Angela Borella

WEAR



No corrective action is recommended at this time. Resample at the next service interval to monitor. The copper level is abnormal. All other component wear rates are normal. The amount and size of particulates present in the system are acceptable. The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

view report





OIL ANALYSIS REPORT

Sample Rating Trend


WEAR



Machine Id
49262091 (S/N 13336)

Component
Hydraulic System

Fluid
MOBIL DTE 24 (--- GAL)

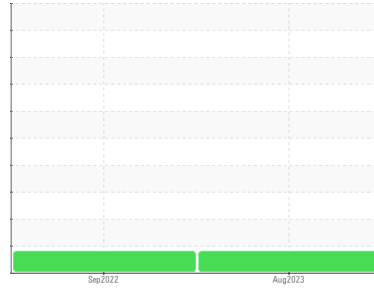

DIAGNOSIS

▲ Recommendation

No corrective action is recommended at this time. Resample at the next service interval to monitor.

▲ Wear

The copper level is abnormal. All other component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is acceptable for the time in service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0844264	WC0731069	---
Sample Date	Client Info		25 Aug 2023	26 Sep 2022	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			MARGINAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		13	---	---
Iron	ppm	ASTM D5185m >200	11	9	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >10	1	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	<1	---
Aluminum	ppm	ASTM D5185m >25	0	<1	---
Lead	ppm	ASTM D5185m >50	19	15	---
Copper	ppm	ASTM D5185m >200	▲ 83	▲ 66	---
Tin	ppm	ASTM D5185m >10	5	4	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	2	---
Barium	ppm	ASTM D5185m	2	3	---
Molybdenum	ppm	ASTM D5185m	2	3	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	17	17	---
Calcium	ppm	ASTM D5185m	186	191	---
Phosphorus	ppm	ASTM D5185m	471	476	---
Zinc	ppm	ASTM D5185m	704	704	---
Sulfur	ppm	ASTM D5185m	5106	5405	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	2	2	---
Sodium	ppm	ASTM D5185m	0	0	---
Potassium	ppm	ASTM D5185m >20	1	1	---

FLUID CLEANLINESS





	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	219	2373	---
Particles >6µm	ASTM D7647	>5000	52	198	---
Particles >14µm	ASTM D7647	>640	12	4	---
Particles >21µm	ASTM D7647	>160	5	1	---
Particles >38µm	ASTM D7647	>40	0	0	---
Particles >71µm	ASTM D7647	>10	0	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	15/13/11	18/15/9	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.69	0.74	---




OIL ANALYSIS REPORT

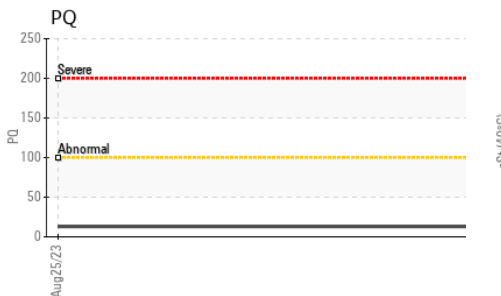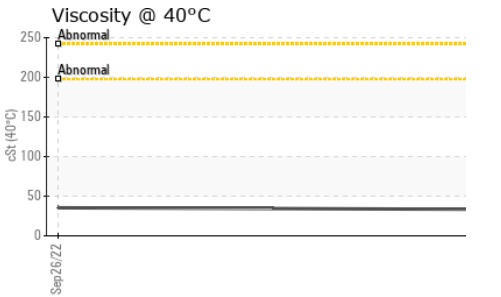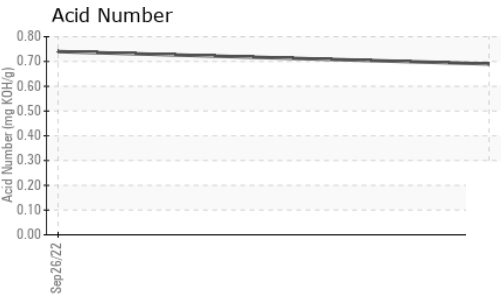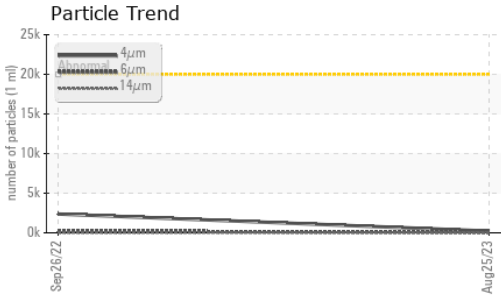






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.2	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	33.4	35.4	---

SAMPLE IMAGES

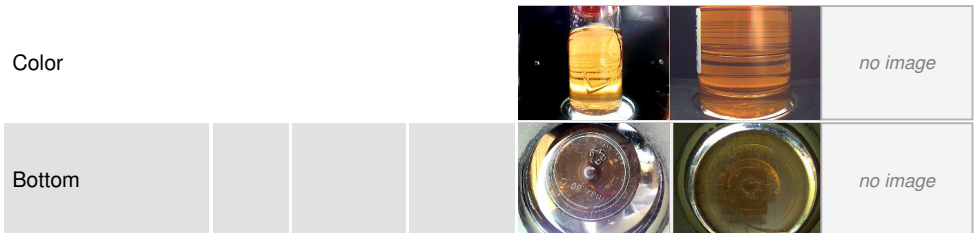

GRAPHS

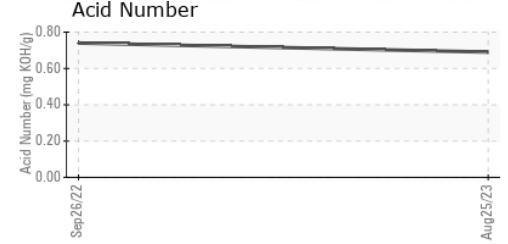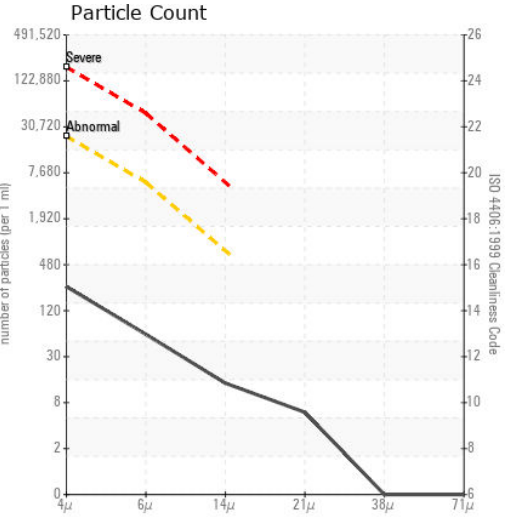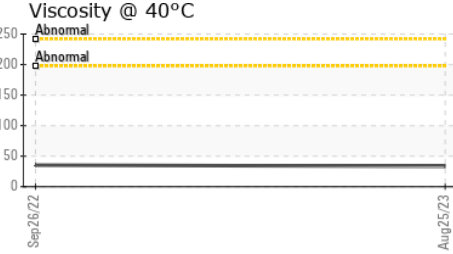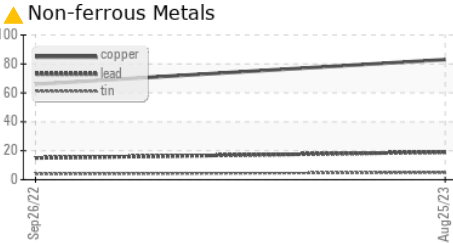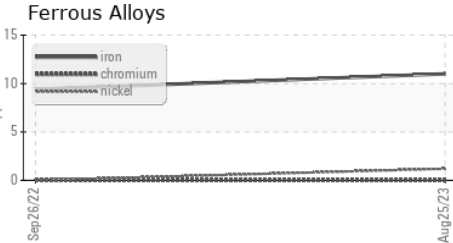

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
Sample No. : WC0844264 **Received** : 30 Aug 2023
Lab Number : 05939036 **Diagnosed** : 06 Sep 2023
Unique Number : 10629648 **Diagnostician** : Doug Bogart
Test Package : PLANT

TE CONNECTIVITY
 719 PEGG RD
 GREENSBORO, NC
 US 27409
 Contact: BILLIE WALLACE
 billie.wallace@te.com
 T:
 F:

Certificate L2367
 To discuss this sample report, contact Customer Service at 1-800-237-1369.
 * - Denotes test methods that are outside of the ISO 17025 scope of accreditation.
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)