



OIL ANALYSIS REPORT

Sample Rating Trend


NORMAL



Machine Id
51049117 (S/N 14128)

Component
Hydraulic System

Fluid
MOBIL DTE 24 (--- GAL)

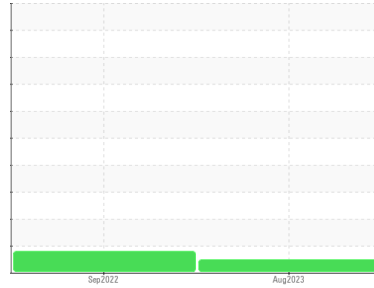

DIAGNOSIS

Recommendation

Resample at the next service interval to monitor.

Wear

All component wear rates are normal.

Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		WC0844272	WC0731076	---
Sample Date	Client Info		25 Aug 2023	26 Sep 2022	---
Machine Age	hrs	Client Info	0	0	---
Oil Age	hrs	Client Info	0	0	---
Oil Changed	Client Info		N/A	N/A	---
Sample Status			NORMAL	ABNORMAL	---

WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		14	---	---
Iron	ppm	ASTM D5185m >150	4	<1	---
Chromium	ppm	ASTM D5185m >10	0	0	---
Nickel	ppm	ASTM D5185m >10	<1	0	---
Titanium	ppm	ASTM D5185m	0	0	---
Silver	ppm	ASTM D5185m	0	0	---
Aluminum	ppm	ASTM D5185m >25	0	<1	---
Lead	ppm	ASTM D5185m >100	7	3	---
Copper	ppm	ASTM D5185m >50	43	13	---
Tin	ppm	ASTM D5185m >10	1	0	---
Vanadium	ppm	ASTM D5185m	0	0	---
Cadmium	ppm	ASTM D5185m	0	0	---

ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	0	0	---
Barium	ppm	ASTM D5185m	3	3	---
Molybdenum	ppm	ASTM D5185m	<1	<1	---
Manganese	ppm	ASTM D5185m	0	<1	---
Magnesium	ppm	ASTM D5185m	2	<1	---
Calcium	ppm	ASTM D5185m	77	63	---
Phosphorus	ppm	ASTM D5185m	362	316	---
Zinc	ppm	ASTM D5185m	630	526	---
Sulfur	ppm	ASTM D5185m	1218	927	---

CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	2	1	---
Sodium	ppm	ASTM D5185m	0	0	---
Potassium	ppm	ASTM D5185m >20	1	1	---

FLUID CLEANLINESS






	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	857	▲ 11042	---
Particles >6µm	ASTM D7647	>5000	79	751	---
Particles >14µm	ASTM D7647	>640	15	7	---
Particles >21µm	ASTM D7647	>160	6	0	---
Particles >38µm	ASTM D7647	>40	0	0	---
Particles >71µm	ASTM D7647	>10	0	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	17/13/11	▲ 21/17/10	---

FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	0.47	0.48	---




OIL ANALYSIS REPORT

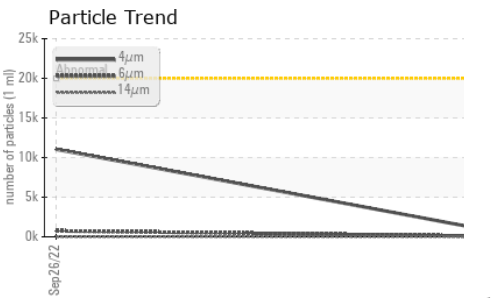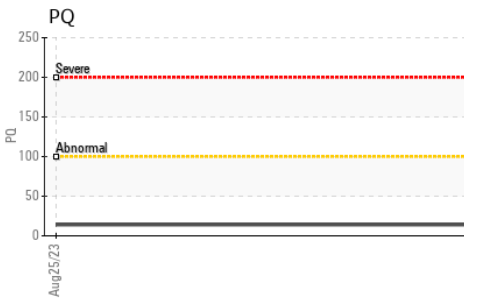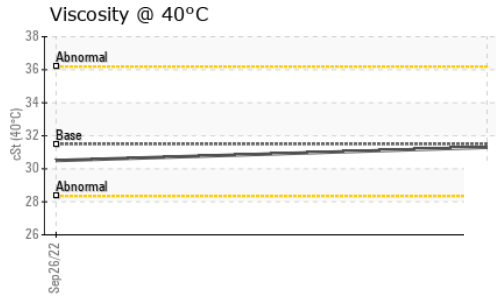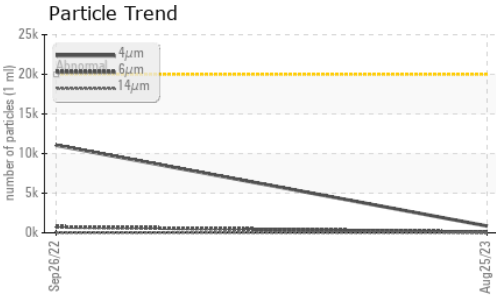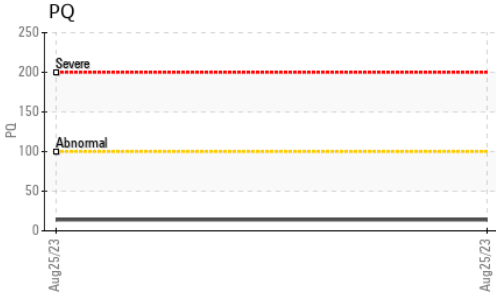






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	NONE	---
Yellow Metal	scalar	*Visual	NONE	NONE	---
Precipitate	scalar	*Visual	NONE	NONE	---
Silt	scalar	*Visual	NONE	NONE	---
Debris	scalar	*Visual	NONE	NONE	---
Sand/Dirt	scalar	*Visual	NONE	NONE	---
Appearance	scalar	*Visual	NORML	NORML	---
Odor	scalar	*Visual	NORML	NORML	---
Emulsified Water	scalar	*Visual	>0.1	NEG	---
Free Water	scalar	*Visual		NEG	---

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5	31.3	30.5

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

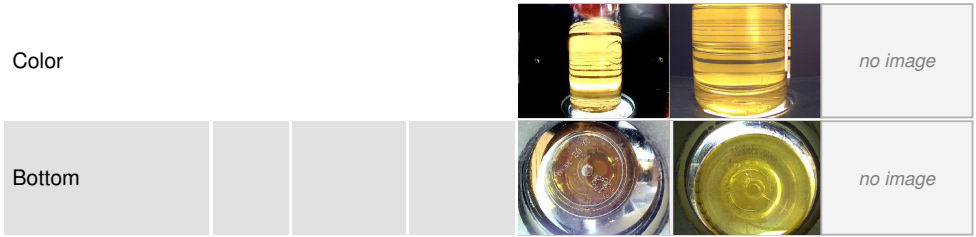

GRAPHS

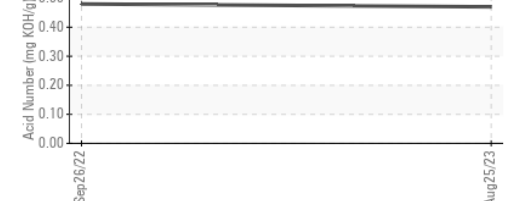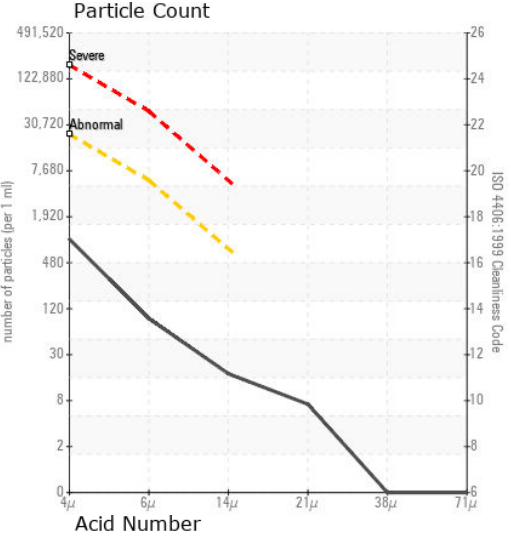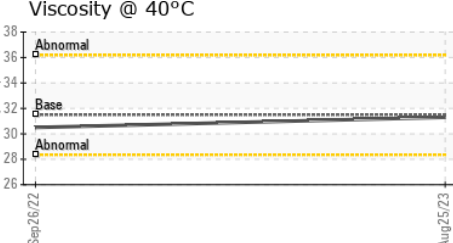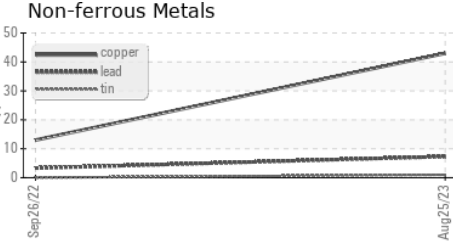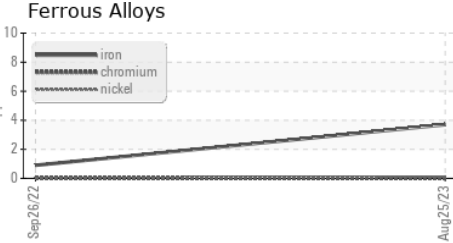

Certificate L2367

Laboratory : WearCheck USA - 501 Madison Ave., Cary, NC 27513
 Sample No. : WC0844272
 Lab Number : 05939045
 Unique Number : 10629657
 Test Package : PLANT

Received : 30 Aug 2023
 Diagnosed : 19 Sep 2023
 Diagnostician : Doug Bogart

To discuss this sample report, contact Customer Service at 1-800-237-1369.

* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.

Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)

TE CONNECTIVITY
 719 PEGG RD
 GREENSBORO, NC
 US 27409
 Contact: BILLIE WALLACE
 billie.wallace@te.com

T:
F: