




# OIL ANALYSIS REPORT

Sample Rating Trend

**NORMAL**

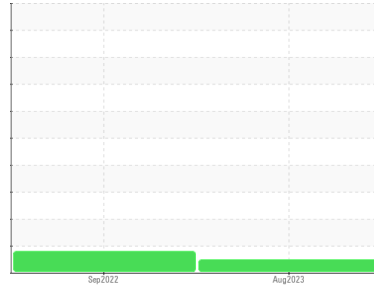

Machine Id  
**50499497 (S/N 13925)**

Component  
**Hydraulic System**

Fluid  
**MOBIL DTE 24 (--- GAL)**

## DIAGNOSIS

### Recommendation

Resample at the next service interval to monitor.

### Wear

All component wear rates are normal.

### Contamination

There is no indication of any contamination in the oil. The amount and size of particulates present in the system are acceptable.

### Fluid Condition

The AN level is acceptable for this fluid. The condition of the oil is suitable for further service.

## SAMPLE INFORMATION

	method	limit/base	current	history1	history2
Sample Number	Client Info		<b>WC0844270</b>	WC0731096	---
Sample Date	Client Info		<b>25 Aug 2023</b>	26 Sep 2022	---
Machine Age	hrs	Client Info	<b>0</b>	0	---
Oil Age	hrs	Client Info	<b>0</b>	0	---
Oil Changed	Client Info		<b>N/A</b>	N/A	---
Sample Status			<b>NORMAL</b>	ABNORMAL	---

## WEAR METALS

	method	limit/base	current	history1	history2
PQ	ASTM D8184		<b>13</b>	---	---
Iron	ppm	ASTM D5185m >150	<b>10</b>	8	---
Chromium	ppm	ASTM D5185m >10	<b>0</b>	0	---
Nickel	ppm	ASTM D5185m >10	<b>&lt;1</b>	0	---
Titanium	ppm	ASTM D5185m	<b>0</b>	0	---
Silver	ppm	ASTM D5185m	<b>0</b>	0	---
Aluminum	ppm	ASTM D5185m >25	<b>0</b>	<1	---
Lead	ppm	ASTM D5185m >100	<b>10</b>	8	---
Copper	ppm	ASTM D5185m >50	<b>55</b>	▲ 42	---
Tin	ppm	ASTM D5185m >10	<b>2</b>	2	---
Vanadium	ppm	ASTM D5185m	<b>0</b>	0	---
Cadmium	ppm	ASTM D5185m	<b>0</b>	0	---

## ADDITIVES

	method	limit/base	current	history1	history2
Boron	ppm	ASTM D5185m	<b>0</b>	0	---
Barium	ppm	ASTM D5185m	<b>3</b>	4	---
Molybdenum	ppm	ASTM D5185m	<b>0</b>	0	---
Manganese	ppm	ASTM D5185m	<b>0</b>	<1	---
Magnesium	ppm	ASTM D5185m	<b>2</b>	1	---
Calcium	ppm	ASTM D5185m	<b>131</b>	133	---
Phosphorus	ppm	ASTM D5185m	<b>448</b>	475	---
Zinc	ppm	ASTM D5185m	<b>708</b>	729	---
Sulfur	ppm	ASTM D5185m	<b>3168</b>	3652	---

## CONTAMINANTS

	method	limit/base	current	history1	history2
Silicon	ppm	ASTM D5185m >50	<b>2</b>	2	---
Sodium	ppm	ASTM D5185m	<b>0</b>	0	---
Potassium	ppm	ASTM D5185m >20	<b>2</b>	1	---

## FLUID CLEANLINESS




	method	limit/base	current	history1	history2
Particles >4µm	ASTM D7647	>20000	<b>464</b>	749	---
Particles >6µm	ASTM D7647	>5000	<b>46</b>	58	---
Particles >14µm	ASTM D7647	>640	<b>3</b>	4	---
Particles >21µm	ASTM D7647	>160	<b>2</b>	1	---
Particles >38µm	ASTM D7647	>40	<b>0</b>	0	---
Particles >71µm	ASTM D7647	>10	<b>0</b>	0	---
Oil Cleanliness	ISO 4406 (c)	>21/19/16	<b>16/13/9</b>	17/13/9	---

## FLUID DEGRADATION

	method	limit/base	current	history1	history2
Acid Number (AN)	mg KOH/g	ASTM D8045	<b>0.83</b>	0.81	---




# OIL ANALYSIS REPORT

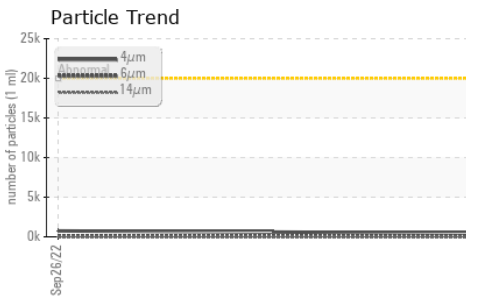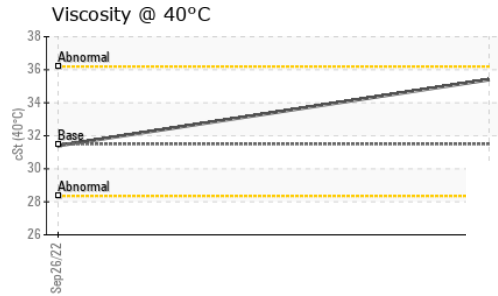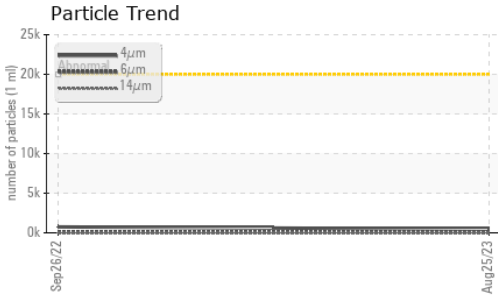






VISUAL	method	limit/base	current	history1	history2
White Metal	scalar	*Visual	NONE	<b>LIGHT</b>	NONE
Yellow Metal	scalar	*Visual	NONE	<b>NONE</b>	NONE
Precipitate	scalar	*Visual	NONE	<b>NONE</b>	NONE
Silt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Debris	scalar	*Visual	NONE	<b>NONE</b>	NONE
Sand/Dirt	scalar	*Visual	NONE	<b>NONE</b>	NONE
Appearance	scalar	*Visual	NORML	<b>NORML</b>	NORML
Odor	scalar	*Visual	NORML	<b>NORML</b>	NORML
Emulsified Water	scalar	*Visual	>0.1	<b>NEG</b>	NEG
Free Water	scalar	*Visual		<b>NEG</b>	NEG

FLUID PROPERTIES	method	limit/base	current	history1	history2
Visc @ 40°C	cSt	ASTM D445	31.5	<b>35.4</b>	31.4

SAMPLE IMAGES	method	limit/base	current	history1	history2
---------------	--------	------------	---------	----------	----------

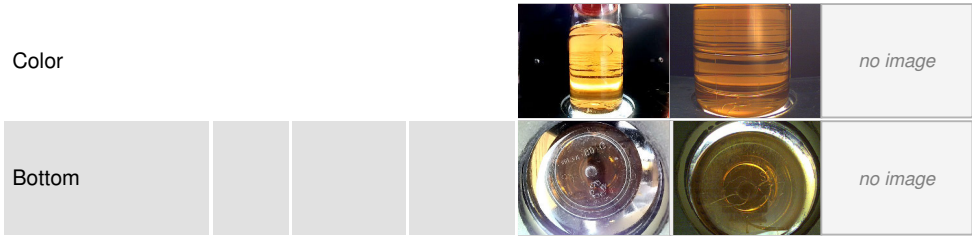

## GRAPHS

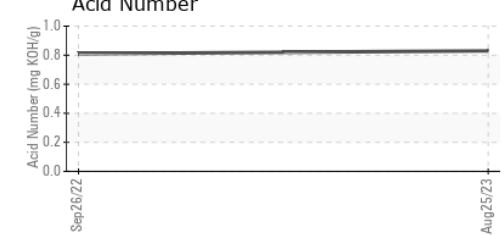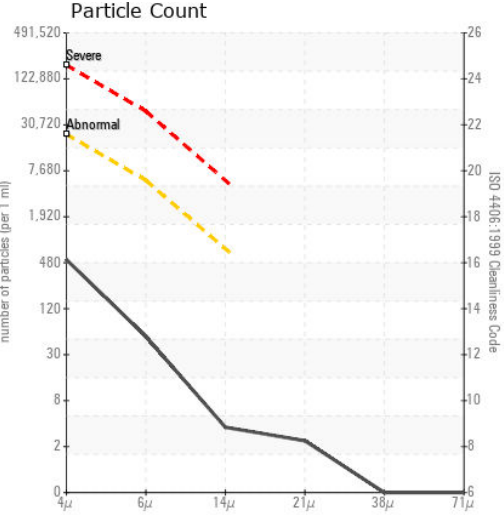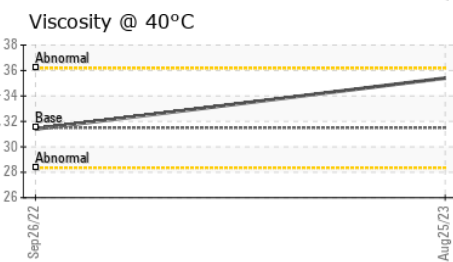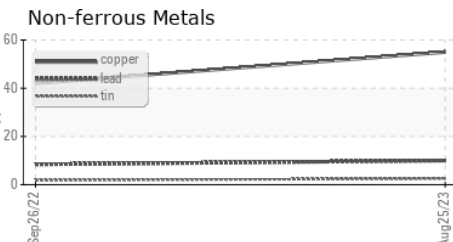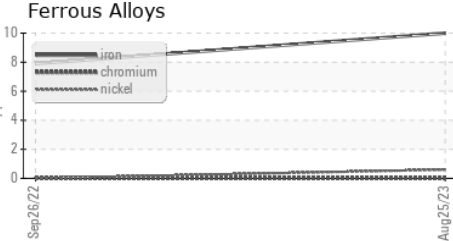

**Laboratory** : WearCheck USA - 501 Madison Ave., Cary, NC 27513  
**Sample No.** : WC0844270 **Received** : 30 Aug 2023  
**Lab Number** : 05939049 **Diagnosed** : 06 Sep 2023  
**Unique Number** : 10629661 **Diagnostician** : Doug Bogart  
**Test Package** : PLANT

**TE CONNECTIVITY**  
 719 PEGG RD  
 GREENSBORO, NC  
 US 27409  
 Contact: BILLIE WALLACE  
 billie.wallace@te.com

Certificate L2367  
 To discuss this sample report, contact Customer Service at 1-800-237-1369.  
 \* - Denotes test methods that are outside of the ISO 17025 scope of accreditation.  
 Statements of conformity to specifications are based on the simple acceptance decision rule (JCGM 106:2012)